

PACKAGED GAS / ELECTRIC

**LGX**

**K-Series™ ROOFTOP UNITS**

Standard Efficiency | Intelli-Guide™ Controller | Eco-Last™ Coil | **R-454B** | 60Hz

**ALLIED**™  
Commercial

COMMERCIAL

PRODUCT SPECIFICATIONS (EHB)

15 to 25 Tons


Net Cooling Capacity | 172,000 to 270,000 Btuh

Gas Input Heat Capacity | 260,000 to 480,000 Btuh

**K-SERIES™**




## MODEL NUMBER IDENTIFICATION

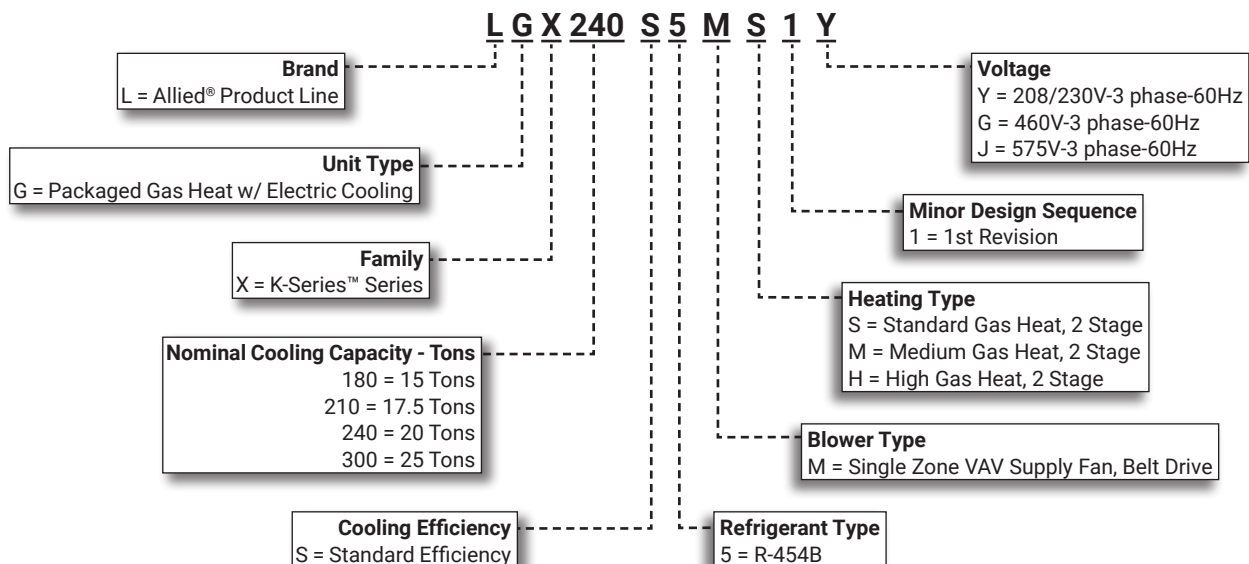

## FEATURE HIGHLIGHTS

K-Series rooftop units are engineered with the right technologies and options to meet standard efficiency requirements while delivering reliable performance and year-round comfort.

1. Heat Exchanger
2. Scroll Compressors
3. Thermal Expansion Valves
4. Filter/Driers
5. Eco-Last™ Coil System
6. Outdoor Coil Fan Motors
7. Cabinet Construction
8. Single Zone VAV  
Air Volume Blower
9. Disconnect Switch (option)
10. Air Filters
11. Intelli-Guide™ Control System
12. Economizer (option)
13. Downflow Barometric Relief Dampers  
(option)
14. Power Exhaust Fans

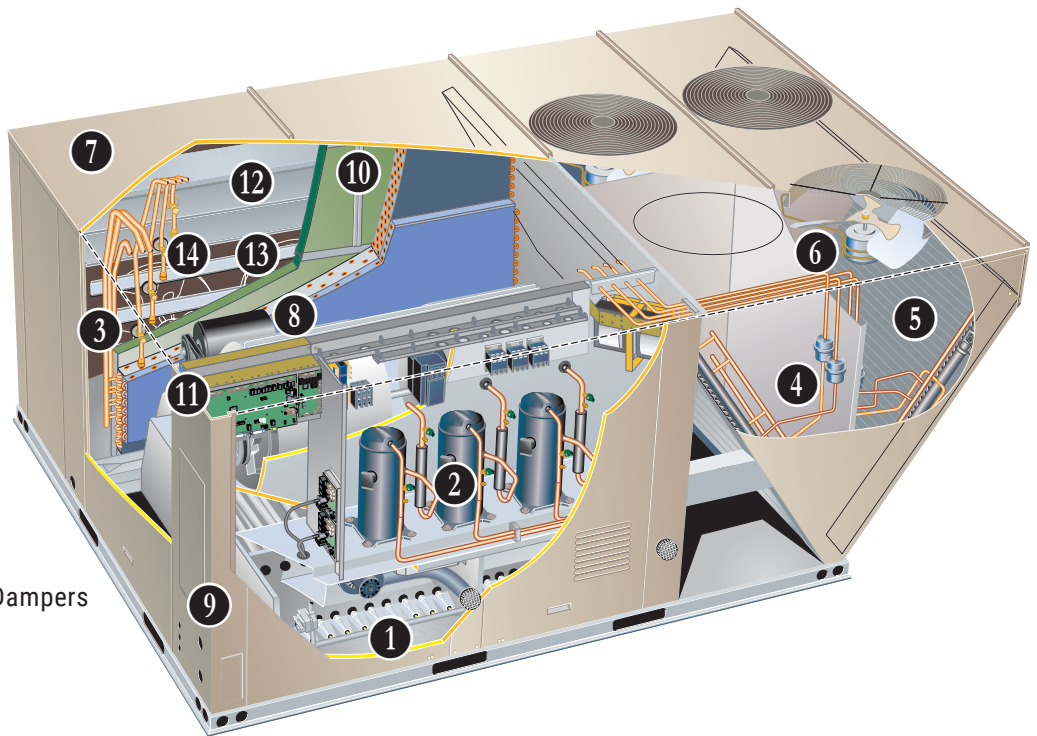

## CONTENTS

Approvals And Warranty . . . . .	3
Blower Data . . . . .	30
Dimensions - Unit . . . . .	38
- LGX180   LGX210 . . . . .	38
- LGX240 . . . . .	39
- LGX300 . . . . .	40
Electrical Accessories - Disconnects . . . . .	35
Electrical Data . . . . .	33
- 15 Ton   17.5 Ton . . . . .	33
- 20 Ton   25 Ton. . . . .	34
Features And Benefits . . . . .	3
High Altitude Derate . . . . .	25
Dehumidification System Option . . . . .	12
Dehumidification System Ratings . . . . .	28
Model Number Identification. . . . .	1
Optional Conventional Temperature Control Systems . . . . .	14
Options / Accessories . . . . .	20
Outdoor Sound Data . . . . .	36
Ratings . . . . .	26
Sequence Of Operation. . . . .	16
Specifications . . . . .	24
- Gas Heat . . . . .	25
- Unit . . . . .	24
Unit Clearances . . . . .	36
Weight Data . . . . .	37

## APPROVALS AND WARRANTY

### **APPROVALS**

- AHRI Standard 340/360-2023 certified
- ETL and CSA listed
- Unit and components are ETL, NEC, and CEC bonded for grounding to meet safety standards for servicing
- All models are ASHRAE 90.1 energy efficiency compliant and meet or exceed requirements of Section 6.8
- All models meet DOE 2023 energy efficiency standards and UL 60335-2-40 Refrigerant Detector Requirements
- All models have HCAI (formerly OSHPD) OSP and Special Seismic Certification ([Number: OSP-0596](#)), and meet 2021 International Building Code (IBC), 2022 California Building Code (CBC) ASCE 7, and ICC-ES AC156
- All models meet California Code of Regulations, Title 24 and ASHRAE 90.1 Section 6.4.3.10 requirements for staged airflow
- ISO 9001 Registered Manufacturing Quality System

### **WARRANTY**

- Aluminumized steel heat exchanger - Limited ten years
- Stainless steel heat exchanger (optional) - Limited fifteen years
- Compressors - Limited five years
- Eco-Last™ Coil System - Limited three years
- Intelli-Guide™ Unit Controller - Limited three years
- Variable-Frequency Drive (VFD) - Limited five years
- High Performance Economizers (optional) - Limited five years

## FEATURES AND BENEFITS

### **HEATING SYSTEM**

- Aluminumized steel inshot burners
- Direct spark ignition
- Electronic flame sensor
- Combustion air inducer
- Redundant automatic dual stage gas valve with manual shut-off

#### **1 Heat Exchanger**

- Tubular construction
- Aluminumized steel
- Life cycle tested

**NOTE** - Optional Stainless Steel Heat Exchanger is required if mixed air temperature is below 45°F.

#### **Electronic Pilot Ignition**

- Provides positive direct ignition of burners on each operating cycle
- System permits main gas valve to stay open only when the burners are proven to be lit
- Should a loss of flame occur, the gas valve closes, shutting off the gas to the burners
- LED indicates status and aid in troubleshooting
- Factory installed in the controls section

#### **Limit Controls**

- Factory installed
- Redundant limit controls with fixed temperature setting
- Protects heat exchanger and other components from overheating

### **Safety Switches**

- Protects system operation
- Flame roll-out switch
- Flame sensor
- Combustion air inducer proving switch

### **Required Selections**

#### **Gas Input Choice - Order one:**

- Standard Gas Heat, 2 Stage (169,000/260,000 Btuh)
- Medium Gas Heat, 2 Stage (234,000/360,000 Btuh)
- High Gas Heat, 2 Stage (312,000/480,000 Btuh)

### **Options / Accessories**

#### **Factory Installed**

##### **Stainless Steel Heat Exchanger**

- Required if mixed air temperature is below 45°F

#### **Field Installed**

##### **Bottom Gas Piping Kit**

- Allows bottom gas entry

##### **Low Temperature Vestibule Heater**

- Electric heater automatically controls minimum temperature in gas burner compartment when temperature is below -40°F
- CSA certified to allow operation of unit down to -60°F

## FEATURES AND BENEFITS

### HEATING SYSTEM (continued)

#### Options / Accessories

#### Field Installed

##### Combustion Air Intake Extensions

- Recommended for use with existing flue extension kits in areas where high snow areas can block intake air
- Order two kits

##### LPG/Propane Kits

- Conversion kit to field change over units from Natural Gas to LPG/Propane
- Order two kits

##### Vertical Vent Extension Kit

- Use to exhaust flue gases vertically above unit
- Required when unit vent is too close to fresh air intakes per building codes
- Also prevents ice formation on intake louvers
- Contains vent transition, vent tee, drain cap, and installation hardware

**NOTE** - Straight vent pipes (4 in. B-Vent) and caps are not furnished and must be field supplied. Refer to kit instructions for additional information.

### COOLING SYSTEM

- Designed to maximize sensible and latent cooling performance at design conditions
- System can operate from 45°F to 125°F without any additional controls

#### R-454B Refrigerant

- Low GWP (Global Warming Potential)
- Zero ODP (Ozone Depletion Potential)
- Low Toxicity/Lower Flammability - A2L
- Unit is factory pre-charged

#### 2 Scroll Compressors

- Scroll compressors on all models for high performance, reliability, and quiet operation
- Resiliently mounted on rubber grommets for quiet operation

#### Compressor Crankcase Heaters

- Protects against refrigerant migration that can occur during low ambient operation or during extended off cycles

#### 3 Thermal Expansion Valves

- Ensures optimal performance throughout the application range
- Removable element head

#### 4 Filter/Driers

- High capacity filter/drier protects the system from dirt and moisture

#### High Pressure Switches

- Protects the compressor from overload conditions such as dirty condenser coils, blocked refrigerant flow or loss of outdoor fan operation

#### Low Pressure Switches

- Protects the compressors from low pressure conditions such as low refrigerant charge or low/no airflow


#### Indoor Coil Freeze Protection

- Protects the evaporator coil from damaging ice build-up due to conditions such as low/no airflow or low refrigerant charge

#### 5 Condenser Coil - Eco-Last™ Coil System

Lightweight, all aluminum brazed fin construction

- Constructed of three components
  - A flat extrusion tube
  - Fins in-between the flat extrusion tube
  - Two refrigerant manifolds



#### Eco-Last™ Coil System Features:

- Improved heat transfer performance due to high primary surface area (flat tubes) versus secondary surface (fins)
- Smaller internal volume (reduced refrigerant charge)
- High durability
- All aluminum construction
- Fewer brazed joints
- Compact design
- Reduced unit weight
- Easy maintenance/cleaning
- Mounting brackets with rubber inserts secure coil to unit providing vibration dampening and corrosion protection
- Angled cabinet design protects coil from damage

#### Evaporator Coil

- Copper tube construction
- Enhanced rippled-edge aluminum fins
- Flared shoulder tubing connections
- Silver soldered construction
- Factory leak tested
- Cross-row circuiting with rifled tubing

#### Antimicrobial Condensate Drain Pan

- Composite pan, sloped to meet drainage requirements of ASHRAE 62.1
- Antimicrobial additive resists growth of mold and mildew on drain pan, which improves indoor air quality and reduces drain line blockage
- Side or bottom drain connections

#### 6 Outdoor Coil Fan Motors

- Thermal overload protected
- Totally enclosed
- Permanently lubricated ball bearings
- Shaft up
- Wire basket mount

#### Outdoor Coil Fans

- PVC coated fan guard furnished

## FEATURES AND BENEFITS

### **COOLING SYSTEM (continued)**

#### **Required Selections**

##### **Cooling Capacity**

- Specify nominal cooling capacity

#### **Options/Accessories**

### **Field Installed**

#### **Condensate Drain Trap**

- Available in copper or PVC

#### **Drain Pan Overflow Switch**

- Monitors condensate level in drain pan
- Shuts down unit if drain becomes clogged

#### **Low Ambient Controls (0°F)**

- Units operate satisfactorily down to 45°F outdoor air temperature without any additional controls
- Allows unit operation down to 0°F without evaporator coil icing
- Head pressure speed control reduces outdoor fan operation during low ambient conditions unit head pressure rises to the setpoint
- Pressure transducers are mounted on the liquid lines
- Liquid line pressure switches and temperature switches are provided for field installation
- Wiring harnesses are furnished for simple plug-in wiring to fans and controller

### **LOW GWP REFRIGERANT DETECTION SYSTEM (RDS)**

- Complies with UL 60335-2-40 approved standard
- Required for all systems using R-454B refrigerant
- Factory installed on all units
- Consists of a refrigerant detection sensor(s) and a mitigation control
- Ensures safe operation for systems equipped with R-454B refrigerant
- Sensor(s) monitors indoor coil area for R-454B refrigerant
- If R-454B refrigerant is detected the refrigerant detection system will prevent compressor and heating operation until R-454B refrigerant is no longer detected
- Refrigeration detection system energizes blower if any R-454B refrigerant is detected to mitigate any concentrations of refrigerant from the unit and the system

### **CABINET**

#### **7 Construction**

- Heavy-gauge steel panels
- Full perimeter heavy-gauge galvanized steel base rail
- Base rails have rigging holes
- Three sides of the base rail have forklift slots
- Raised edges around duct and power entry openings in the bottom of the unit for water protection

#### **Airflow Choice**

- Units are shipped in downflow (vertical) return air flow configuration

**NOTE** - Units can be field converted to horizontal air flow with optional Horizontal Return Air Panel Kit and Horizontal Roof Curb.

#### **Power/Gas Entry**

- Electrical and gas lines can be routed through the unit base or through horizontal access knock-outs

#### **Exterior Panels**

- Constructed of heavy-gauge, galvanized steel
- Textured pre-paint with polyurethane finish
- Cyclic salt fog and UV exposure up to 1,680 hours per ASTM D5894

#### **Insulation**

- Fully insulated with non-hygroscopic fiberglass insulation (conditioned areas)
- Unit base is fully insulated
- Base insulation serves as an air seal to the roof curb, eliminating the need to add a seal during installation

#### **Access Panels**

- Economizer/Filter section
- Heating/Blower section
- Compressor/Controls section

#### **Options/Accessories**

### **Factory Installed**

#### **Hinged Access Panels**

- Tool-less access
- Filter section
- Heating/Blower section
- Compressor/Controls section
- Panel seals and quarter-turn latching handles provide a tight air and water seal

### **Field Installed**

#### **Combination Coil/Hail Guards**

- Heavy gauge steel frame
- Painted to match cabinet
- Expanded metal mesh protects outdoor coil

#### **Horizontal Return Air Panel Kit**

- Required for horizontal applications with Horizontal Roof Curb
- Contains panel with return air opening for field replacement of existing unit panel and panel to cover bottom return air opening in unit
- See dimension drawings

## FEATURES AND BENEFITS

### **BLOWER**

A wide selection of supply air blower options are available to meet a variety of airflow requirements

#### **Motor**

- Overload protected
- Ball bearings

#### **8 Supply Air Blower**

- Forward curved blades
- Double inlet
- Blower wheel is statically and dynamically balanced
- Ball bearings
- Adjustable pulley (allows speed change)
- Blower assembly slides out of unit for servicing
- Grease fittings furnished

#### **Blower Proving Switch**

- Monitors blower operation, shuts down unit if blower fails

#### **Single Zone VAV Supply Fan Operation**

- **Single Zone VAV Supply Fan** stages the amount of airflow according to compressor stages, heating demand, ventilation demand or smoke alarm
- Units utilize a Variable Frequency Drive (VFD) to stage the supply air blower airflow
- VFD alters the frequency and voltage of the power supply to the blower to control blower speed
- The amount of airflow for each stage can be set according to a parameter in the Lennox® CORE Unit Controller
- Unit is shipped from the factory we preset airflow
- VFD has an operational range of -40 to 125°F outdoor air ambient temperature
- Lower operating costs are obtained when the blower is operated on lower speeds.

**NOTE** - Units equipped a Variable Frequency Drive (VFD) are designed to operate on balanced, three-phase power. Operating units on unbalanced three-phase power will reduce the reliability of all electrical components in the unit. Unbalanced power is a result of the power delivery system supplied by the local utility company. Factory-installed inverters are sized to drive blower motors with an equivalent current rating using balanced three-phase power. If unbalanced three-phase power is supplied, the installer must replace the existing factory-installed inverter with an inverter that has a higher current rating to allow for the imbalance. Refer to the installation instructions for additional information and replacement information

#### **Ordering Information**

- Specify motor horsepower and drive kit number when base unit is ordered

### **Options/Accessories**

#### **Field Installed**

##### **Blower Belt Auto-Tensioner**

- Provides proper tension to belt drive blower belt without the need for regular adjustments
- Maintains airflow and proper performance

##### **VFD Automatic Bypass Kit**

- Bypass Kit can be used to automatically bypass the VFD and operate the unit in single speed (CAV) blower mode if the inverter needs to be serviced or replaced
- VFD Automatic Bypass Control must be enabled by Config ID on the unit controller



## FEATURES AND BENEFITS

### **ELECTRICAL**

#### **SmartWire™ System**

- Keyed and color-coded wiring connectors prevent miswiring
- Wire coloring scheme is standardized across all models
- Each connection is intuitively labeled to make troubleshooting and servicing quick and easy

#### **Electrical Plugs**

- Positive connection electrical plugs connect common accessories or maintenance parts for easy removal or installation

#### **Phase/Voltage Detection**

- Monitors power supply to ensure correct phase at unit start-up
- If phase is incorrect, the unit will not state and an alarm code reports to the unit controller
- Prevents unit start-up if the unit is in the incorrect phase; unit start-ups in the wrong phase could lead to issues such as compressors functioning in reverse
- Monitors power supply voltage to ensure proper voltage
- If voltage is not correct (over/under voltage conditions) the unit will not start and an alarm code reports to the unit controller

### **Required Selections**

#### **Voltage Choice**

- Specify when ordering base unit

### **Options/Accessories**

#### **Factory or Field Installed**

##### **9 Disconnect Switch**

- Accessible from outside of unit
- Spring loaded weatherproof cover furnished

#### **GFI Service Outlets (2)**

- 115V ground fault circuit interrupter (GFCI) type options:
  - Field installed, non-powered, field wired

#### **Field Installed**

##### **GFI Weatherproof Cover**

- Single-gang cover
- Heavy-duty UV-resistant polycarbonate case construction
- Hinged base cover with gasket

### **INDOOR AIR QUALITY**

##### **10 Air Filters**

- Disposable 2 inch MERV 4 filters furnished as standard

### **Options/Accessories**

#### **Field Installed**

##### **High Efficiency Air Filters**

- Disposable MERV 8, MERV 13 (Minimum Efficiency Reporting Value based on ASHRAE 52.2) efficiency
- 2 inch pleated filters


##### **Indoor Air Quality (CO<sub>2</sub>) Sensors**

- Monitors CO<sub>2</sub> levels
- Reports to the Intelli-Guide™ Unit Controller which adjusts economizer dampers as needed

##### **Replacement Filter Media Kit With Frame**

- Replaces existing pleated filter media
- Includes washable metal mesh screen and metal frame with clip for holding replaceable non-pleated filter

### **INTELLI-GUIDE™ CONTROL SYSTEM**

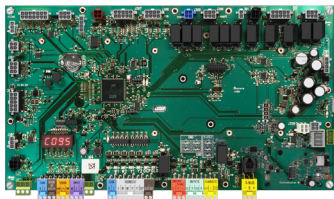

- 11** The Intelli-Guide™ Control System is designed to accelerate equipment install and service. Standard with all E-Series™ rooftop units, control system integrates key technologies that lower installation costs, drive system efficiency, and protect your investments.

The Intelli-Guide™ Unit Controller is a microprocessor-based controller that provides flexible control of all unit functions.

#### **Mobile Service App**

- Guided Setup with progress indicators, detailed help, and exportable summaries to manage simple, trouble-free setup, reducing commissioning times
- Enhanced Test Functionality provides real-time sensor readings, trending, and reports that enable easy troubleshooting
- Ability to set and configure parameters of the Control System to manage sequence of operation
- Economizer test function ensures economizer is operating correctly

#### **Additional Features:**

- Built-In 7-Segment Display shows Unit Status and active alarms for easy troubleshooting
- Buttons for test and clearing delays
- SmartWire™ System with keyed and removable screw terminals ensure correct field wiring
- Built-in BACnet MS/TP and IP allow open integration to building management systems.
- Profile setup copies key settings between units with the same configuration to reduce setup time
- USB port allows a technician to download and transfer unit information to help verify service was performed
- USB software updates on the Intelli-Guide™ Unit Controller enhance functionality without the need to change components

#### **Configurable Built-In Functions**

- Up to three distinct Cooling Airflows in Thermostat Mode
- Programmable independent heating, ventilation and cooling blower speeds
- Economizer Control Options (See Economizer / Exhaust Air / Outdoor Air sections)
- Exhaust Fan Control Modes for fresh air damper position
- Configurable Morning Warm-up
- Night Setback Mode
- Demand Control Ventilation
- Dehumidification Operation

#### **Component Protection / Unit Safeguards:**

- Compressor Time-Off Delay
- Adjustable Blower On/Off Delay
- Return Air Temperature Limit Control
- Safety Switch Input allows Controller to respond to a external safety switch trip
- Service Relay Output
- Thermostat Bounce Delay
- Smoke Alarm Mode has four choices (unit off, positive pressure, negative pressure, purge)
- "Strike Three" Protection
- Gas Valve Time Delay Between First and Second Stage
- Minimum Compressor Run Time

#### **Control Methods / Interfaces:**

- DDC and 24V Thermostat
- BACnet MS/TP (Field Option)
- S-BUS
- Zone Temperature Sensor Input
- Dehumidistat and Humidity Sensor Inputs
- Indoor Air Quality Inputs (2)
- Built-in Control Parameter Defaults
- Permanent Diagnostic Code Storage
- Field Adjustable Control Parameters (Over 200 settings)
- Multiple Configurable Digital Inputs
- LED Indicators

Intelli-Guide™ Control System features vary with the type of rooftop unit in which the control is installed.



## CONTROL SYSTEM

### **INTELLI-GUIDE™ CONTROL SYSTEM (continued)**

#### Controls Options

##### **Field Installed**

##### **Dirty Filter Switch**

- Senses static pressure increase and issues alarm if necessary

##### **Smoke Detector**

- Photoelectric type
- Installed in supply air section, return air section or both sections
- Available with power board and single sensor (supply or return) or power board and two sensors (supply and return)
- Power board located in unit control compartment

## OPTIONS / ACCESSORIES

### **ECONOMIZER**

- Economizer operation is set and controlled by the Intelli-Guide™ Unit Controller
- Simple plug-in connections from Economizer to unit controller for easy installation
- All K-Series™ rooftop units are equipped with factory installed CEC Title 24 approved sensors for outside, return and discharge air temperature monitoring

**NOTE** - Optional sensors may be used instead of unit sensors to determine whether outdoor air is suitable for free cooling. See Options/Accessories table.

#### **Factory or Field Installed**

#### **12 High Performance Economizer**

- Approved for California Title 24 building standards
- Low leakage dampers are Air Movement and Control Association International (AMCA) Class 1A Certified - Maximum 3 CFM per sq. ft. leakage at 1 in. w.g.
- ASHRAE 90.1 and IECC compliant
- Downflow or Horizontal with Outdoor Air Hood
- Outdoor Air Hood with mist elimination is included when Economizer is factory installed and is furnished with Economizer when ordered for field installation

**NOTE** - Downflow or horizontal economizer applications require optional Downflow or Horizontal Barometric Relief Dampers with Exhaust Hood.

- Linked damper action
- High torque 24-volt fully-modulating spring return damper motor
- Return air and outdoor air dampers
- Plug-in connections to unit

**NOTE** - High Performance Economizers are not approved for use with enthalpy controls in Title 24 applications.

**NOTE** - The Free Cooling setpoint for Title 24 applications must be set based on the Climate Zone where the system is installed. See Section 140.4 "Prescriptive Requirements for Space Conditioning Systems" of the California Energy Commission's 2019 Building Energy Efficiency Standards.

**NOTE** - Refer to Installation Instructions for complete setup information.

#### **Differential Sensible Control**

- Factory setting
- Uses outdoor air and return air sensors that are furnished with the unit
- The Intelli-Guide™ unit controller compares outdoor air temperature with return air
- When the outdoor air is below the configured setpoint and cooler than return air, the controller activates the Economizer

### **ECONOMIZER (continued)**

#### **Factory or Field Installed**

**NOTE** - Differential Sensible Control can be configured in the field to provide Offset Differential Sensible Control or Single Sensible Control.

**NOTE** - In Offset Differential Sensible Control mode, the Economizer is enabled if the temperature differential (offset) between outdoor air and return air reaches the configured setpoint. In Single Sensible Control mode, the Economizer is enabled when outdoor air temperature falls below the configured setpoint.

#### **Single Enthalpy Control (Not for Title 24)**

- Outdoor air enthalpy sensor enables Economizer if the outdoor enthalpy is less than the setpoint of the control

#### **Field Installed**

#### **Differential Enthalpy Control (Not for Title 24)**

- Order two Single Enthalpy Controls
- One is field installed in the return air section
- One is installed in the outdoor air section
- Allows the Economizer control to select between outdoor air or return air, whichever has lower enthalpy

### **EXHAUST**

#### **Factory or Field Installed**

#### **13 Downflow Barometric Relief Dampers**

- Allow relief of excess air
- Aluminum blade dampers prevent blow back and outdoor air infiltration during off cycle
- Exhaust hood is factory installed when dampers are factory installed with Economizer
- Exhaust hood is furnished with dampers when ordered for field installation
- Bird screen furnished

#### **Field Installed**

#### **14 Power Exhaust Fans**

- Install internal to unit for downflow applications only with Economizer option
- Provides exhaust air pressure relief
- Interlocked to run when supply air blower is operating
- Fans run when outdoor air dampers are 50% open (adjustable)
- Motor is overload protected
- Dual propeller type fans are 20 in. diameter
- Five blades
- Two 1/3 hp motors
- SCCR rated

**NOTE** - Requires Economizer with furnished Outdoor Air Hood and Downflow Barometric Relief Dampers.

**NOTE** - All models are equipped with 2-stage power exhaust fans. Power exhaust operates in 1st stage (one fan) up to 70% of supply air blower speed. Both exhaust fans operate in 2nd stage when supply air blower speed is above 70% (adjustable) of full speed.

#### **Horizontal Barometric Relief Dampers**

- For use when unit is configured for horizontal applications requiring an Economizer
- Allows relief of excess air
- Aluminum blade dampers prevent blow back and outdoor air infiltration during off cycle
- Field installed in return air duct
- Bird screen and hood furnished

## OPTIONS / ACCESSORIES

### **OUTDOOR AIR**

#### **Field Installed**

##### **Motorized Outdoor Air Damper**

- Linked mechanical dampers
- Fully modulating spring return damper motor with plug-in connection
- 0 to 25% (fixed) outdoor air adjustable
- Installs in unit
- Outdoor air hood with bird screen included

##### **Manual Outdoor Air Damper**

- Adjustable slide damper
- Installed in unit
- Outdoor air hood with bird screen included

### **ROOF CURBS**

#### **Field Installed**

- Nailer strip furnished (downflow only)
- Mates to unit
- US National Roofing Contractors Approved
- Shipped knocked down

#### **Downflow**

##### **Hybrid Roof Curbs**

- Interlocking tabs fasten corners together
- No tools required for assembly
- Can also be fastened together with furnished hardware
- Available in 8, 14, 18, and 24 inch heights

##### **Adjustable Pitch Curb**

- Fully adjustable pitch curbs (3/4 in. per foot in any direction) provide a level platform for rooftop units allowing flexible installations on roofs with uneven or sloped angles
- Interlocking tabs fasten corners together
- No tools required for assembly
- Hardware is furnished to connect upper curb with lower curb
- Available in 14 inch height

### **Horizontal**

- Meet National Roofing Code requirements
- Converts unit from downflow to horizontal (side) air flow
- Return air is on unit
- Supply air is on curb
- See dimension drawings
- Available in 26, 30, 37, and 41 inch heights

**NOTE** - Requires Horizontal Return Air Panel Kit.

**NOTE** - Optional Insulation Kit is available to help prevent sweating.

#### **Adaptor Curbs (not shown)**

- Curbs are regionally sourced
- Dimensions vary based upon the source

**NOTE** - Contact your local sales representative for a detailed cut sheet with applicable dimensions.

### **CEILING DIFFUSERS**

#### **Field Installed**

##### **Ceiling Diffusers (Flush or Step-Down)**

- White powder coat finish on diffuser face and grilles
- Insulated UL listed duct liner
- Diffuser box has collars for duct connection
- Step-down diffusers have double deflection blades
- Flush diffusers have fixed blades
- Provisions for suspending
- Internally sealed to prevent recirculation
- Removable return air grille
- Adapts to T-bar ceiling grids or plaster ceilings

##### **Transitions (Supply and Return)**

- Used with diffusers
- Installs in roof curb
- Galvanized steel construction
- Flanges furnished for duct connection to diffusers
- Fully insulated

## DEHUMIDIFICATION SYSTEM OPTION

### **OVERVIEW**

**NOTE** - Dehumidification System only available for Single Zone VAV Supply Fan models

- Factory installed option designed to control humidity
- Provides dehumidification on demand using ASHRAE 90.1 recommended method for comfort conditioning humidity control
- Unit comes equipped with one row reheat coil, solenoid valve

**NOTE** - A dehumidification demand from a relative humidity sensor, dehumidistat, a DDC controller or building automation system is required to control humidity.

Controls are not furnished and must be ordered extra.

### **BENEFITS**

- Improves indoor air quality
- Helps prevent damage due to high humidity levels
- Improves comfort levels by reducing space humidity levels

### **OPERATION**

#### **No Dehumidification Demand**


- The unit will operate conventionally whenever there is a demand for cooling or heating and no dehumidification demand
- Free cooling is only permitted when there is no demand for dehumidification

#### **Dehumidification Demand Only**


- Reheat operation will initiate on a dehumidification demand and does not require a cooling demand
- Unit will operate in the dehumidification mode until the relative humidity of the conditioned space is below the setpoint
- Reheat coil is sized to provide 68°F to 75°F supply air during reheat operation
- This reduces sensible cooling capacity and extends compressor run time to control humidity when the cooling load is low
- A solenoid valve diverts hot gas from the compressor to the reheat coil
- Cooled and dehumidified air from the evaporator is reheated as it passes through the reheat coil
- De-superheated and partially condensed refrigerant continues to the outdoor condenser coil where condensing is completed
- Unit will continue to operate in this mode until the dehumidification demand is satisfied
- Dehumidification and Cooling Demand (Thermostat/ Room Sensor Application)
- If both a dehumidification and a full cooling load demand occur, the system will operate in cooling mode until the cooling demand is satisfied
- Then the system will energize the dehumidification mode

## DEHUMIDIFICATION SYSTEM OPTION

REFRIGERANT SCHEMATIC (180, 210 AND 240 MODELS ONLY)

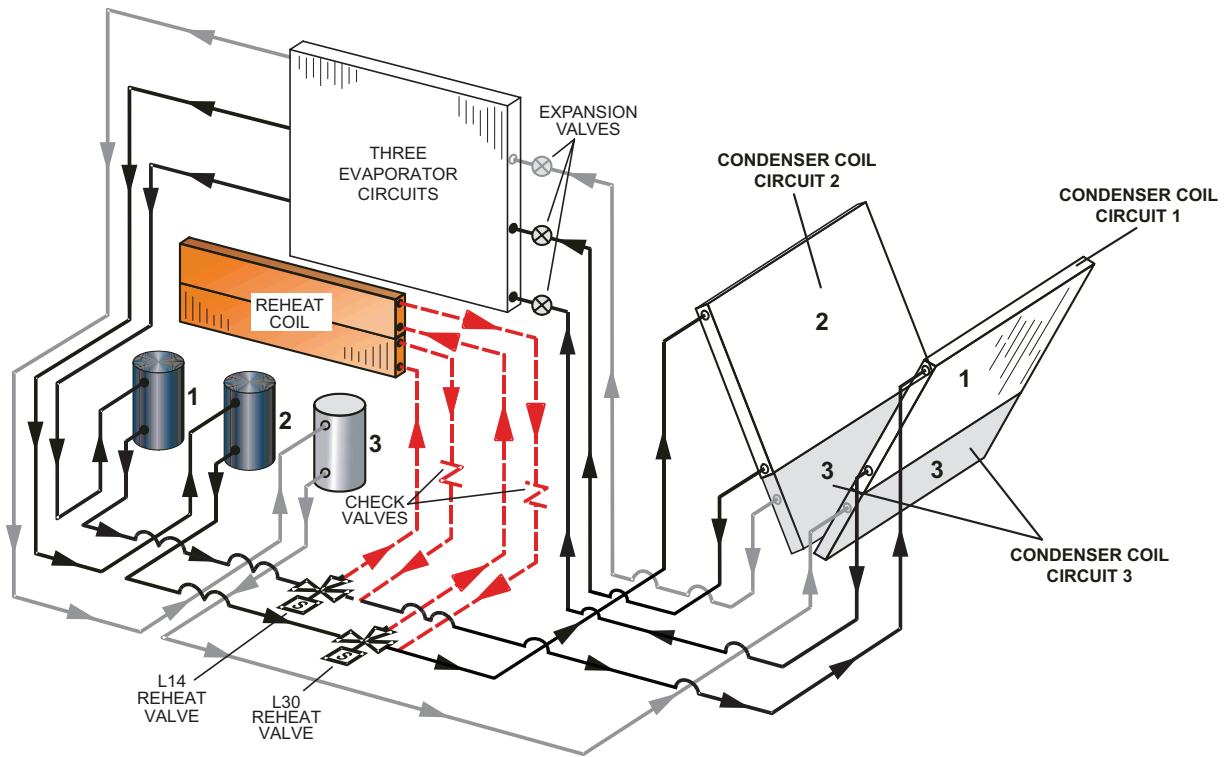


REFRIGERANT SCHEMATIC (300 MODELS ONLY)

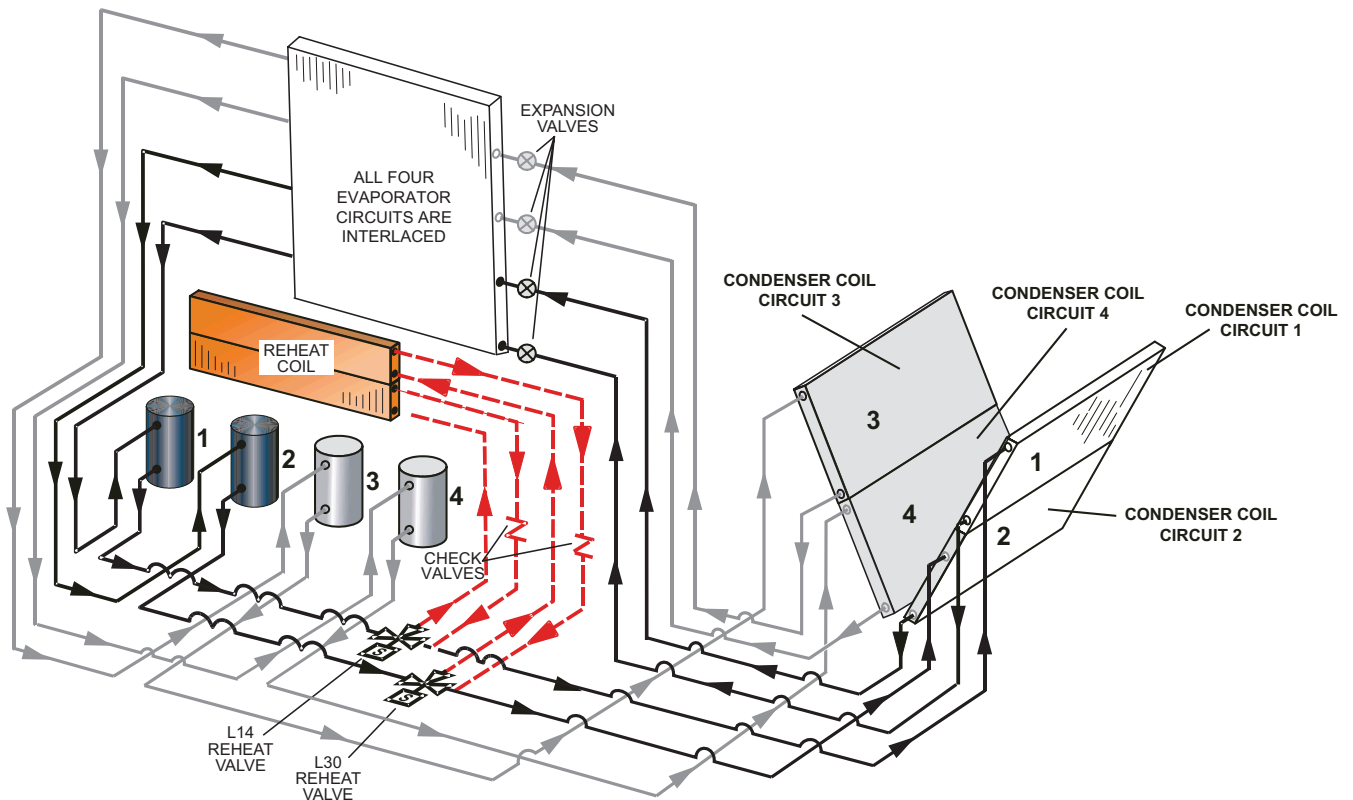

## OPTIONAL CONVENTIONAL TEMPERATURE CONTROL SYSTEMS

### CS8500 Commercial 7-Day Programmable Thermostat

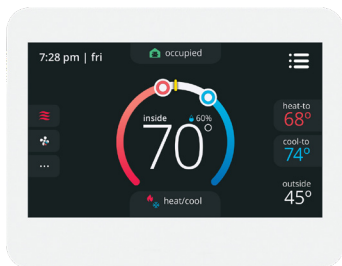


- Fully Communicating Sensor
- Full Color Touchscreen Interface
- Variable Speed System Control (On Compatible Units)
- Up To 4 Heat / 4 Cool
- Built-In Sensors For Temperature, Humidity And Optional CO<sub>2</sub>
- Remote Sensor Options For Occupancy, Temperature
- BACnet Capable Options
- 5-2 or 7-Day Scheduling
- Smooth Setback Recovery
- Heat/Cool Auto-Changeover
- Four-Wire Installation
- FDD, ASHRAE, IECC Compliant

### CS7500 Commercial 7-Day Programmable Thermostat



- Premium Universal Thermostat
- Full Color Touchscreen Interface
- Up To 4 Heat / 3 Cool
- Built-In Sensors For Temperature and Humidity
- Remote Sensors Options For Temperature, Discharge Air, Outdoor Air
- 5-2 or 7-Day Scheduling
- Smooth Setback Recovery
- Heat/Cool Auto-Changeover
- FDD, ASHRAE, IECC Compliant

### CS3000 Commercial 5-2 Day Programmable Thermostat

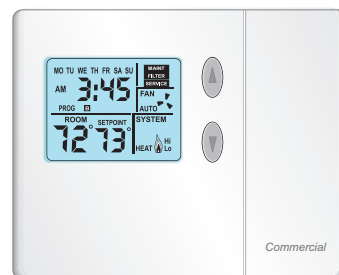

- Conventional Multi-Stage Thermostat
- Intuitive Display
- Push-Button Operation
- Up To 2 Heat / 2 Cool
- Built-In Temperature Sensor
- Remote Temperature Sensing
- Up to 5-2 Day Scheduling
- Smooth Setback Recovery
- Heat/Cool Auto-changeover



## OPTIONAL CONVENTIONAL TEMPERATURE CONTROL SYSTEMS

Description		Order Number
<b>CS8500 Commercial 7 Day Programmable Thermostat</b>		
CS8500 7-Day Thermostat	No CO <sub>2</sub> Sensing	<b>24K55</b>
	With CO <sub>2</sub> Sensing	<b>24K53</b>
Sensors/Accessories	<sup>1</sup> Remote non-adjustable wall-mount 10k	<b>47W37</b>
	<sup>1</sup> Remote non-adjustable wall-mount 11k	<b>94L61</b>
<b>Sysbus Network Cable (Yellow) for CS8500 and LCS-5030 Wired Room Sensor</b>		
Twisted pair 100% shielded communication cable, Red and Black 22 AWG, yellow jacket, rated at 75°C, 300V, Plenum rated Insulation - Low smoke PVC, NEC, CMP	500 ft. box	<b>27M19</b>
	1000 ft. box	<b>94L63</b>
	2500 ft. roll	<b>68M25</b>
<b>CS7500 Commercial 7-Day Programmable Thermostat</b>		
CS7500 7-Day Thermostat		<b>24K41</b>
Sensors/Accessories	<sup>2</sup> Remote non-adjustable wall-mount 20k	<b>47W36</b>
	<sup>2</sup> Remote non-adjustable wall-mount 10k	<b>47W37</b>
	Remote non-adjustable discharge air (duct mount)	<b>19L22</b>
	Outdoor temperature sensor	<b>X2658</b>
<b>CS3000 Commercial 5-2 Day Programmable Thermostat</b>		
CS3000 5-2 Day Thermostat		<b>11Y05</b>
Sensors/Accessories	Remote non-adjustable wall mount 10k averaging	<b>47W37</b>
	Thermostat wall mounting plate	<b>X2659</b>
<b>Universal Thermostat Guard with Lock (clear)</b>		
	Inside Dimensions (H x W x D) 5-7/8 x 8-3/8 x 3 in.	<b>39P21</b>

<sup>1</sup> Up to nine of the same type remote temperature sensors can be connected in parallel.

<sup>2</sup> Remote wall-mount sensors can be applied in any of the following combinations:  
 One Sensor - (1) 47W36, Two Sensors - (2) 47W37, Three Sensors - (2) 47W36 and (1) 47W37  
 Four Sensors - (4) 47W36, Five Sensors - (3) 47W36 and (2) 47W37

**180/210/240/300 MODELS (3 AND 4 COMPRESSORS)****UNIT OPERATION WITH 2-STAGE THERMOSTAT (2 COOLING STAGES, Y1, Y2)****SUPPLY AIR BLOWER SPEED**

Unit has following supply air blower speed setting:

- Ventilation speed
- Cooling Speed - Low
- Cooling Speed - High
- Heating Speed
- Smoke Speed (Using only in smoke removal option - not discussed)

**COOLING****<sup>1</sup> Unit Features and Economizer and Outdoor Air is Suitable****Thermostat Mode (Y1, Y2)Y1 Demand:**

All compressors are off, supply air blower is on low cooling speed to minimize blower power consumption, economizer modulates (minimum to maximum open position) to maintain 55°F supply air temperature (default unit controller setting).

**Y2 Demand:**

All compressors are off, supply air blower is on high cooling speed providing higher cooling capacity, and economizer modulates to maintain 55°F supply air temperature. If economizer stays at maximum open for 3 minutes, 1st stage compressors (compressor 1 and 2) are energized while supply air blower stays on high cooling speed providing maximum cooling capacity.

<sup>1</sup> Outdoor air suitability is determined by the energy state of outdoor ambient (enthalpy or sensible) and its ability to achieve the desired free cooling effects. Outdoor air suitability can also be determined by a third party controller and provided to the rooftop unit via a network connection.

**Unit Does Not Feature An Economizer Or Outdoor Air Is Not Suitable****Thermostat Mode (Y1, Y2)****Y1 Demand:**

1st stage compressors 1 & 2 operate and supply air blower operates at low cooling speed.

**Y2 Demand:**

All compressors operate and supply air blower operates at high cooling speed.

**Dehumidification Mode**

If a unit with Dehumidification Option receives a call for dehumidification, economizer free cooling is locked out.

**Call For Dehumidification, No Y1, Y2 Demand:**

1st stage compressors (1 & 2) operate, supply air blower operates at low cooling speed, and the reheat valves are energized.

**Y1 Demand With A Call For Dehumidification:**

All compressors operate, supply air blower operates at high cooling speed and the reheat valves are energized.

**Y2 Demand With A Call For Dehumidification:**

All compressors operate, supply air blower operates at high cooling speed, and the reheat valves are de-energized.

**180/210/240/300 MODELS (3 AND 4 COMPRESSORS)****ZONE SENSOR****SUPPLY AIR BLOWER SPEED**

Unit has following supply air blower speed setting:

- Ventilation speed
- Cooling Speed - Low
- Cooling Speed - High
- Heating Speed
- Smoke Speed (Using only in smoke removal option - not discussed)

**COOLING****<sup>1</sup> Unit Features and Economizer and Outdoor Air is Suitable****3 Compressor Units****Y1 Demand:**

All compressors are off, supply air blower is on low cooling speed to minimize blower power consumption, economizer modulates (minimum to maximum open position) to maintain 55°F supply air temperature (default unit controller setting).

**Y2 Demand:**

All compressors are off, supply air blower is on high cooling speed providing higher cooling capacity, economizer modulates (minimum to maximum open position) to maintain 55°F supply air temperature (default unit controller setting).

If economizer stays at maximum open for 3 minutes then compressor 1 is energized while supply air blower stays on high cooling speed. After compressor is energized the economizer stays at maximum open.

**Y3 Demand:**

Compressors 1 and 2 are energized while supply air blower stays on high cooling speed. After compressors are energized the economizer stays at maximum.

**Y4 Demand:**

All compressors are energized and supply air blower stays on high cooling speed.

**4 Compressor Units****Y1 Demand:**

All compressors are off, supply air blower is on low cooling speed to minimize blower power consumption, economizer modulates (minimum to maximum open position) to maintain 55°F supply air temperature (default unit controller setting).

**Y2 Demand:**

All compressors are off, supply air blower is on high cooling speed providing higher cooling capacity, economizer modulates (minimum to maximum open position) to maintain 55°F supply air temperature (default unit controller setting).

If economizer stays at maximum open for 3 minutes then compressors 1 and 2 are energized while supply air blower stays on high cooling speed. After compressors are energized the economizer stays at maximum open.

**Y3 Demand:**

Compressors 1, 2 and 3 are energized and supply air blower stays on high cooling speed.

**Y4 Demand (Zone Sensor Only):**

All compressors are energized and supply air blower stays on high cooling speed.

<sup>1</sup> Outdoor air suitability is determined by the energy state of outdoor ambient (enthalpy or sensible) and its ability to achieve the desired free cooling effects. Outdoor air suitability can also be determined by a third party controller and provided to the rooftop unit via a network connection.

**Dehumidification Mode**

If a unit with Dehumidification Option receives a call for dehumidification, economizer free cooling is locked out.

**Call For Dehumidification, No Y1, Y2, Y3 Demand:**

Compressor 1 and 2 operate, supply air blower operates at low cooling speed, and both reheat valves are energized.

**Y1 Demand With A Call For Dehumidification:**

All compressors operate, supply air blower operates at high cooling speed and both reheat valves are energized.

**Y2 Demand With A Call For Dehumidification:**

All compressors operate, supply air blower operates at high cooling speed, and the reheat valve of refrigeration circuit 1 is energized while the reheat valve of refrigeration circuit 2 is de-energized.

**Y3 or Y4 (Zone Sensor Only) Demand:**

All compressors operate, supply air blower operates at high cooling speed, and both reheat valves are de-energized.

**Heating Mode (Gas Heat)**

*NOTE – HEATING MODE CAN BE SET TO TWO-STAGE IN THERMOSTAT MODE OR AT FOUR-STAGE IN ROOM SENSOR MODE CONTROL OPTIONS.*

**Two-Stage Operation (Thermostat Mode)****W1 Demand:**

Both gas valves are open on Low Fire (stage 1 on units with 2-stage gas valves) and supply air blower operates at heating speed

**W2 Demand:**

Both gas valves are open on High Fire (stage 2 on units with 2-stage gas valves) and supply air blower operates at heating speed

**Four-Stage Operation (Room Sensor Mode)****W1 Demand:**

Left heat exchanger gas valve is open on Low Fire (stage 1 on units with 4-stage gas valves) and supply air blower operates at heating speed.

**W2 Demand:**

Both gas valves are open on Low Fire (stage 2 on units with 4-stage gas valves) and supply air blower operates at heating speed.

**W3 Demand:**

Left heat exchanger gas valve will open on High Fire and the right heat exchanger will remain open on Low Fire (stage 3 on units with 4-stage gas valves) and supply air blower operates at heating speed.

**W4 Demand:**

Both gas valves are open on High Fire (stage 4 on units with 4-stage gas valves) and supply air blower operates at heating speed.

**Modulating Outdoor Air Damper**

The minimum damper position for “occupied low blower” and “occupied high blower” is adjusted during unit setup to provide minimum fresh air requirements per ASHRAE 62.1 at the corresponding supply air blower speeds.

- When supply air blower is off or the unit is in unoccupied mode, the outdoor air damper is closed.
- When unit is in occupied mode and supply air blower is operating at a speed below the “midpoint” blower speed, the outdoor air damper is at minimum “low blower” position.
- When unit is in occupied mode and supply air blower is operating at a speed equal to or above the “midpoint” blower speed, the outdoor air damper is at minimum “high blower” position.

*NOTE - The “midpoint” blower speed is an average of the minimum and maximum blower speed (minimum speed + maximum speed divided by 2).*

**Power Exhaust Operation**

*NOTE - POWER EXHAUST OPERATION IS THE SAME FOR ALL CONTROL OPTIONS*

Single Zone VAV Supply Fan models are equipped with 2-stage power exhaust fans. Power exhaust fans operate when economizer outdoor air dampers are 50% open (adjustable). Power exhaust operates in 1st stage (one fan) up to 70% of supply air blower speed. 2nd stage power exhaust fans (both fans) operate when supply air blower speed is above 70% (adjustable) of full speed.

## OPTIONS / ACCESSORIES

Item Description			Order Number	Size			
				180	210	240	300
COOLING SYSTEM							
Condensate Drain Trap	PVC	22H54	X	X	X	X	
	Copper	76W27	X	X	X	X	
Drain Pan Overflow Switch		21Z07	X	X	X	X	
Low Ambient Kits (0°F)		37G59	X	X			
		37G60			X		
		37G63				X	
HEATING SYSTEM							
Bottom Gas Piping Kit		85M31	X	X	X	X	
Combustion Air Intake Extensions (order two)		89L97	X	X	X	X	
Gas Heat Input	Standard - 260,000 Btuh	Factory	O	O	O	O	
	Medium - 360,000 Btuh	Factory	O	O	O	O	
	High - 480,000 Btuh	Factory	O	O	O	O	
Low Temperature Vestibule Heater	208/230V-3ph	37G86	X	X	X	X	
	460V	37G90	X	X	X	X	
	575V	37G92	X	X	X	X	
LPG/Propane Conversion Kits (Order 2 kits)	Standard heat	14N28	X	X	X	X	
	Medium heat	14N29	X	X	X	X	
	High heat	14N30	X	X	X	X	
Stainless Steel Heat Exchanger		Factory	O	O	O	O	
Vertical Vent Extension Kit		42W16	X	X	X	X	
BLOWER - SUPPLY AIR							
Blower Motors	Belt Drive - 3 hp	Factory	O	O			
	Belt Drive - 5 hp	Factory	O	O	O	O	
	Belt Drive - 7.5 hp	Factory	O	O	O	O	
	Belt Drive - 10 hp	Factory			O	O	
VFD Bypass Kit	3, 5, 7.5 HP - No Overload	37G64	X	X	X	X	
	10 HP - With Overload	37G65			X	X	
Drive Kits	Kit #1 535-725 rpm	Factory	O	O			
See Blower Data Tables for usage and selection	Kit #2 710-965 rpm	Factory	O	O			
	Kit #3 685-856 rpm	Factory	O	O	O	O	
	Kit #4 850-1045 rpm	Factory	O	O	O	O	
	Kit #5 945-1185 rpm	Factory	O	O	O	O	
	Kit #6 850-1045 rpm	Factory	O	O	O	O	
	Kit #7 945-1185 rpm	Factory	O	O	O	O	
	Kit #8 1045-1285 rpm	Factory	O	O	O	O	
	Kit #10 1045-1285 rpm	Factory			O	O	
	Kit #11 1135-1330 rpm	Factory			O	O	
	Blower Belt Auto-Tensioner	24B80	X	X	X	X	
DEHUMIDIFICATION REHEAT OPTION							
Dehumidification Option		Factory	O	O	O	O	

NOTE - Order numbers shown are for ordering field installed accessories.

OX - Configure To Order (Factory Installed) or Field Installed

O = Configure To Order (Factory Installed)

X = Field Installed



## OPTIONS / ACCESSORIES

Item Description		Order Number	Size				
			180	210	240	300	
CABINET							
Combination Coil/Hail Guards		23U69	X	X			
		23U71			X	X	
Hinged Access Panels		Factory	O	O	O	O	
CONTROLS							
NOTE - Also see Conventional Thermostat Control Systems page 14 for Additional Options.							
BACnet® MS/TP Module		38B35	X	X	X	X	
Dirty Filter Switch		53W68	X	X	X	X	
Smoke Detector - Supply or Return (Power board and one sensor)		37G73	X	X	X	X	
Smoke Detector - Supply and Return (Power board and two sensors)		37G74	X	X	X	X	
ELECTRICAL							
Voltage 60 Hz		208/230V - 3 phase	Factory	O	O	O	O
		460V - 3 phase	Factory	O	O	O	O
		575V - 3 phase	Factory	O	O	O	O
Disconnect Switch (see Disconnect Table for usage, page 35)		80 amp	54W88	OX	OX	OX	OX
		150 amp	54W89	OX	OX	OX	OX
		250 amp	90W82				OX
GFI Service Outlets		15 amp non-powered, field-wired (208/230V, 460V only)	74M70	X	X	X	X
		1 20 amp non-powered, field-wired (208/230V, 460V, 575V)	67E01	X	X	X	X
Weatherproof Cover for GFI		10C89	X	X	X	X	
INDOOR AIR QUALITY							
Air Filters							
High Efficiency Air Filters 24 x 24 x 2 in. (Order 6 per unit)		MERV 8	54W67	X	X	X	X
		MERV 13	52W40	X	X	X	X
Replacement Media Filter With Metal Mesh Frame (includes non-pleated filter media)		44N61	X	X	X	X	
Indoor Air Quality (CO2) Sensors							
Sensor - Wall-mount, off-white plastic cover with LCD display		77N39	X	X	X	X	
Sensor - Wall-mount, off-white plastic cover, no display		23V86	X	X	X	X	
Sensor - Black plastic case, LCD display, rated for plenum mounting		87N52	X	X	X	X	
Sensor - Black plastic case, no display, rated for plenum mounting		23V87	X	X	X	X	
CO2 Sensor Duct Mounting Kit - for downflow applications		23Y47	X	X	X	X	
Aspiration Box - for duct mounting non-plenum rated CO2 sensors (77N39)		90N43	X	X	X	X	

<sup>1</sup> Canada requires a minimum 20 amp circuit. Select 20 amp, non-powered, field wired GFI.

<sup>2</sup>

NOTE - Order numbers shown are for ordering field installed accessories.

OX - Configure To Order (Factory Installed) or Field Installed

O = Configure To Order (Factory Installed)

X = Field Installed

## OPTIONS / ACCESSORIES

Item Description	Order Number	Size			
		180	210	240	300
ECONOMIZER					
High Performance Economizer (Approved for California Title 24 Building Standards AMCA Class 1A Certified)					
High Performance Economizer (Downflow or Horizontal) Includes Economizer Dampers with Outdoor Air Hood Downflow Applications - Use furnished Outdoor Air Hood - Order Downflow Barometric Relief Dampers with Exhaust Hood separately Horizontal Applications - Use furnished Outdoor Air Hood - Order Horizontal Barometric Relief Dampers with Exhaust Hood separately	22J18	OX	OX	OX	OX
Economizer Controls					
Differential Enthalpy (Not for Title 24)	Order 2 21Z09	X	X	X	X
Sensible Control	Sensor is Furnished Factory	O	O	O	O
Single Enthalpy (Not for Title 24)	21Z09	OX	OX	OX	OX
Barometric Relief Dampers With Exhaust Hood					
Downflow Barometric Relief Dampers	54W78	OX	OX	OX	OX
Horizontal Barometric Relief Dampers	16K99	X	X	X	X
OUTDOOR AIR					
Outdoor Air Dampers With Outdoor Air Hood					
Motorized	22J27	X	X	X	X
Manual	13U05	X	X	X	X
³ POWER EXHAUST (DOWNFLOW APPLICATIONS ONLY)					
Standard Static	208/230V 22H90	X	X	X	X
	460V 22H91	X	X	X	X
	575V 22V34	X	X	X	X

<sup>3</sup> Field installed Power Exhaust requires Economizer with Outdoor Air Hood and Downflow Barometric Relief Dampers with Exhaust Hood. Must be ordered separately.

NOTE - Order numbers shown are for ordering field installed accessories.

OX - Configure To Order (Factory Installed) or Field Installed

O = Configure To Order (Factory Installed)

X = Field Installed

## OPTIONS / ACCESSORIES

Item Description		Order Number	Size			
			180	210	240	300
ROOF CURBS						
Hybrid Roof Curbs, Downflow						
8 in. height		11F58	X	X	X	X
14 in. height		11F59	X	X	X	X
18 in. height		11F60	X	X	X	X
24 in. height		11F61	X	X	X	X
Adjustable Pitch Curb						
14 in. height		43W26	X	X	X	X
Standard Roof Curbs, Horizontal - Requires Horizontal Return Air Panel Kit						
26 in. height - slab applications		11T89	X	X	X	
30 in. height - slab applications		11T90				X
37 in. height - rooftop applications		11T96	X	X	X	
41 in. height - rooftop applications		11T97				X
Insulation Kit For Standard Horizontal Curbs						
For 26 in. Curb		73K32	X	X	X	
For 30 in. Curb		73K33				X
For 37 in. Curb		73K34	X	X	X	
For 41 in. Curb		73K35				X
Horizontal Return Air Panel Kit						
Required for Horizontal Applications with Roof Curb		87M00	X	X	X	X
CEILING DIFFUSERS						
Step-Down - Order one	RTD11-185S	13K63	X			
	RTD11-275S	13K64		X	X	X
Flush - Order one	FD11-185S	13K58	X			
	FD11-275S	13K59		X	X	X
Transitions (Supply and Return) - Order one	C1DIFF33C-1	12X68	X			
	C1DIFF34C-1	12X70		X	X	X

NOTE - Order numbers shown are for ordering field installed accessories.

OX - Configure To Order (Factory Installed) or Field Installed

O = Configure To Order (Factory Installed)

X = Field Installed

SPECIFICATIONS			UNIT			
Model			LGX180S5M	LGX210S5M	LGX240S5M	LGX300S5M
Nominal Tonnage			15 Ton	17.5 Ton	20 Ton	25 Ton
Efficiency Type			Standard	Standard	Standard	Standard
Blower Type			Single Zone VAV Supply Fan	Single Zone VAV Supply Fan	Single Zone VAV Supply Fan	Single Zone VAV Supply Fan
Cooling Performance	Gross Cooling Capacity - Btuh		178,000	206,000	236,000	282,000
	<sup>1</sup> Net Cooling Capacity - Btuh		172,000	200,000	228,000	270,000
	<sup>1</sup> AHRI Rated Air Flow - cfm		7200	6150	7100	7450
	<sup>1</sup> IEER (Btuh/Watt)		14.0	14.0	14.0	13.0
	<sup>1</sup> EER (Btuh/Watt)		10.8	10.8	10.8	9.8
	Total Unit Power - kW		15.9	18.5	21.1	27.6
Sound Rating Number dBA			86	86	93	94
Refrigerant Refrigerant Type			R-454B	R-454B	R-454B	R-454B
Charge	Without Reheat Option	Circuit 1	6 lbs. 11 oz.	6 lbs. 6 oz.	7 lbs. 4 oz.	5 lbs. 15 oz.
		Circuit 2	5 lbs. 3 oz.	6 lbs. 2 oz.	7 lbs. 2 oz.	5 lbs. 8 oz.
		Circuit 3	5 lbs. 5 oz.	7 lbs. 13 oz.	6 lbs. 15 oz.	5 lbs. 5 oz.
		Circuit 4	- - -	- - -	- - -	5 lbs. 6 oz.
	With Reheat Option	Circuit 1	6 lbs. 4 oz.	6 lbs. 4 oz.	7 lbs. 10 oz.	6 lbs. 15 oz.
		Circuit 2	6 lbs. 0 oz.	6 lbs. 4 oz.	7 lbs. 4 oz.	6 lbs. 5 oz.
		Circuit 3	5 lbs. 12 oz.	5 lbs. 15 oz.	6 lbs. 15 oz.	4 lbs. 11 oz.
		Circuit 4	- - -	- - -	- - -	5 lbs. 3 oz.
Gas Heat Available			See page 22			
Compressor Type (number)			Scroll (3)	Scroll (3)	Scroll (3)	Scroll (4)
Outdoor Coils	Net face area - ft. <sup>2</sup> (total)		41.1	41.1	55.0	55.0
	Rows		1	1	1	1
	Fins - in.		23	23	23	23
Outdoor Coil Fans	Motor HP (number and type)		1/3 (3 PSC)	1/3 (3 PSC)	1/3 (4 PSC)	1/3 (6 PSC)
	Rpm		1075	1075	1075	1075
	Watts		1100	1100	1665	1950
	Diameter - (No.) in.		(3) 24	(3) 24	(4) 24	(6) 24
	Blades		3	3	3	3
	Total Air volume - cfm		12,000	12,000	16,000	20,000
	Indoor Coils	Net face area - ft. <sup>2</sup> (total)		21.4	21.4	21.4
Tube diameter - in.		3/8	3/8	3/8	3/8	
Rows		3	4	4	4	
Fins - in.		14	14	14	14	
Condensate drain size (NPT) - in.		(1) 1	(1) 1	(1) 1	(1) 1	
Expansion device type		Balanced Port Thermostatic Expansion Valve, removable element head				
<sup>2</sup> Indoor Blower and Drive Selection	Nominal motor HP		3, 5, 7.5		5, 7.5, 10	
	Maximum usable motor HP (US)		3.45, 5.75, 8.62		5.75, 8.62, 11.5	
	Motor - Drive kit number		3 HP		5 HP	
			Kit 1 535-725 rpm		Kit 3 685-856 rpm	
			Kit 2 710-965 rpm		Kit 4 850-1045 rpm	
			5 HP		Kit 5 945-1185 rpm	
			Kit 3 685-856 rpm		7.5 HP	
			Kit 4 850-1045 rpm		Kit 6 850-1045 rpm	
			Kit 5 945-1185 rpm		Kit 7 945-1185 rpm	
			7.5 HP		Kit 8 1045-1285 rpm	
		Kit 6 850-1045 rpm		10 HP		
		Kit 7 945-1185 rpm		Kit 7 945-1185 rpm		
		Kit 8 1045-1285 rpm		Kit 10 1045-1285 rpm		
				Kit 11 1135-1330 rpm		
Wheel (Number) diameter x width - in.			(2) 15 x 15			
Filters Type of filter			MERV 4, Disposable			
Number and size - in.			(6) 24 x 24 x 2			
Line voltage data (Volts-Phase-Hz)			208/230-3-60 460-3-60 575-3-60			

NOTE - Net capacity includes evaporator blower motor heat deduction. Gross capacity does not include evaporator blower motor heat deduction.

<sup>1</sup> AHRI Certified to AHRI Standard 340/360; 95°F outdoor air temperature and 80°F db/67°F wb entering evaporator air; minimum external duct static pressure.

<sup>2</sup> Using total air volume and system static pressure requirements determine from blower performance tables rpm and motor output required. Maximum usable output of motors furnished are shown. In Canada, nominal motor output is also maximum usable motor output. If motors of comparable output are used, be sure to keep within the service factor limitations outlined on the motor nameplate.

NOTE - Motor service factor limit - 1.0.

SPECIFICATIONS			GAS HEAT		
Heat Input Type			Standard (S)	Medium (M)	High (H)
Number of Gas Heat Stages			<sup>1</sup> Two	<sup>1</sup> Two	<sup>1</sup> Two
<sup>1</sup> Gas Heating Performance	Input - Btuh	First Stage	85,000	117,000	156,000
		Second Stage	169,000	234,000	312,000
		Third Stage	214,000	297,000	396,000
		Fourth Stage	260,000	360,000	480,000
	Output - Btuh	First Stage	---	---	---
		Second Stage	---	---	---
		Third Stage	---	---	---
		Fourth Stage	211,000	292,000	389,000
Temperature Rise Range - °F		First Stage	15-45	30-60	40-70
		Second Stage	---	---	---
Minimum Air Volume - cfm			4500	4500	5125
Thermal Efficiency			81%	81%	81%
Gas Supply Connections			1 in. NPT	1 in. NPT	1 in. NPT
Recommended Gas Supply Pressure - in. w.g.		Natural	7	7	7
		LPG/Propane	11	11	11
Gas Supply Pressure Range		Min./Max. (Natural)	4.7 - 10.5 in. w.g.		
		Min./Max. (LPG)	10.8 - 13.5 in. w.g.		

<sup>1</sup> Two-stage heat models can be operated with four stages of gas heating when controlled in either zone sensor, Discharge Air Control, or fresh air tempering mode on the Intelli-Guide™ unit controller.

## HIGH ALTITUDE DERATE

**NOTE** - Units may be installed at altitudes up to 2000 feet above sea level without any modification.

At altitudes above 2000 feet, units must be derated to match gas manifold pressures shown in table below.

At altitudes above 4500 feet units must be derated 4% for each 1000 feet above sea level.

**NOTE** - This is the only permissible derate for these units.

Refer to the Installation Instructions for more detailed information.

### ONE STAGE HEAT

No Adjustment Required

### TWO STAGE HEAT

Heat Input Type	Altitude Feet	Gas Manifold Pressure - in. w.g.		Input Rate (Btuh)	
		Natural Gas	LPG/Propane Gas	First Stage	Second Stage
Standard (2 stage)	2001 - 4500	1.6 / 3.1	4.4 / 8.9	169,000	239,000
Medium (2 stage)	2001 - 4500	1.6 / 3.1	4.4 / 8.9	234,000	331,000
High (2 stage)	2001 - 4500	1.6 / 3.1	4.4 / 8.9	312,000	442,000

### FOUR STAGE HEAT

<sup>1</sup> Heat Input Type	Altitude Feet	Gas Manifold Pressure - in. w.g.		Input Rate (Btuh)			
		Natural Gas	LPG/Propane Gas	First Stage	Second Stage	Third Stage	Fourth Stage
Standard (4 stage)	2001 - 4500	1.6 / 3.1	4.4 / 8.9	85,000	169,000	204,000	239,000
Medium (4 stage)	2001 - 4500	1.6 / 3.1	4.4 / 8.9	117,000	234,000	283,000	331,000
High (4 stage)	2001 - 4500	1.6 / 3.1	4.4 / 8.9	156,000	312,000	377,000	442,000

<sup>1</sup> Four-Stage Gas Heating is field configured.

## RATINGS

NOTE - For Temperatures and Capacities not shown in tables, see bulletin - Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

### 15 TON - LGX180S5M (PART LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	3500	120.2	4.95	0.76	0.85	0.95	113.2	5.79	0.77	0.86	0.96	106.7	6.65	0.77	0.87	0.97	100.3	7.55	0.77	0.88	0.97
	4000	124.1	4.96	0.78	0.88	0.97	117.6	5.81	0.78	0.89	0.98	111	6.66	0.79	0.9	0.98	104.2	7.57	0.79	0.91	0.99
	4500	128	4.98	0.8	0.9	0.98	121.4	5.82	0.8	0.91	0.99	114.5	6.67	0.81	0.93	1	107.5	7.58	0.81	0.94	1
67°F	3500	125.7	4.97	0.66	0.75	0.83	119.3	5.82	0.65	0.75	0.83	112.8	6.67	0.65	0.75	0.84	105.7	7.57	0.65	0.75	0.86
	4000	130.6	4.98	0.67	0.76	0.85	124	5.83	0.66	0.77	0.86	117.1	6.68	0.66	0.77	0.88	109.3	7.58	0.66	0.78	0.88
	4500	134.5	4.99	0.68	0.78	0.88	127.7	5.84	0.68	0.79	0.89	120.6	6.69	0.67	0.79	0.9	112.8	7.6	0.67	0.8	0.92
71°F	3500	132.2	4.99	0.55	0.64	0.73	125.7	5.83	0.54	0.64	0.73	118.9	6.69	0.53	0.64	0.74	111.7	7.59	0.53	0.64	0.74
	4000	136.9	5	0.55	0.66	0.75	130.1	5.85	0.55	0.66	0.75	122.9	6.7	0.54	0.65	0.76	115	7.61	0.54	0.65	0.76
	4500	140.7	5.01	0.56	0.67	0.77	134	5.86	0.56	0.67	0.77	126.3	6.71	0.55	0.67	0.78	119.6	7.62	0.54	0.66	0.78

### 15 TON - LGX180S5M (FULL LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		85°F					95°F					105°F					115°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	4800	169.2	9.86	0.71	0.86	0.99	158.5	11.19	0.72	0.87	1	146.9	12.64	0.73	0.89	1	134.6	14.29	0.74	0.92	1
	6000	178.3	9.9	0.77	0.93	1	166.2	11.22	0.78	0.95	1	154.2	12.67	0.79	0.98	1	142.6	14.33	0.81	1	1
	7200	185.8	9.92	0.82	0.99	1	174.2	11.25	0.83	1	1	162.8	12.71	0.86	1	1	150.9	14.36	0.88	1	1
67°F	4800	181	9.91	0.55	0.69	0.82	169.1	11.23	0.55	0.7	0.84	157.5	12.69	0.55	0.7	0.86	144.9	14.34	0.55	0.72	0.88
	6000	189.9	9.94	0.59	0.74	0.9	177.9	11.27	0.59	0.76	0.92	165.1	12.72	0.59	0.77	0.94	152.1	14.36	0.59	0.79	0.97
	7200	196.7	9.96	0.62	0.8	0.96	183.6	11.29	0.62	0.82	0.99	170.5	12.74	0.63	0.84	1	156.6	14.38	0.64	0.86	1
71°F	4800	192.4	9.95	0.41	0.54	0.67	180.7	11.28	0.4	0.54	0.67	167.5	12.73	0.39	0.54	0.68	154.9	14.37	0.37	0.54	0.7
	6000	201.5	9.98	0.42	0.58	0.72	189	11.31	0.41	0.58	0.74	176.2	12.76	0.4	0.58	0.75	162.3	14.4	0.4	0.59	0.77
	7200	208.3	10	0.43	0.61	0.78	195.4	11.33	0.43	0.62	0.8	181.7	12.78	0.42	0.63	0.82	167.8	14.42	0.42	0.64	0.84

### 17.5 TON - LGX210S5M (PART LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	4000	153.4	6.42	0.79	0.87	0.96	146.7	7.31	0.79	0.88	0.97	140.1	8.31	0.8	0.89	0.97	131.8	9.41	0.8	0.9	0.98
	4750	160.5	6.49	0.81	0.9	0.98	153.3	7.39	0.81	0.91	0.99	145.3	8.37	0.82	0.93	0.99	138	9.49	0.83	0.94	1
	5500	165.9	6.55	0.83	0.94	1	158.6	7.45	0.84	0.95	1	150.2	8.44	0.84	0.96	1	142.3	9.55	0.86	0.97	1
67°F	4000	161.7	6.51	0.69	0.77	0.85	154.7	7.41	0.69	0.77	0.86	147.2	8.4	0.69	0.78	0.87	139.1	9.51	0.69	0.79	0.88
	4750	169	6.59	0.7	0.79	0.88	161.4	7.49	0.7	0.8	0.89	153.4	8.48	0.7	0.8	0.91	144.8	9.59	0.71	0.81	0.92
	5500	174.7	6.65	0.71	0.81	0.91	165.9	7.54	0.72	0.82	0.93	158.3	8.55	0.72	0.83	0.94	149.4	9.66	0.72	0.84	0.96
71°F	4000	169.5	6.59	0.59	0.68	0.75	162.5	7.5	0.59	0.68	0.76	154	8.49	0.59	0.68	0.76	146	9.61	0.58	0.68	0.77
	4750	177.3	6.68	0.6	0.69	0.78	168.7	7.58	0.6	0.69	0.78	160.7	8.58	0.59	0.69	0.79	152.6	9.71	0.59	0.7	0.8
	5500	182.7	6.75	0.6	0.7	0.8	174.1	7.65	0.6	0.71	0.81	165.5	8.65	0.6	0.71	0.82	156.7	9.77	0.6	0.72	0.83

### 17.5 TON - LGX210S5M (FULL LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		85°F					95°F					105°F					115°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	5600	210.4	12.57	0.72	0.86	0.99	200	14.27	0.72	0.87	1	186.4	16.17	0.74	0.9	1	174.5	18.41	0.75	0.92	1
	7000	221	12.73	0.77	0.94	1	209.3	14.41	0.78	0.95	1	196.1	16.33	0.8	0.98	1	183.9	18.58	0.82	1	1
	8400	231.1	12.88	0.83	0.99	1	218.5	14.56	0.84	1	1	206.5	16.51	0.87	1	1	193.7	18.76	0.89	1	1
67°F	5600	224.8	12.78	0.56	0.69	0.82	212.7	14.47	0.56	0.7	0.84	199.6	16.38	0.57	0.71	0.86	186.4	18.62	0.57	0.73	0.89
	7000	234.4	12.93	0.59	0.75	0.9	222	14.62	0.6	0.76	0.93	208.4	16.54	0.61	0.78	0.95	193.8	18.76	0.61	0.8	0.98
	8400	242.1	13.05	0.63	0.81	0.97	228.4	14.73	0.64	0.83	0.99	214.1	16.65	0.65	0.85	1	199.3	18.85	0.66	0.87	1
71°F	5600	238.7	12.99	0.42	0.55	0.67	226.3	14.69	0.41	0.55	0.68	212.3	16.61	0.41	0.55	0.69	198.3	18.83	0.4	0.56	0.71
	7000	248.9	13.16	0.43	0.59	0.73	235.3	14.85	0.43	0.59	0.74	221.1	16.77	0.43	0.6	0.76	206.5	18.99	0.43	0.61	0.78
	8400	256.4	13.28	0.45	0.62	0.79	242.5	14.97	0.45	0.63	0.81	227.9	16.89	0.45	0.64	0.83	211.9	19.08	0.45	0.65	0.85



## RATINGS

NOTE - For Temperatures and Capacities not shown in tables, see bulletin - Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

### 20 TON - LGX240S5M (PART LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
		cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F
63°F	4500	171	6.96	0.79	0.87	0.96	163.6	8.06	0.79	0.88	0.97	156.5	9.23	0.8	0.89	0.98	149.5	10.51	0.8	0.9	0.98
	5500	179.9	6.96	0.81	0.91	0.99	172.1	8.08	0.82	0.92	0.99	163.9	9.27	0.82	0.94	1	156.4	10.56	0.83	0.95	1
	6500	186.6	6.95	0.84	0.95	1	178.5	8.09	0.85	0.96	1	170.2	9.3	0.85	0.97	1	161.7	10.6	0.87	0.98	1
67°F	4500	180.3	6.96	0.69	0.77	0.85	172.9	8.08	0.69	0.77	0.86	164.8	9.28	0.69	0.78	0.87	157.5	10.57	0.69	0.79	0.88
	5500	189.8	6.95	0.7	0.79	0.89	181.8	8.1	0.7	0.8	0.9	172.7	9.32	0.71	0.81	0.91	164.4	10.63	0.71	0.82	0.92
	6500	196.7	6.94	0.72	0.82	0.92	187.8	8.11	0.72	0.83	0.94	179	9.34	0.73	0.84	0.95	169.9	10.66	0.73	0.85	0.96
71°F	4500	189.2	6.95	0.59	0.67	0.75	181.6	8.1	0.58	0.68	0.76	173.1	9.32	0.59	0.68	0.76	165.4	10.64	0.58	0.68	0.77
	5500	199.3	6.94	0.6	0.69	0.78	191	8.11	0.6	0.69	0.79	181.5	9.35	0.6	0.7	0.79	172.7	10.68	0.6	0.7	0.8
	6500	206.1	6.92	0.61	0.71	0.8	197.2	8.12	0.61	0.71	0.81	188.5	9.38	0.61	0.72	0.82	178.9	10.73	0.61	0.72	0.83

### 20 TON - LGX240S5M (FULL LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		85°F					95°F					105°F					115°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)							
				Dry Bulb					Dry Bulb					Dry Bulb							
				75°F	80°F	85°F			kBtuh	kW	75°F			80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	6400	238.6	14.89	0.71	0.85	0.98	225.8	16.88	0.72	0.87	1	213.7	19.09	0.73	0.89	1	200.8	21.55	0.75	0.91	1
	8000	250.9	14.97	0.77	0.93	1	237.4	17	0.78	0.95	1	224.1	19.22	0.8	0.97	1	211	21.69	0.82	0.99	1
	9600	260.2	15.04	0.82	0.99	1	247.4	17.1	0.84	1	1	235.4	19.36	0.86	1	1	222	21.85	0.88	1	1
67°F	6400	254.3	15	0.56	0.69	0.82	241.8	17.04	0.56	0.7	0.84	228.9	19.28	0.56	0.71	0.86	213.9	21.74	0.57	0.72	0.88
	8000	265.9	15.08	0.59	0.74	0.9	252.1	17.14	0.6	0.76	0.92	238.4	19.39	0.6	0.77	0.94	223.5	21.87	0.61	0.79	0.97
	9600	274.1	15.13	0.62	0.8	0.97	260	17.22	0.63	0.82	0.98	244.7	19.47	0.64	0.84	1	228.9	21.94	0.65	0.86	1
71°F	6400	270.3	15.11	0.42	0.54	0.67	256.8	17.19	0.41	0.54	0.68	243.1	19.45	0.41	0.55	0.69	228.2	21.93	0.4	0.56	0.7
	8000	282	15.18	0.43	0.58	0.72	268.1	17.29	0.43	0.58	0.74	253.4	19.56	0.43	0.59	0.75	237.6	22.05	0.43	0.6	0.77
	9600	290.4	15.24	0.44	0.61	0.78	275.4	17.35	0.44	0.62	0.8	260.3	19.63	0.45	0.63	0.82	243.7	22.12	0.45	0.65	0.84

### 25 TON - LGX300S5M (PART LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
				cfm	kBtuh	kW			75°F	80°F	85°F			kBtuh	kW	75°F			80°F	85°F	kBtuh
63°F	5750	166.6	6.25	0.77	0.92	1	159	7.15	0.78	0.94	1	150.9	8.15	0.79	0.95	1	142.4	9.28	0.8	0.97	1
	6750	172.5	6.29	0.81	0.97	1	164.7	7.2	0.82	0.98	1	156.3	8.2	0.84	0.99	1	148.1	9.33	0.85	1	1
	7750	177.4	6.33	0.84	0.99	1	169.8	7.24	0.86	1	1	161.2	8.25	0.88	1	1	152.6	9.38	0.9	1	1
67°F	5750	176.7	6.32	0.6	0.75	0.89	168.5	7.23	0.61	0.76	0.91	158.9	8.22	0.61	0.78	0.93	149.9	9.35	0.62	0.79	0.95
	6750	181.2	6.36	0.63	0.79	0.94	172.6	7.27	0.63	0.8	0.96	163.1	8.26	0.64	0.82	0.98	153.9	9.4	0.65	0.83	0.99
	7750	185	6.38	0.65	0.83	0.98	175.6	7.29	0.66	0.84	0.99	166.3	8.29	0.66	0.86	1	156.6	9.43	0.67	0.88	1
71°F	5750	185.1	6.38	0.45	0.59	0.73	176	7.29	0.45	0.6	0.74	167.2	8.3	0.45	0.61	0.76	158.2	9.44	0.44	0.61	0.77
	6750	190.4	6.43	0.46	0.62	0.77	181.2	7.34	0.46	0.63	0.78	172.2	8.35	0.46	0.63	0.8	162.4	9.49	0.46	0.64	0.82
	7750	194.9	6.47	0.48	0.64	0.81	185.1	7.38	0.47	0.65	0.82	175.6	8.39	0.47	0.66	0.84	165.2	9.53	0.47	0.67	0.86

### 25 TON - LGX300S5M (FULL LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		85°F					95°F					105°F					115°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
				cfm	kBtuh	kW			75°F	80°F	85°F			kBtuh	kW	75°F			80°F	85°F	kBtuh
63°F	8000	294.6	17.45	0.75	0.83	0.94	278.2	19.93	0.71	0.85	0.95	262.2	22.71	0.72	0.85	0.97	243.7	25.97	0.73	0.87	0.99
	9500	307.6	17.53	0.75	0.87	0.98	290.3	19.94	0.76	0.89	0.99	272.8	22.69	0.78	0.91	1	254.7	25.91	0.78	0.92	1
	11000	317.2	17.58	0.79	0.91	1	298.8	20.02	0.79	0.93	1	281.3	22.78	0.81	0.95	1	263.6	26.03	0.82	0.97	1
67°F	8000	309.2	17.64	0.53	0.68	0.81	291	19.91	0.54	0.68	0.82	273.3	22.7	0.53	0.69	0.83	254.3	26.19	0.54	0.7	0.84
	9500	319.2	17.69	0.57	0.72	0.85	301.7	20.16	0.57	0.73	0.86	283	22.76	0.57	0.75	0.88	262.5	25.98	0.55	0.77	0.9
	11000	328.7	17.74	0.57	0.76	0.89	309.9	20.19	0.58	0.78	0.91	290.4	22.86	0.58	0.8	0.93	271.1	26.07	0.59	0.8	0.95
71°F	8000	329.8	17.77	0.39	0.52	0.65	311.8	20.21	0.38	0.52	0.65	292.3	22.89	0.38	0.53	0.67	271.7	26.07	0.37	0.52	0.69
	9500	340.7	17.82	0.4	0.55	0.69	321.5	20.31	0.39	0.56	0.71	301.3	23.03	0.39	0.55	0.72	280	26.16	0.39	0.56	0.74
	11000	348.5	17.79	0.41	0.57	0.74	329	20.37	0.41	0.57	0.75	307.9	23.09	0.4	0.58	0.78	285.2	26.22	0.39	0.59	0.79

## DEHUMIDIFICATION SYSTEM RATINGS

NOTE - For Temperatures and Capacities not shown in tables, see bulletin - Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

### 15 TON - LGX180S5M WITH DEHUMIDIFICATION OPERATING (PART LOAD)

Entering Wet Bulb Tem- perature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
				75°F	80°F	85°F			75°F	80°F	85°F			75°F	80°F	85°F			75°F	80°F	85°F
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	3500	72.59	4.57	0.54	0.69	0.85	53.64	5.21	0.47	0.69	0.88	35.15	5.86	0.31	0.65	0.93	17.07	6.60	-0.26	0.52	1.00
	4000	75.44	4.61	0.57	0.74	0.89	55.69	5.25	0.50	0.73	0.91	36.13	5.90	0.35	0.71	0.96	16.84	6.64	-0.26	0.64	1.00
	4500	78.05	4.65	0.59	0.78	0.91	57.34	5.28	0.53	0.78	0.94	36.73	5.94	0.38	0.79	1.00	16.41	6.68	-0.26	0.78	1.00
67°F	3500	82.70	4.65	0.41	0.55	0.68	64.04	5.29	0.30	0.49	0.66	45.59	5.94	0.11	0.39	0.64	26.95	6.68	-0.38	0.14	0.56
	4000	86.10	4.69	0.42	0.57	0.71	66.31	5.33	0.32	0.52	0.71	46.67	5.99	0.12	0.42	0.69	26.64	6.72	-0.41	0.17	0.64
	4500	88.82	4.72	0.43	0.60	0.75	68.05	5.36	0.33	0.55	0.75	47.33	6.02	0.12	0.46	0.75	26.49	6.76	-0.45	0.21	0.73
71°F	3500	93.34	4.72	0.29	0.42	0.55	74.66	5.37	0.17	0.35	0.51	56.03	6.03	-0.02	0.22	0.43	37.37	6.77	-0.43	-0.04	0.29
	4000	96.78	4.75	0.29	0.44	0.58	76.88	5.40	0.18	0.37	0.54	57.14	6.06	-0.04	0.23	0.46	36.85	6.80	-0.49	-0.05	0.32
	4500	99.52	4.78	0.30	0.46	0.60	78.69	5.43	0.17	0.38	0.56	57.60	6.09	-0.05	0.25	0.50	36.46	6.83	-0.55	-0.05	0.36

### 15 TON - LGX180S5M WITH DEHUMIDIFICATION OPERATING (FULL LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
				75°F	80°F	85°F			75°F	80°F	85°F			75°F	80°F	85°F			75°F	80°F	85°F
63°F	cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F
	4800	120.72	6.98	0.55	0.75	0.94	96.51	8.10	0.50	0.75	0.98	72.52	9.22	0.41	0.75	1.00	48.73	10.42	0.24	0.74	1.00
	6000	127.64	7.04	0.61	0.85	1.00	101.51	8.16	0.58	0.87	1.00	75.20	9.29	0.52	0.90	1.00	48.74	10.48	0.38	0.98	1.00
67°F	7200	132.55	7.09	0.68	0.93	0.99	104.64	8.21	0.66	0.97	1.00	77.12	9.34	0.62	1.00	1.00	50.48	10.54	0.54	1.00	1.00
	4800	137.03	7.06	0.36	0.54	0.71	112.56	8.18	0.28	0.50	0.71	88.36	9.31	0.15	0.43	0.70	63.84	10.50	-0.08	0.32	0.69
	6000	144.54	7.12	0.40	0.61	0.81	117.97	8.24	0.32	0.58	0.82	91.14	9.36	0.20	0.53	0.84	64.72	10.56	-0.04	0.44	0.87
	7200	149.26	7.15	0.43	0.67	0.89	120.92	8.28	0.36	0.65	0.92	92.52	9.41	0.24	0.62	0.97	63.93	10.60	0.01	0.57	1.00
71°F	4800	152.82	7.13	0.21	0.37	0.53	128.39	8.25	0.11	0.31	0.49	103.94	9.38	-0.04	0.21	0.44	79.49	10.58	-0.28	0.05	0.36
	6000	161.14	7.18	0.22	0.41	0.60	134.13	8.31	0.12	0.35	0.57	107.35	9.44	-0.03	0.26	0.53	80.79	10.64	-0.30	0.11	0.47
	7200	166.14	7.22	0.22	0.45	0.66	137.10	8.34	0.12	0.39	0.64	108.70	9.47	-0.04	0.31	0.62	80.31	10.68	-0.32	0.16	0.58

### 17.5 TON - LGX210S5M WITH DEHUMIDIFICATION OPERATING (PART LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
	cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F
63°F	4000	81.12	6.32	0.52	0.67	0.81	58.39	6.92	0.40	0.61	0.81	36.56	7.64	0.14	0.51	0.79	15.31	8.53	-0.99	0.10	0.73
	4750	87.60	6.44	0.57	0.73	0.85	63.72	7.05	0.48	0.70	0.85	40.94	7.78	0.27	0.65	0.86	19.06	8.67	-0.45	0.48	0.86
	5500	92.28	6.54	0.61	0.78	0.88	67.89	7.15	0.53	0.78	0.88	44.46	7.88	0.38	0.76	0.88	22.33	8.78	-0.11	0.67	0.87
67°F	4000	93.54	6.49	0.40	0.54	0.66	70.79	7.10	0.27	0.45	0.62	48.53	7.84	0.01	0.30	0.55	27.58	8.74	-0.67	-0.07	0.39
	4750	99.88	6.61	0.43	0.58	0.72	76.35	7.23	0.32	0.52	0.70	52.97	7.96	0.10	0.40	0.66	31.04	8.87	-0.44	0.12	0.58
	5500	104.67	6.71	0.47	0.62	0.77	80.09	7.33	0.36	0.57	0.76	56.57	8.08	0.16	0.47	0.75	33.78	8.98	-0.30	0.26	0.72
71°F	4000	105.27	6.65	0.29	0.43	0.55	82.95	7.28	0.17	0.34	0.49	60.06	8.02	-0.09	0.17	0.39	39.01	8.93	-0.57	-0.16	0.19
	4750	111.93	6.78	0.32	0.46	0.59	88.05	7.41	0.19	0.38	0.54	64.84	8.16	-0.01	0.23	0.46	43.44	9.08	-0.44	-0.04	0.31
	5500	116.44	6.88	0.34	0.49	0.63	92.65	7.52	0.22	0.42	0.59	68.58	8.27	0.02	0.29	0.52	45.75	9.18	-0.37	0.04	0.41

### 17.5 TON - LGX210S5M WITH DEHUMIDIFICATION OPERATING (FULL LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
	cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F
63°F	5600	144.60	9.52	0.54	0.73	0.92	114.40	10.52	0.49	0.74	0.98	83.79	11.69	0.40	0.75	1.00	55.02	13.11	0.22	0.77	1.00
	7000	151.95	9.73	0.60	0.83	0.98	119.89	10.74	0.57	0.87	1.00	87.25	11.91	0.51	0.93	1.00	56.13	13.33	0.40	1.00	1.00
	8400	158.17	9.88	0.67	0.93	0.98	124.87	10.91	0.66	0.98	1.00	92.42	12.12	0.64	1.00	1.00	61.14	13.56	0.60	1.00	1.00
67°F	5600	164.88	9.79	0.35	0.52	0.70	134.57	10.82	0.26	0.49	0.70	103.68	12.00	0.13	0.42	0.70	74.12	13.42	-0.09	0.32	0.70
	7000	172.24	10.00	0.39	0.59	0.80	139.95	11.03	0.30	0.56	0.81	106.72	12.21	0.19	0.53	0.85	75.47	13.65	-0.03	0.45	0.90
	8400	177.60	10.14	0.42	0.66	0.89	144.10	11.19	0.35	0.65	0.92	109.15	12.37	0.24	0.64	0.98	75.85	13.79	0.04	0.61	1.00
71°F	5600	184.72	10.06	0.20	0.36	0.51	154.48	11.11	0.09	0.29	0.48	123.04	12.30	-0.05	0.20	0.43	93.34	13.74	-0.31	0.04	0.36
	7000	192.57	10.28	0.20	0.40	0.58	159.28	11.31	0.10	0.34	0.56	126.77	12.53	-0.05	0.25	0.53	94.88	13.96	-0.30	0.10	0.47
	8400	196.74	10.41	0.21	0.43	0.64	163.27	11.47	0.11	0.38	0.64	129.32	12.69	-0.04	0.31	0.62	96.15	14.13	-0.30	0.18	0.60

## DEHUMIDIFICATION SYSTEM RATINGS

NOTE - For Temperatures and Capacities not shown in tables, see bulletin - Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

### 20 TON - LGX240S5M WITH DEHUMIDIFICATION OPERATING (PART LOAD)

Entering Wet Bulb Tem- perature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		65°F						75°F						85°F						95°F					
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
				75°F	80°F	85°F			75°F	80°F	85°F			75°F	80°F	85°F			75°F	80°F	85°F				
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F					
63°F	4500	96.79	7.72	0.55	0.69	0.82	73.46	8.51	0.48	0.67	0.83	50.63	9.39	0.35	0.63	0.85	28.35	10.40	-0.02	0.51	0.86				
	5500	103.40	7.78	0.59	0.74	0.86	77.99	8.60	0.54	0.74	0.87	53.10	9.49	0.41	0.73	0.89	28.11	10.51	0.06	0.68	0.91				
	6500	108.13	7.82	0.63	0.80	0.88	81.43	8.65	0.58	0.81	0.88	54.97	9.57	0.48	0.81	0.89	29.03	10.60	0.15	0.78	0.89				
67°F	4500	110.57	7.80	0.43	0.56	0.68	87.35	8.62	0.35	0.51	0.66	64.28	9.52	0.20	0.43	0.63	41.48	10.55	-0.14	0.24	0.56				
	5500	117.63	7.85	0.46	0.60	0.73	92.37	8.69	0.38	0.56	0.73	66.66	9.61	0.22	0.48	0.71	41.93	10.66	-0.13	0.31	0.68				
	6500	122.65	7.87	0.48	0.64	0.78	95.38	8.74	0.40	0.60	0.79	68.39	9.67	0.25	0.54	0.79	41.69	10.73	-0.13	0.38	0.79				
71°F	4500	123.86	7.87	0.33	0.46	0.57	100.70	8.71	0.23	0.39	0.53	77.36	9.64	0.08	0.29	0.47	54.51	10.69	-0.22	0.09	0.35				
	5500	131.52	7.90	0.35	0.48	0.60	106.29	8.78	0.25	0.42	0.57	80.40	9.72	0.09	0.32	0.52	55.27	10.79	-0.25	0.11	0.41				
	6500	136.61	7.93	0.36	0.51	0.64	109.53	8.81	0.26	0.45	0.61	82.88	9.79	0.09	0.35	0.57	55.84	10.86	-0.26	0.14	0.48				

### 20 TON - LGX240S5M WITH DEHUMIDIFICATION OPERATING (FULL LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
				75°F	80°F	85°F			75°F	80°F	85°F			75°F	80°F	85°F			75°F	80°F	85°F
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	6400	168.32	11.65	0.57	0.77	0.95	137.65	12.99	0.54	0.77	1.00	107.51	14.46	0.48	0.79	1.00	77.36	16.11	0.39	0.82	1.00
	8000	178.04	11.74	0.64	0.86	1.00	144.61	13.12	0.61	0.89	1.00	111.58	14.61	0.58	0.94	1.00	79.37	16.29	0.52	1.00	1.00
	9600	185.73	11.80	0.70	0.95	1.00	150.80	13.21	0.70	0.99	1.00	116.30	14.73	0.69	1.00	1.00	83.70	16.45	0.67	1.00	1.00
67°F	6400	191.38	11.77	0.38	0.56	0.73	160.15	13.15	0.32	0.53	0.73	128.82	14.66	0.22	0.49	0.73	99.11	16.36	0.07	0.42	0.74
	8000	201.44	11.84	0.42	0.62	0.82	167.74	13.27	0.36	0.60	0.84	133.46	14.81	0.27	0.57	0.87	101.63	16.53	0.12	0.53	0.92
	9600	208.39	11.89	0.45	0.69	0.91	173.09	13.34	0.40	0.68	0.94	137.19	14.91	0.32	0.67	0.99	102.75	16.65	0.19	0.66	1.00
71°F	6400	213.96	11.87	0.23	0.39	0.54	182.74	13.31	0.15	0.33	0.52	150.78	14.86	0.03	0.26	0.48	120.99	16.60	-0.13	0.16	0.43
	8000	224.27	11.93	0.24	0.43	0.61	189.88	13.41	0.15	0.38	0.59	156.27	15.00	0.04	0.31	0.57	123.59	16.77	-0.13	0.21	0.54
	9600	231.20	11.97	0.25	0.47	0.67	195.38	13.48	0.17	0.43	0.66	160.30	15.10	0.05	0.37	0.66	124.56	16.77	-0.13	0.27	0.65

### 25 TON - LGX300S5M WITH DEHUMIDIFICATION OPERATING (PART LOAD)

Entering Wet Bulb Tem- perature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
				75°F	80°F	85°F			75°F	80°F	85°F			75°F	80°F	85°F			75°F	80°F	85°F
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	5750	85.82	6.39	0.69	0.97	1.00	63.38	6.97	0.62	1.00	1.00	40.76	7.62	0.47	1.00	1.00	17.68	8.47	-0.20	1.00	1.00
	6750	90.76	6.49	0.76	1.00	1.00	66.41	7.06	0.71	1.00	1.00	42.69	7.71	0.61	1.00	1.00	19.21	8.58	0.08	1.00	1.00
	7750	95.53	6.56	0.82	1.00	1.00	70.53	7.11	0.80	1.00	1.00	45.92	7.81	0.75	1.00	1.00	21.07	8.59	0.46	1.00	1.00
67°F	5750	99.33	6.54	0.43	0.68	0.92	76.24	7.09	0.29	0.63	0.93	52.77	7.76	0.04	0.53	0.97	29.91	8.55	-0.70	0.29	1.00
	6750	103.38	6.62	0.47	0.74	0.99	78.80	7.16	0.34	0.71	1.00	53.94	7.84	0.08	0.64	1.00	28.92	8.62	-0.69	0.46	1.00
	7750	106.98	6.67	0.51	0.80	1.00	80.48	7.22	0.39	0.79	1.00	54.47	7.90	0.13	0.75	1.00	27.95	8.68	-0.65	0.65	1.00
71°F	5750	112.29	6.68	0.22	0.45	0.67	89.05	7.23	0.05	0.35	0.63	65.59	7.91	-0.24	0.19	0.56	42.17	8.70	-0.90	-0.17	0.42
	6750	116.80	6.76	0.25	0.50	0.73	91.81	7.30	0.07	0.40	0.70	67.11	7.98	-0.25	0.24	0.66	41.68	8.78	-0.97	-0.12	0.55
	7750	120.70	6.81	0.27	0.53	0.78	94.30	7.36	0.10	0.44	0.77	68.13	8.05	-0.21	0.30	0.74	41.10	8.83	-0.99	-0.05	0.69

### 25 TON - LGX300S5M WITH DEHUMIDIFICATION OPERATING (FULL LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
				75°F	80°F	85°F			75°F	80°F	85°F			75°F	80°F	85°F			75°F	80°F	85°F
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	8000	212.97	13.23	0.62	0.83	0.95	181.79	14.73	0.59	0.82	0.98	149.47	16.46	0.59	0.83	1.00	116.66	18.45	0.55	0.86	1.00
	9500	221.32	13.37	0.66	0.86	1.00	185.85	14.88	0.65	0.88	1.00	150.35	16.58	0.64	0.90	1.00	113.28	18.63	0.60	0.94	1.00
	11000	228.63	13.49	0.71	0.91	1.00	189.97	15.01	0.71	0.93	1.00	150.35	16.72	0.72	0.96	1.00	110.10	18.70	0.67	1.00	1.00
67°F	8000	237.60	13.40	0.42	0.60	0.78	205.06	14.92	0.37	0.58	0.79	171.98	16.71	0.31	0.55	0.79	137.39	18.56	0.22	0.52	0.80
	9500	245.51	13.51	0.45	0.64	0.82	209.15	15.02	0.40	0.62	0.83	171.79	16.83	0.34	0.61	0.85	134.31	18.74	0.20	0.59	0.87
	11000	251.75	13.58	0.47	0.68	0.87	212.86	15.13	0.41	0.69	0.89	172.14	16.94	0.33	0.67	0.91	131.18	18.94	0.23	0.67	0.95
71°F	8000	264.05	13.60	0.26	0.43	0.58	230.83	15.15	0.20	0.39	0.57	196.57	16.87	0.12	0.34	0.54	162.03	18.98	0.01	0.25	0.50
	9500	272.96	13.72	0.26	0.44	0.62	236.36	15.27	0.20	0.41	0.60	198.53	17.01	0.11	0.33	0.58	159.20	19.13	-0.04	0.25	0.58
	11000	280.11	13.81	0.26	0.46	0.67	239.88	15.38	0.19	0.42	0.65	199.83	17.12	0.10	0.37	0.65	157.05	19.20	-0.05	0.29	0.63

## BLOWER DATA

BLOWER TABLE INCLUDES RESISTANCE FOR BASE UNIT ONLY WITH DRY INDOOR COIL & AIR FILTERS IN PLACE  
FOR ALL UNITS ADD:

- 1 - Wet indoor coil air resistance of selected unit.
- 2 - Any factory installed options air resistance (heat section, economizer, etc.)
- 3 - Any field installed accessories air resistance (heat section, duct resistance, diffuser, etc.)

Then determine from blower table blower motor output and drive required.

See page 31 for wet coil, option/accessory air resistance data, and factory installed drive kit specifications.

### Minimum Air Volume Required For Different Gas Heat Sizes:

Standard and Medium Heat - 4500 cfm | High Heat - 5125 cfm

Air Volume cfm	TOTAL STATIC PRESSURE - Inches Water Gauge (Pa)																							
	0.20		0.40		0.60		0.80		1.00		1.20		1.40		1.60		1.80		2.00		2.20		2.40	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2750	385	0.30	505	0.50	600	0.70	680	0.90	755	1.10	820	1.30	885	1.50	950	1.70	1015	1.90	1080	2.10	1145	2.30	1210	2.50
3000	395	0.35	515	0.55	610	0.75	685	1.00	760	1.20	825	1.45	890	1.65	955	1.85	1020	2.05	1085	2.25	1150	2.45	1215	2.65
3250	405	0.40	520	0.60	615	0.85	695	1.10	765	1.30	830	1.60	895	1.85	960	2.05	1025	2.25	1090	2.45	1155	2.65	1220	2.85
3500	415	0.45	530	0.70	620	0.95	700	1.20	775	1.45	840	1.70	900	2.00	965	2.25	1030	2.50	1095	2.70	1160	2.90	1225	3.10
3750	425	0.50	540	0.75	630	1.05	710	1.30	780	1.60	845	1.85	905	2.15	970	2.35	1035	2.60	1100	2.80	1165	3.00	1230	3.20
4000	435	0.55	545	0.85	635	1.10	715	1.40	785	1.70	850	2.00	910	2.30	975	2.55	1040	2.80	1105	3.05	1170	3.25	1235	3.45
4250	445	0.60	555	0.90	645	1.25	725	1.55	795	1.85	860	2.15	920	2.45	985	2.70	1050	2.95	1115	3.20	1180	3.45	1240	3.65
4500	455	0.70	565	1.00	655	1.35	730	1.65	800	2.00	865	2.35	925	2.65	990	2.90	1055	3.15	1120	3.40	1185	3.65	1245	3.85
4750	470	0.75	575	1.10	660	1.45	740	1.80	810	2.15	875	2.50	935	2.85	1000	3.10	1065	3.35	1130	3.60	1195	3.85	1250	4.05
5000	480	0.85	585	1.25	670	1.60	750	1.95	815	2.30	880	2.70	940	3.05	1005	3.35	1070	3.65	1135	3.95	1200	4.25	1260	4.55
5250	495	0.95	595	1.35	680	1.70	755	2.10	825	2.50	890	2.90	945	3.25	1010	3.60	1075	3.90	1140	4.20	1205	4.50	1265	4.80
5500	505	1.05	605	1.45	690	1.85	765	2.25	835	2.65	895	3.05	955	3.45	1015	3.85	1080	4.15	1145	4.45	1210	4.75	1270	5.05
5750	520	1.15	615	1.60	700	2.00	775	2.45	840	2.85	905	3.25	965	3.65	1025	4.05	1090	4.35	1155	4.65	1220	4.95	1280	5.25
6000	530	1.30	630	1.75	710	2.15	785	2.60	850	3.05	910	3.45	970	3.85	1030	4.25	1095	4.55	1160	4.85	1225	5.15	1285	5.45
6250	545	1.40	640	1.90	720	2.35	795	2.80	860	3.25	920	3.70	975	4.15	1035	4.55	1100	4.85	1165	5.15	1230	5.45	1290	5.75
6500	560	1.55	650	2.05	730	2.50	805	3.00	870	3.45	930	3.95	985	4.40	1040	4.85	1105	5.15	1170	5.45	1235	5.75	1295	6.05
6750	570	1.70	665	2.20	745	2.70	815	3.20	880	3.70	940	4.20	995	4.65	1045	5.10	1105	5.45	1170	5.75	1235	6.05	1295	6.35
7000	585	1.85	675	2.35	755	2.90	825	3.40	890	3.95	950	4.45	1005	4.95	1055	5.40	1115	5.75	1180	6.05	1240	6.35	1300	6.65
7250	600	2.00	690	2.60	765	3.10	835	3.65	900	4.15	955	4.65	1015	5.25	1065	5.75	1125	6.05	1190	6.35	1250	6.65	1310	6.95
7500	615	2.20	700	2.75	775	3.30	845	3.85	910	4.45	965	4.95	1020	5.50	1075	6.05	1135	6.35	1200	6.65	1260	6.95	1320	7.25
7750	630	2.40	715	3.00	790	3.55	855	4.10	920	4.70	975	5.25	1030	5.80	1080	6.35	1140	6.65	1205	6.95	1265	7.25	1325	7.55
8000	640	2.55	725	3.20	800	3.80	865	4.35	930	4.95	985	5.50	1040	6.10	1090	6.70	1150	7.05	1215	7.35	1275	7.65	1335	7.95
8250	655	2.80	740	3.40	810	4.00	880	4.65	940	5.25	995	5.85	1050	6.45	1100	7.05	1160	7.35	1225	7.65	1285	7.95	1345	8.25
8500	670	3.00	750	3.65	825	4.30	890	4.90	950	5.55	1005	6.15	1060	6.80	1110	7.40	1170	7.75	1230	8.05	1290	8.35	1350	8.65
8750	685	3.25	765	3.90	835	4.55	900	5.20	960	5.85	1015	6.45	1070	7.15	1120	7.75	1180	8.05	1240	8.35	1300	8.65	1360	8.95
9000	700	3.50	780	4.20	850	4.85	910	5.50	970	6.15	1025	6.80	1080	7.50	1130	8.15	1190	8.45	1250	8.75	1310	9.05	1370	9.35
9250	715	3.75	790	4.45	860	5.15	925	5.85	985	6.55	1040	7.20	1090	7.85	1140	8.55	1200	8.85	1260	9.15	1320	9.45	1380	9.75
9500	730	4.00	805	4.75	875	5.45	935	6.15	995	6.90	1050	7.60	1100	8.25	1150	8.95	1210	9.25	1270	9.55	1330	9.85	1390	10.15
9750	745	4.30	820	5.05	885	5.75	950	6.55	1005	7.20	1060	7.95	1110	8.65	1160	9.40	1220	9.70	1280	10.00	1340	10.30	1400	10.60
10,000	760	4.60	835	5.40	900	6.15	960	6.85	1015	7.60	1070	8.35	1120	9.05	1170	9.80	1230	10.10	1290	10.40	1350	10.70	1410	11.00
10,250	775	4.90	845	5.65	910	6.45	970	7.20	1030	8.00	1080	8.75	1135	9.55	1180	10.25	1240	10.55	1300	10.85	1360	11.15	1420	11.45
10,500	790	5.20	860	6.00	925	6.85	985	7.65	1040	8.40	1095	9.20	1145	10.00	1190	10.70	1250	11.00	1310	11.30	1370	11.60	1430	11.90
10,750	805	5.55	875	6.40	940	7.25	1000	8.05	1055	8.85	1105	9.65	1155	10.45	1200	11.20	1260	11.50	1320	11.80	1380	12.10	1440	12.40
11,000	820	5.90	890	6.80	950	7.60	1010	8.45	1065	9.30	1115	10.05	1165	10.90	1210	11.65	1270	11.95	1330	12.25	1390	12.55	1450	12.85

## BLOWER DATA

### FACTORY INSTALLED BELT DRIVE KIT SPECIFICATIONS

Nominal hp	Maximum hp	Drive Kit Number	RPM Range
3	3.45	1	535 - 725
3	3.45	2	710 - 965
5	5.75	3	685 - 856
5	5.75	4	850 - 1045
5	5.75	5	945 - 1185
7.5	8.63	6	850 - 1045
7.5	8.63	7	945 - 1185
7.5	8.63	8	1045 - 1285
10	11.50	7	945 - 1185
10	11.50	10	1045 - 1285
10	11.50	11	1135 - 1330

NOTE - Using total air volume and system static pressure requirements determine from blower performance tables rpm and motor output required. Maximum usable output of motors furnished are shown. In Canada, nominal motor output is also maximum usable motor output. If motors of comparable output are used, be sure to keep within the service factor limitations outlined on the motor nameplate.

NOTE - Motor service factor limit - 1.0.

### FACTORY INSTALLED OPTIONS/FIELD INSTALLED ACCESSORY AIR RESISTANCE - in w.g.

Air Volume cfm	Wet Indoor Coil		Reheat Coil	Gas Heat Exchanger			Economizer	Filters		Horizontal Roof Curb	
	180	210 240 300		Standard Heat	Medium Heat	High Heat		MERV 8	MERV 13	180 thru 240	300
2750	.01	.02	.01	.02	.04	.05	---	.01	.03	.03	---
3000	.01	.02	.01	.03	.04	.05	---	.01	.03	.04	---
3250	.01	.03	.01	.03	.05	.06	---	.01	.04	.04	.01
3500	.01	.03	.02	.03	.05	.06	---	.01	.04	.05	.01
3750	.01	.03	.02	.04	.06	.07	---	.01	.04	.05	.01
4000	.02	.04	.02	.04	.06	.07	---	.01	.04	.06	.02
4250	.02	.04	.02	.04	.06	.08	---	.01	.05	.07	.02
4500	.02	.05	.02	.05	.07	.09	---	.01	.05	.07	.02
4750	.02	.05	.02	.05	.08	.10	---	.02	.05	.08	.03
5000	.02	.05	.02	.05	.09	.11	---	.02	.06	.08	.03
5250	.02	.06	.03	.06	.10	.12	---	.02	.06	.09	.04
5500	.02	.07	.03	.06	.10	.13	---	.02	.06	.10	.04
5750	.03	.07	.03	.06	.11	.14	---	.02	.07	.11	.05
6000	.03	.08	.03	.07	.12	.15	---	.03	.07	.11	.06
6250	.03	.08	.03	.07	.12	.16	.01	.03	.07	.12	.07
6500	.03	.09	.04	.08	.13	.17	.02	.03	.08	.13	.08
6750	.04	.10	.04	.08	.14	.18	.03	.03	.08	.14	.08
7000	.04	.10	.04	.09	.15	.19	.04	.04	.08	.15	.09
7250	.04	.11	.04	.09	.16	.20	.05	.04	.09	.16	.10
7500	.05	.12	.05	.10	.17	.21	.06	.04	.09	.17	.11
8000	.05	.13	.05	.11	.19	.24	.09	.05	.10	.19	.13
8500	.06	.15	.05	.12	.20	.26	.11	.05	.10	.21	.15
9000	.07	.16	.06	.13	.23	.29	.14	.06	.11	.24	.17
9500	.08	.18	.07	.14	.25	.32	.16	.07	.12	.26	.19
10,000	.08	.20	.07	.16	.27	.35	.19	.07	.12	.29	.21
10,500	.09	.22	.08	.17	.30	.38	.22	.08	.13	.31	.24
11,000	.11	.24	.08	.18	.31	.40	.25	.09	.14	.34	.27



## BLOWER DATA

### CEILING DIFFUSER AIR RESISTANCE - in. w.g.

Air Volume cfm	Step-Down Diffuser						Flush Diffuser	
	RTD11-185S			RTD11-275S			FD11-185S	FD11-275S
	2 Ends Open	1 Side/2 Ends Open	All Ends & Sides Open	2 Ends Open	1 Side/2 Ends Open	All Ends & Sides Open		
5000	.51	.44	.39	---	---	---	.27	---
5200	.56	.48	.42	---	---	---	.30	---
5400	.61	.52	.45	---	---	---	.33	---
5600	.66	.56	.48	---	---	---	.36	---
5800	.71	.59	.51	---	---	---	.39	---
6000	.76	.63	.55	.36	.31	.27	.42	.29
6200	.80	.68	.59	---	---	---	.46	---
6400	.86	.72	.63	---	---	---	.50	---
6500	---	---	---	.42	.36	.31	---	.34
6600	.92	.77	.67	---	---	---	.54	---
6800	.99	.83	.72	---	---	---	.58	---
7000	1.03	.87	.76	.49	.41	.36	.62	.40
7200	1.09	.92	.80	---	---	---	.66	---
7400	1.15	.97	.84	---	---	---	.70	---
7500	---	---	---	.51	.46	.41	---	.45
7600	1.20	1.02	.88	---	---	---	.74	---
8000	---	---	---	.59	.49	.43	---	.50
8500	---	---	---	.69	.58	.50	---	.57
9000	---	---	---	.79	.67	.58	---	.66
9500	---	---	---	.89	.75	.65	---	.74
10,000	---	---	---	1.00	.84	.73	---	.81
10,500	---	---	---	1.10	.92	.80	---	.89
11,000	---	---	---	1.21	1.01	.88	---	.96

### CEILING DIFFUSER AIR THROW DATA

Size	Air Volume cfm	<sup>1</sup> Effective Throw Range - ft.		Size	Air Volume cfm	<sup>1</sup> Effective Throw Range - ft.	
		RTD11-185S Step-Down	FD11-185S Flush			RTD11-275S Step-Down	FD11-275S Flush
180	5600	39 - 49	28 - 37	210 240 300	7200	33 - 38	26 - 35
	5800	42 - 51	29 - 38		7400	35 - 40	28 - 37
	6000	44 - 54	40 - 50		7600	36 - 41	29 - 38
	6200	45 - 55	42 - 51		7800	38 - 43	40 - 50
	6400	46 - 55	43 - 52		8000	39 - 44	42 - 51
	6600	47 - 56	45 - 56		8200	41 - 46	43 - 52
					8400	43 - 49	44 - 54
					8600	44 - 50	46 - 57
					8800	47 - 55	48 - 59

<sup>1</sup> Throw is the horizontal or vertical distance an airstream travels on leaving the outlet or diffuser before the maximum velocity is reduced to 50 ft. per minute. Four sides open.

### POWER EXHAUST FAN PERFORMANCE

Return Air System Static Pressure	Air Volume Exhausted
in. w.g.	cfm
0.00	8630
0.05	8210
0.10	7725
0.15	7110
0.20	6470
0.25	5790
0.30	5060
0.35	4300
0.40	3510
0.45	2690
0.50	1840



# ELECTRICAL DATA

15 TON | 17.5 TON

Model		LGX180S5								
<sup>1</sup> Voltage - 60Hz		208/230V - 3 Ph			460V - 3 Ph			575V - 3 Ph		
Compressor 1 (Non-Inverter)	Rated Load Amps	13.1			6.6			4.8		
	Locked Rotor Amps	93			60			41		
Compressor 2 (Non-Inverter)	Rated Load Amps	13.1			6.6			4.8		
	Locked Rotor Amps	93			60			41		
Compressor 3 (Non-Inverter)	Rated Load Amps	13.1			6.6			4.8		
	Locked Rotor Amps	93			60			41		
Outdoor Fan Motors (3)	Full Load Amps (3 Non-ECM)	2.4			1.3			1		
	Total	7.2			3.9			3		
Power Exhaust (2) 0.33 HP	Full Load Amps	2.4			1.3			1		
	Total	4.8			2.6			2		
Service Outlet 115V GFI (amps)		15			15			20		
Indoor Blower Motor	HP	3	5	7.5	3	5	7.5	3	5	7.5
	Full Load Amps	10.6	16.7	24.2	4.8	7.6	11	3.9	6.1	9
<sup>2</sup> Maximum Overcurrent Protection (MOCP)	Unit Only	70	80	100	35	40	45	25	30	35
	With (2) 0.33 HP Power Exhaust	70	80	100	35	40	50	25	30	35
<sup>3</sup> Minimum Circuit Ampacity (MCA)	Unit Only	61	68	77	31	34	38	23	26	29
	With (2) 0.33 HP Power Exhaust	66	73	82	33	36	41	25	28	31

NOTE - All units have a minimum Short Circuit Current Rating (SCCR) of 5000 amps.

<sup>1</sup> Extremes of operating range are plus and minus 10% of line voltage.

<sup>2</sup> HACR type breaker or fuse.

<sup>3</sup> Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.

Model		LGX210S5								
<sup>1</sup> Voltage - 60Hz		208/230V - 3 Ph			460V - 3 Ph			575V - 3 Ph		
Compressor 1 (Non-Inverter)	Rated Load Amps	21.2			9.1			7.7		
	Locked Rotor Amps	156.5			74.8			47.8		
Compressor 2 (Non-Inverter)	Rated Load Amps	21.2			9.1			7.7		
	Locked Rotor Amps	156.5			74.8			47.8		
Compressor 3 (Non-Inverter)	Rated Load Amps	21.2			9.1			7.7		
	Locked Rotor Amps	156.5			74.8			47.8		
Outdoor Fan Motors (3)	Full Load Amps (3 Non-ECM)	2.4			1.3			1		
	Total	7.2			3.9			3		
Power Exhaust (2) 0.33 HP	Full Load Amps	2.4			1.3			1		
	Total	4.8			2.6			2		
Service Outlet 115V GFI (amps)		15			15			20		
Indoor Blower Motor	HP	3	5	7.5	3	5	7.5	3	5	7.5
	Full Load Amps	10.6	16.7	24.2	4.8	7.6	11	3.9	6.1	9
<sup>2</sup> Maximum Overcurrent Protection (MOCP)	Unit Only	100	110	125	45	50	50	35	40	45
	With (2) 0.33 HP Power Exhaust	110	110	125	45	50	50	40	40	45
<sup>3</sup> Minimum Circuit Ampacity (MCA)	Unit Only	87	93	102	39	42	45	32	35	38
	With (2) 0.33 HP Power Exhaust	92	98	106	41	44	48	34	37	40

NOTE - All units have a minimum Short Circuit Current Rating (SCCR) of 5000 amps.

<sup>1</sup> Extremes of operating range are plus and minus 10% of line voltage.

<sup>2</sup> HACR type breaker or fuse.

<sup>3</sup> Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.

# ELECTRICAL DATA

20 TON | 25 TON

Model		LGX240S5								
<sup>1</sup> Voltage - 60Hz		208/230V - 3 Ph			460V - 3 Ph			575V - 3 Ph		
Compressor 1 (Non-Inverter)	Rated Load Amps	22.4			9.1			7.2		
	Locked Rotor Amps	166.2			74.6			54		
Compressor 2 (Non-Inverter)	Rated Load Amps	22.4			9.1			7.2		
	Locked Rotor Amps	166.2			74.6			54		
Compressor 3 (Non-Inverter)	Rated Load Amps	24.4			11.9			9.4		
	Locked Rotor Amps	210			103			78		
Outdoor Fan Motors (4)	Full Load Amps (4 Non-ECM)	2.4			1.3			1		
	Total	9.6			5.2			4		
Power Exhaust (2) 0.33 HP	Full Load Amps	2.4			1.3			1		
	Total	4.8			2.6			2		
Service Outlet 115V GFI (amps)		15			15			20		
Indoor Blower Motor	HP	5	7.5	10	5	7.5	10	5	7.5	10
	Full Load Amps	16.7	24.2	24.2	7.6	11	14	6.1	9	11
<sup>2</sup> Maximum Overcurrent Protection (MOCP)	Unit Only	125	125	125	50	60	60	45	45	50
	With (2) 0.33 HP Power Exhaust	125	125	125	60	60	60	45	50	50
<sup>3</sup> Minimum Circuit Ampacity (MCA)	Unit Only	102	110	110	46	50	53	37	40	42
	With (2) 0.33 HP Power Exhaust	107	114	114	49	52	56	39	42	44

NOTE - All units have a minimum Short Circuit Current Rating (SCCR) of 5000 amps.

<sup>1</sup> Extremes of operating range are plus and minus 10% of line voltage.

<sup>2</sup> HACR type breaker or fuse.

<sup>3</sup> Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.

Model		LGX300S5								
<sup>1</sup> Voltage - 60Hz		208/230V - 3 Ph			460V - 3 Ph			575V - 3 Ph		
Compressor 1 (Non-Inverter)	Rated Load Amps	21.2			9.1			7.7		
	Locked Rotor Amps	156.5			74.8			47.8		
Compressor 2 (Non-Inverter)	Rated Load Amps	21.2			9.1			7.7		
	Locked Rotor Amps	156.5			74.8			47.8		
Compressor 3 (Non-Inverter)	Rated Load Amps	22.4			9.1			7.2		
	Locked Rotor Amps	166.2			74.6			54		
Compressor 4 (Non-Inverter)	Rated Load Amps	22.4			9.1			7.2		
	Locked Rotor Amps	166.2			74.6			54		
Outdoor Fan Motors (6)	Full Load Amps (6 Non-ECM)	2.4			1.3			1		
	Total	14.4			7.8			6		
Power Exhaust (2) 0.33 HP	Full Load Amps	2.4			1.3			1		
	Total	4.8			2.6			2		
Service Outlet 115V GFI (amps)		15			15			20		
Indoor Blower Motor	HP	5	7.5	10	5	7.5	10	5	7.5	10
	Full Load Amps	16.7	24.2	30.8	7.6	11	14	6.1	9	11
<sup>2</sup> Maximum Overcurrent Protection (MOCP)	Unit Only	125	150	150	60	60	70	50	50	60
	With (2) 0.33 HP Power Exhaust	150	150	175	60	70	70	50	50	60
<sup>3</sup> Minimum Circuit Ampacity (MCA)	Unit Only	124	132	141	55	58	62	44	48	50
	With (2) 0.33 HP Power Exhaust	129	137	145	57	61	65	46	50	52

NOTE - All units have a minimum Short Circuit Current Rating (SCCR) of 5000 amps.

<sup>1</sup> Extremes of operating range are plus and minus 10% of line voltage.

<sup>2</sup> HACR type breaker or fuse.

<sup>3</sup> Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.

## ELECTRICAL ACCESSORIES - DISCONNECTS

### 15 TON | LGX180S5

Motor HP Voltage	3		5		7.5		3	5	7.5	3	5	7.5
	208V	230V	208V	230V	208V	230V	460V	460V	460V	575V	575V	575V
Unit Only	54W88	54W88	54W88	54W88	54W89	54W89	54W88	54W88	54W88	54W88	54W88	54W88
Unit w/ Power Exhaust	54W88	54W88	54W88	54W88	54W89	54W89	54W88	54W88	54W88	54W88	54W88	54W88

### 17.5 TON | LGX210S5

Motor HP Voltage	3		5		7.5		3	5	7.5	3	5	7.5
	208V	230V	208V	230V	208V	230V	460V	460V	460V	575V	575V	575V
Unit Only	54W89	54W89	54W89	54W89	54W89	54W89	54W88	54W88	54W88	54W88	54W88	54W88
Unit w/ Power Exhaust	54W89	54W89	54W89	54W89	54W89	54W89	54W88	54W88	54W88	54W88	54W88	54W88

### 20 TON | LGX240S5

Motor HP Voltage	5		7.5		10		5	7.5	10	5	7.5	10
	208V	230V	208V	230V	208V	230V	460V	460V	460V	575V	575V	575V
Unit Only	54W89	54W89	54W89	54W89	54W89	54W89	54W88	54W88	54W88	54W88	54W88	54W88
Unit w/ Power Exhaust	54W89	54W89	54W89	54W89	54W89	54W89	54W88	54W88	54W88	54W88	54W88	54W88

### 25 TON | LGX300S5

Motor HP Voltage	5		7.5		10		5	7.5	10	5	7.5	10
	208V	230V	208V	230V	208V	230V	460V	460V	460V	575V	575V	575V
Unit Only	54W89	54W89	54W89	54W89	54W89	54W89	54W88	54W88	54W88	54W88	54W88	54W88
Unit w/ Power Exhaust	54W89	54W89	54W89	54W89	90W82	90W82	54W88	54W88	54W88	54W88	54W88	54W88

Disconnects - 54W88 - 80A  
54W89 - 150A  
90W82 - 250A


<sup>1</sup> Disconnect must be field furnished.

#### FIELD WIRING NOTES

- For use with copper wiring only
- Field wiring not furnished
- All wiring must conform to NEC or CEC and local electrical codes
- For specific wiring information, please refer to the installation instructions

## UNIT CLEARANCES

### Unit With Economizer

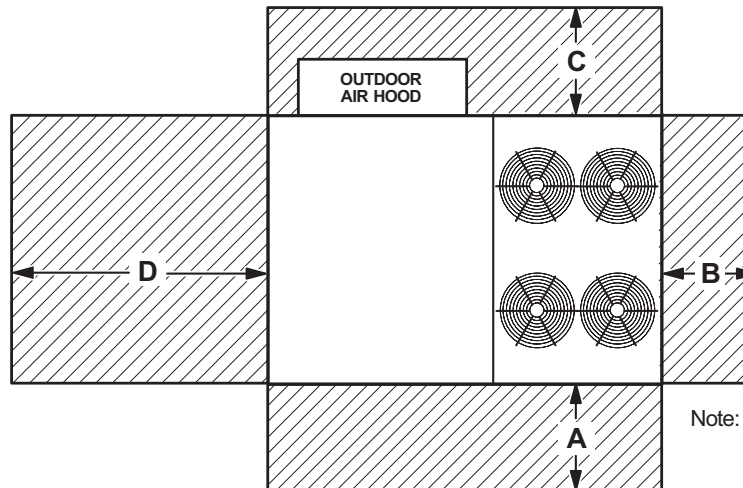

Note: Models with four outdoor fans shown.  
Dimension clearances are for all sizes.

<sup>1</sup> Unit Clearance	A		B		C		D		Top Clearance
	in.	mm	in.	mm	in.	mm	in.	mm	
<b>Service Clearance</b>	60	1524	36	914	36	914	66	1676	Unobstructed
<b>Clearance to Combustibles</b>	36	914	1	25	1	25	1	25	
<b>Minimum Operation Clearance</b>	45	1143	36	914	36	914	41	1041	

NOTE - Entire perimeter of unit base requires support when elevated above the mounting surface.

<sup>1</sup> Service Clearance - Required for removal of serviceable parts.

Clearance to Combustibles - Required clearance to combustible material.

Minimum Operation Clearance - Required clearance for proper unit operation.

## OUTDOOR SOUND DATA

Size	Octave Band Sound Power Levels dBA, re 10 <sup>-12</sup> Watts - Center Frequency - Hz							<sup>1</sup> Sound Rating Number (SRN) (dBA)
	125	250	500	1000	2000	4000	8000	
180, 210	71	78	81	81	76	71	63	86
240	80	83	87	88	84	80	71	93
300	79	84	88	89	85	82	73	94

Note - The octave sound power data does not include tonal corrections.

<sup>1</sup> Sound Rating Number according to AHRI Standard 270-95 (includes pure tone penalty). Sound Rating Number is the overall A-Weighted Sound Power Level, (LWA), dBA (100 Hz to 10,000 Hz).

## WEIGHT DATA

Size	Net		Shipping	
	lbs.	kg	lbs.	kg
180S Base Unit	1884	855	2084	945
180S Max. Unit	2204	1000	2404	1090
210S Base Unit	2044	927	2244	1018
210S Max. Unit	2374	1077	2574	1167
240S Base Unit	2216	1005	2416	1096
240S Max. Unit	2546	1155	2746	1246
300S Base Unit	2460	1116	2660	1207
300S Max. Unit	2750	1247	2950	1338

NOTE - Max. Unit is the unit with ALL INTERNAL OPTIONS Installed. (Economizer, Standard Static Power Exhaust Fans, Controls, etc.). Does not include accessories EXTERNAL to unit.

## FACTORY / FIELD INSTALLED OPTIONS AND ACCESSORIES - NET WEIGHTS

Description		lbs.	kg
ECONOMIZER / OUTDOOR AIR / EXHAUST			
Economizer			
Economizer Dampers		102	46
Barometric Relief Dampers (downflow)		30	14
Barometric Relief Dampers (horizontal)		20	9
Outdoor Air Dampers			
Motorized		52	24
Manual		49	22
Outdoor Air Damper Hood (downflow)		65	29
Power Exhaust		62	28
GAS HEAT EXCHANGER (NET WEIGHT)			
Medium Heat (adder over standard heat)		54	25
High Heat (adder over standard heat)		90	41
COIL/HAIL GUARDS			
180/210		30	13
240/300		36	16
ROOF CURBS			
Hybrid Roof Curb, Downflow			
8 in. height		136	62
14 in. height		169	77
18 in. height		191	87
24 in. height		224	102
Adjustable Pitch Curb, Downflow			
14 in. height		224	102
Horizontal Roof Curbs, Standard			
26 in. height		450	204
37 in. height		540	245
30 in. height		495	225
41 in. height		575	261
CEILING DIFFUSERS			
Step-Down	RTD11-185S	168	76
	RTD11-275S	238	108
Flush	FD11-185S	168	76
	FD11-275S	238	108
Transitions	C1DIFF33C-1	80	36
	C1DIFF34C-1	75	34
DEHUMIDIFICATION SYSTEM			
Dehumidification Option		50	23

# DIMENSIONS - UNIT


LGX180 | LGX210

## CORNER WEIGHTS


Model	AA		BB		CC		DD		E CENTER OF GRAVITY		F	
	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	in.	mm	in.	mm
LGX180S Base Unit	426	194	378	172	508	231	572	260	50-5/8	1286	38-7/8	987
LGX180S Max. Unit (Eco-Last™ Coil)	541	246	452	206	551	251	659	300	49	1247	41	1043
LGX210S Base Unit	468	213	419	190	546	248	611	278	50-7/8	1292	39-1/2	1004
LGX210S Max. Unit	593	270	499	227	585	266	696	317	49-1/4	1250	42	1065

Base Unit - The unit with NO INTERNAL OPTIONS.


Max. Unit - The unit with ALL INTERNAL OPTIONS Installed. (Economizer, Standard Static Power Exhaust Fans, Controls, etc.). Does not include accessories external to unit.

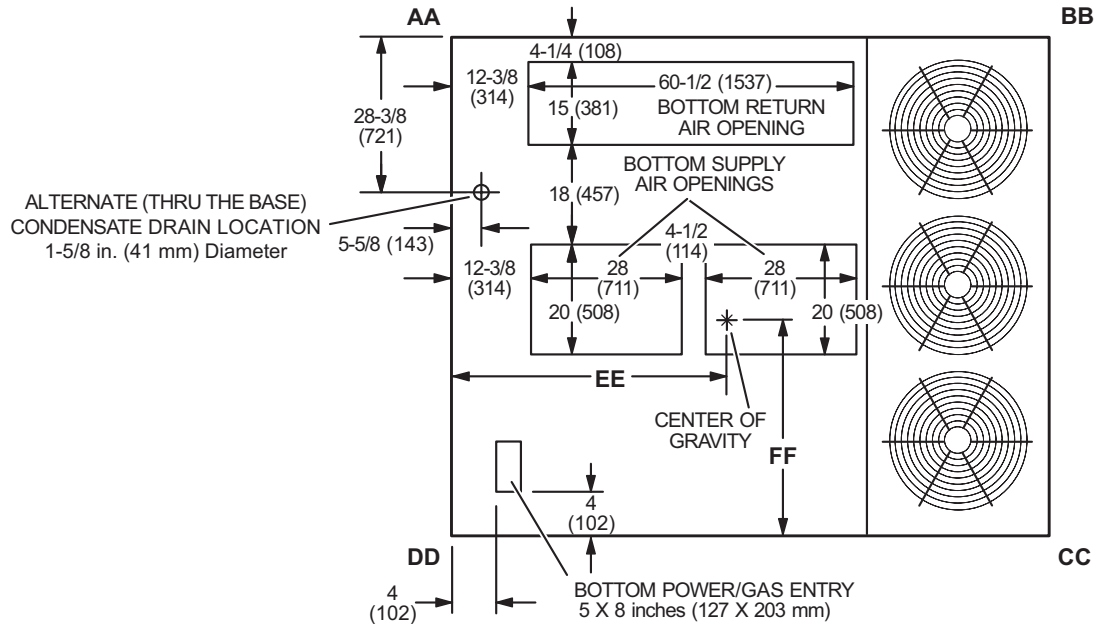

TOP VIEW

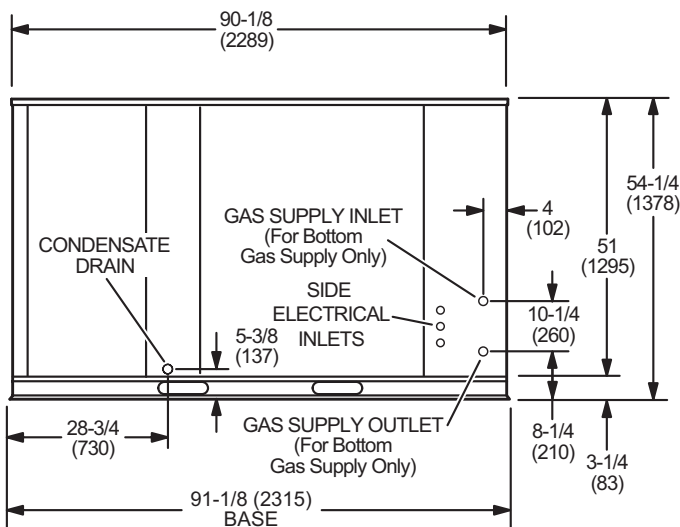

END VIEW

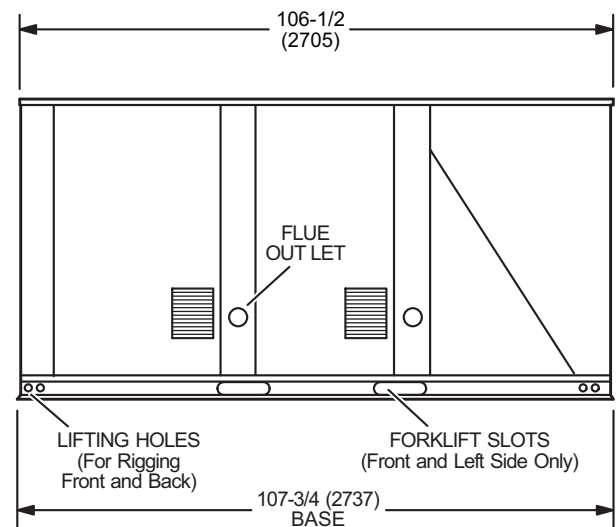

SIDE VIEW

# DIMENSIONS - UNIT


LGX240

## CORNER WEIGHTS


Model	AA		BB		CC		DD		CENTER OF GRAVITY		FF	
	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	in.	mm	in.	mm
LGX240S Base Unit	466	212	437	199	635	289	677	308	52-1/8	1325	37-1/8	944
LGX240S Max. Unit	576	262	524	238	689	313	758	344	51-1/4	1303	39-3/8	1000

Base Unit - The unit with NO INTERNAL OPTIONS.


Max. Unit - The unit with ALL INTERNAL OPTIONS Installed. (Economizer, Standard Static Power Exhaust Fans, Controls, etc.). Does not include accessories external to unit.

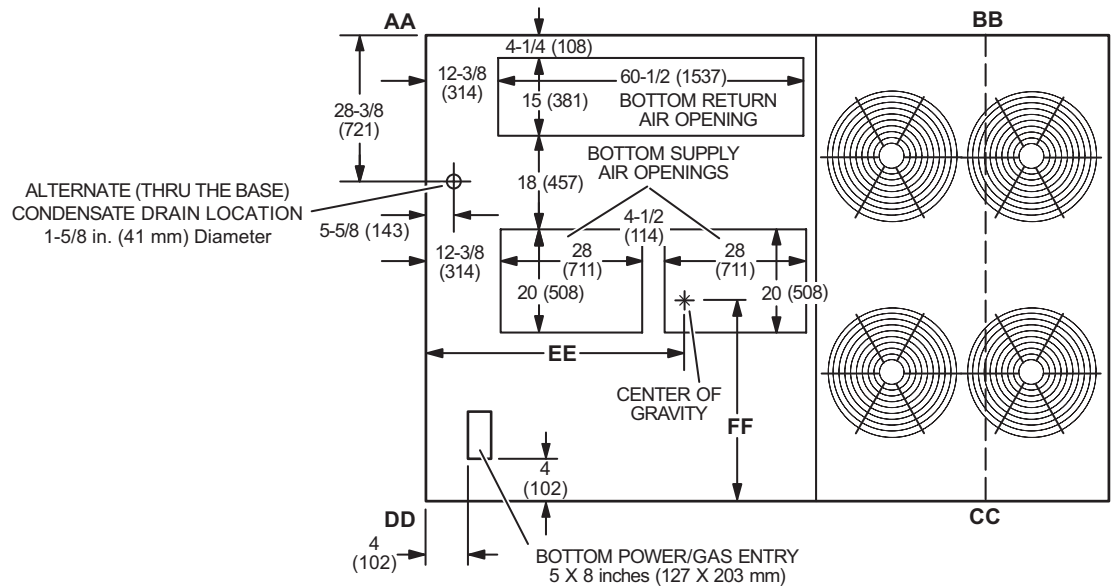

TOP VIEW

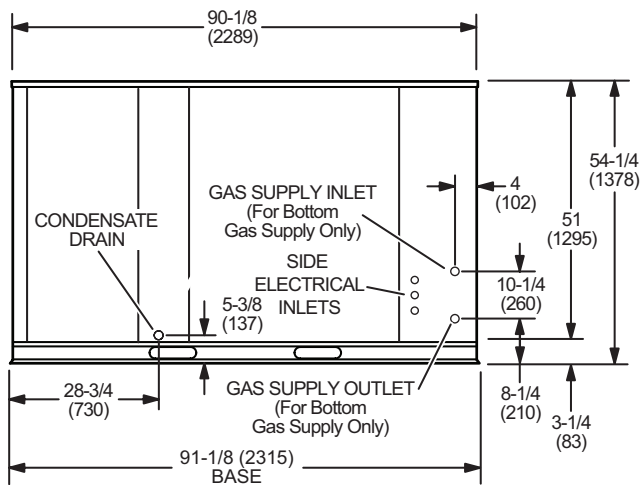

END VIEW

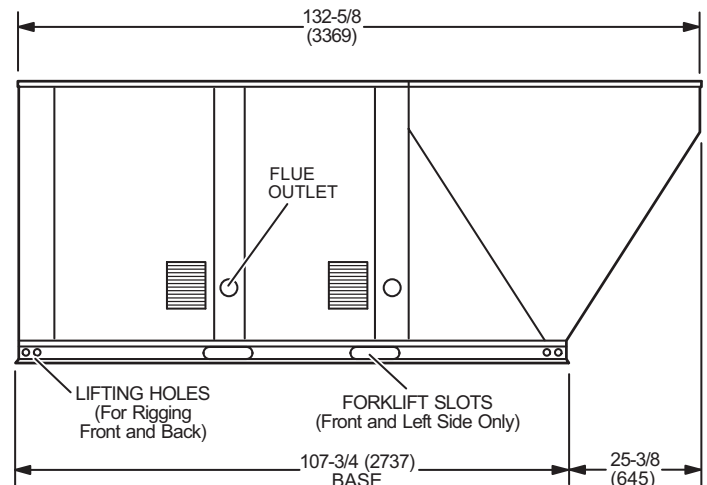

SIDE VIEW



# DIMENSIONS - UNIT


LGX300

## CORNER WEIGHTS


Model	AA		BB		CC		DD		CENTER OF GRAVITY		FF	
	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	in.	mm	in.	mm
LGX300S Base Unit	512	233	509	231	718	326	722	328	53-3/4	1364	37-3/4	960
LGX300S Max. Unit	625	284	598	272	747	339	780	355	52-3/4	1339	40-1/2	1029

Base Unit - The unit with NO INTERNAL OPTIONS.


Max. Unit - The unit with ALL INTERNAL OPTIONS Installed. (Economizer, Standard Static Power Exhaust Fans, Controls, etc.). Does not include accessories external to unit.

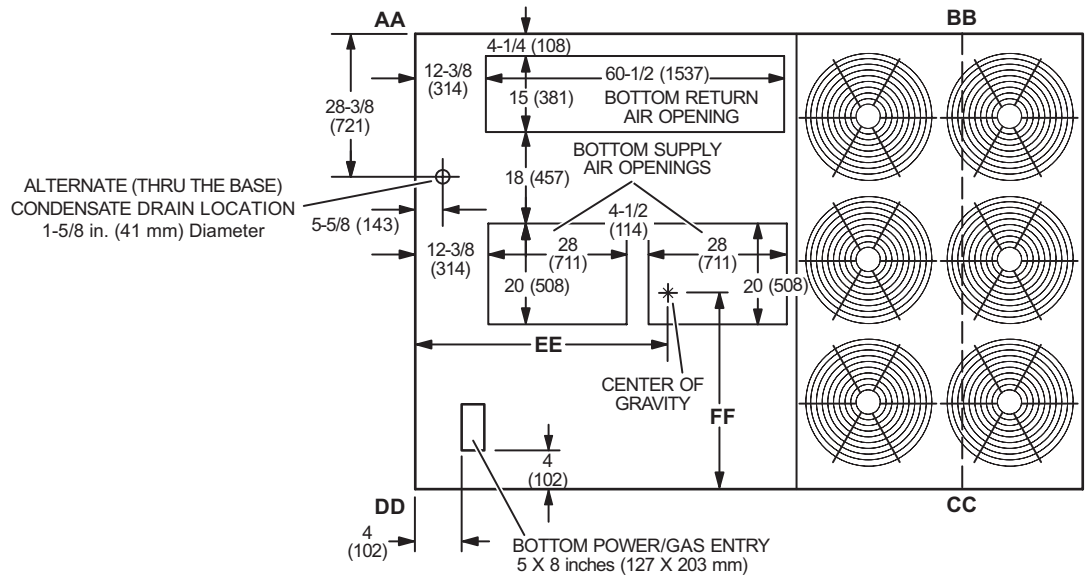

TOP VIEW

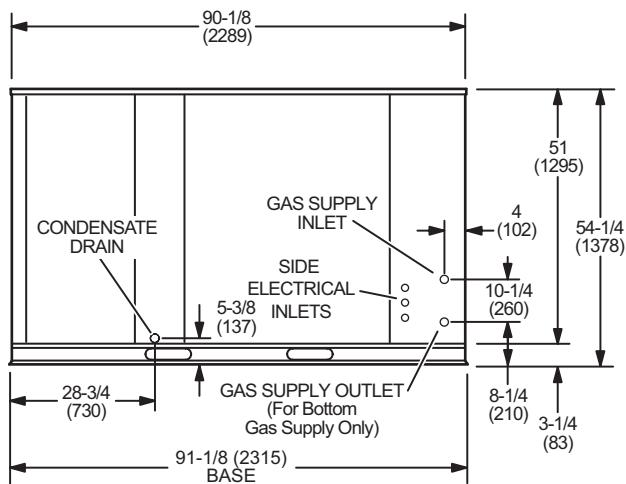


END VIEW

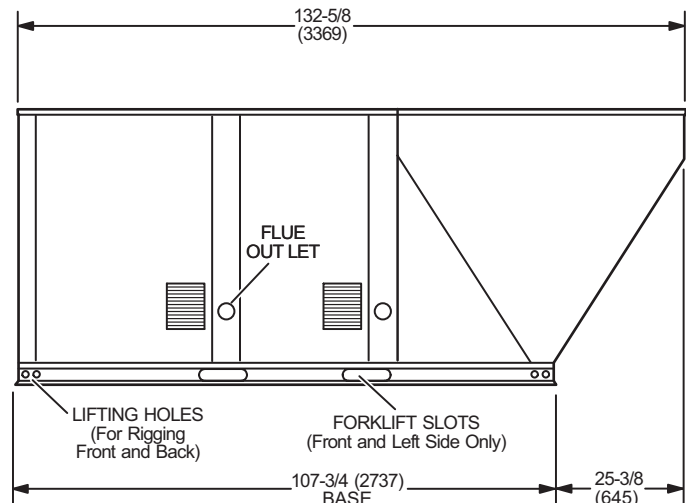


SIDE VIEW

**OUTDOOR AIR HOOD DETAIL**

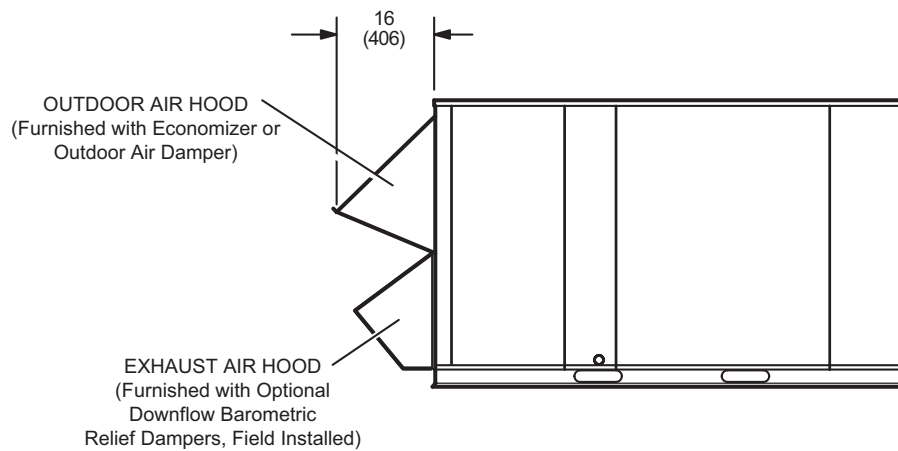


**OPTIONAL HORIZONTAL BAROMETRIC RELIEF DAMPERS WITH HOOD**

(Field installed in horizontal return air duct adjacent to unit)

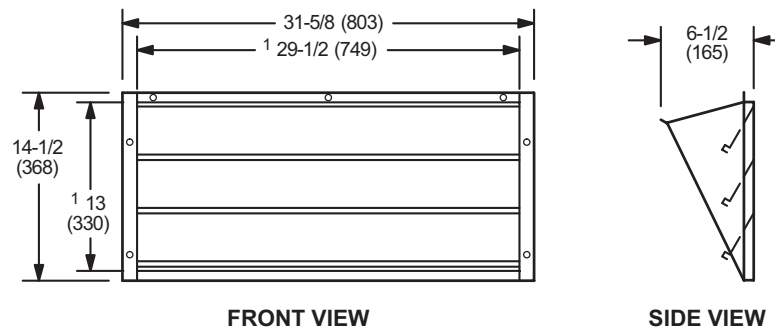


NOTE - Two furnished per order no.  
<sup>1</sup> NOTE - Opening size required in return air duct.


**HYBRID ROOF CURBS - DOUBLE DUCT OPENING**

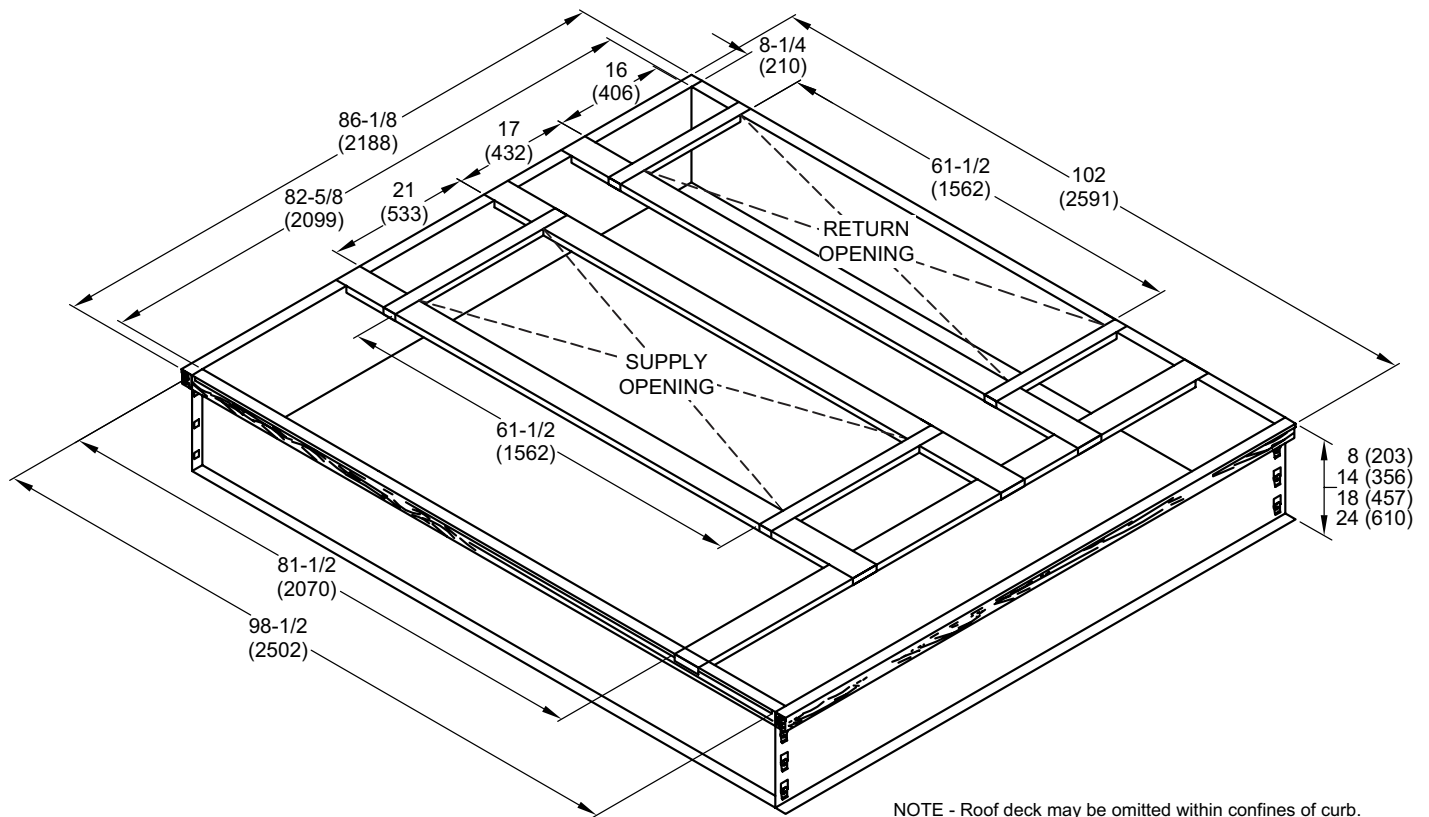


**TYPICAL FLASHING DETAIL FOR ROOF CURB**

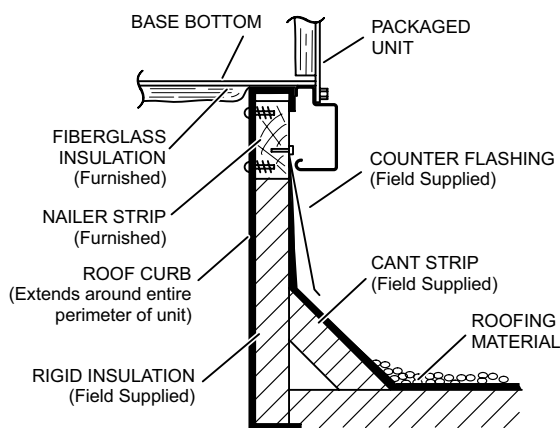

**DETAIL ROOF CURB**

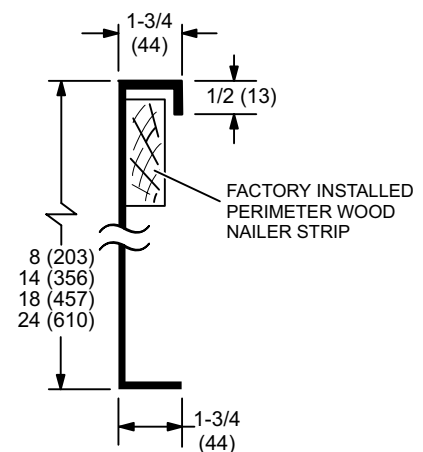


**ADJUSTABLE PITCH CURB - DOUBLE DUCT OPENING**

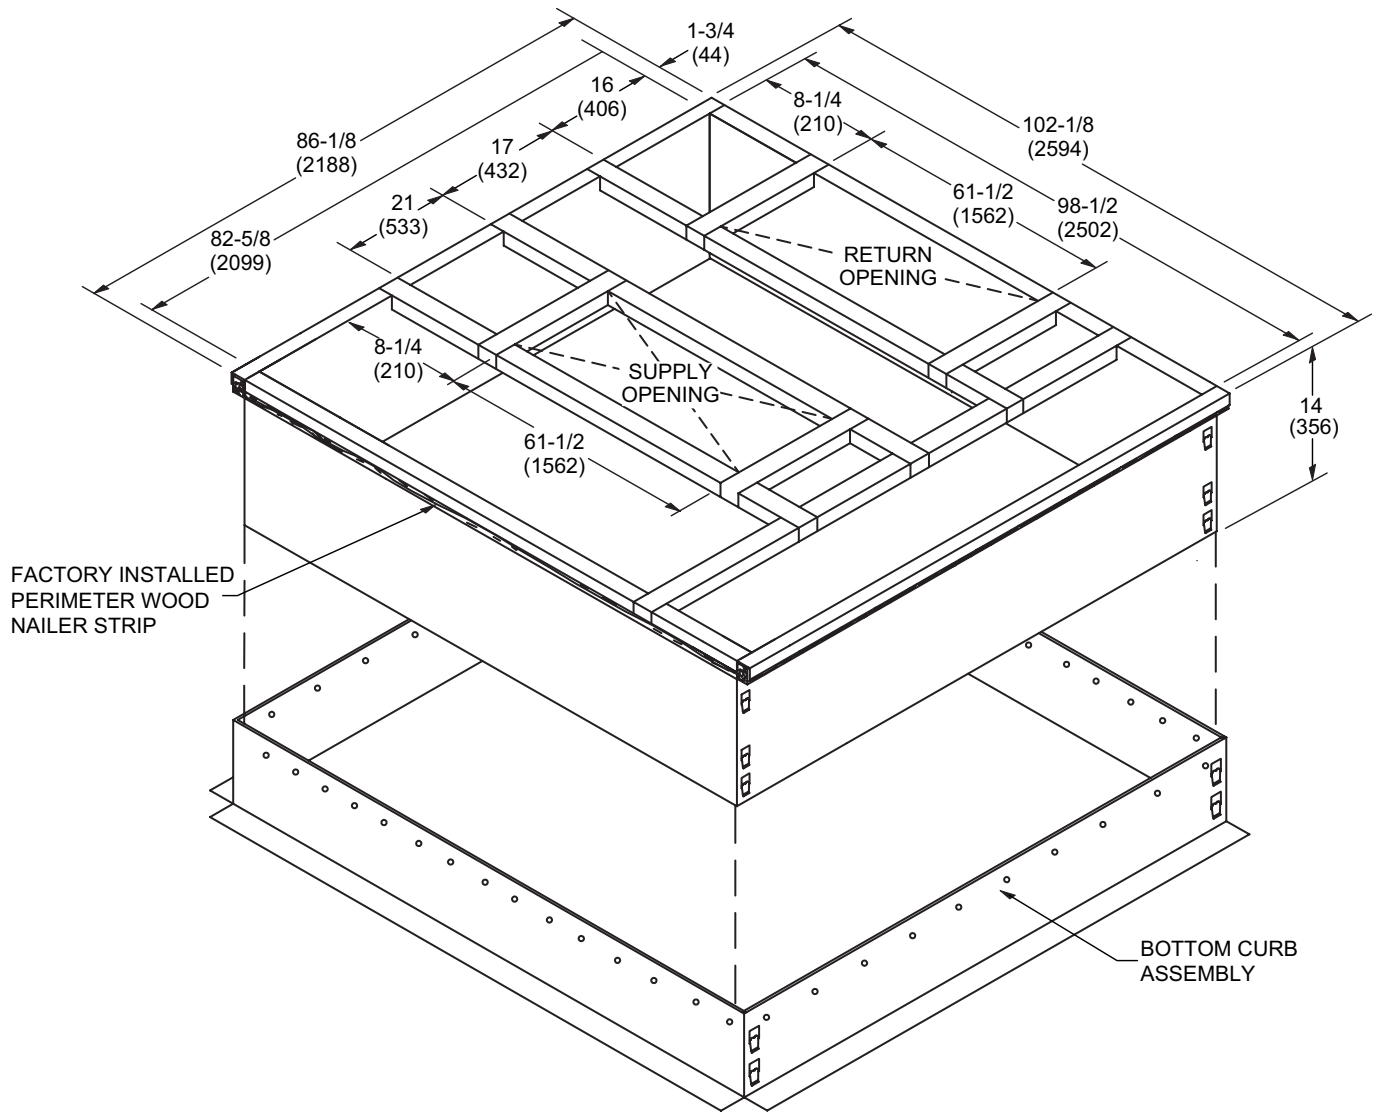


NOTE - Maximum slope pitch is 3/4 in. per 1 foot (19 mm per 305 mm) in any one direction.


**TYPICAL FLASHING DETAIL FOR ROOF CURB**

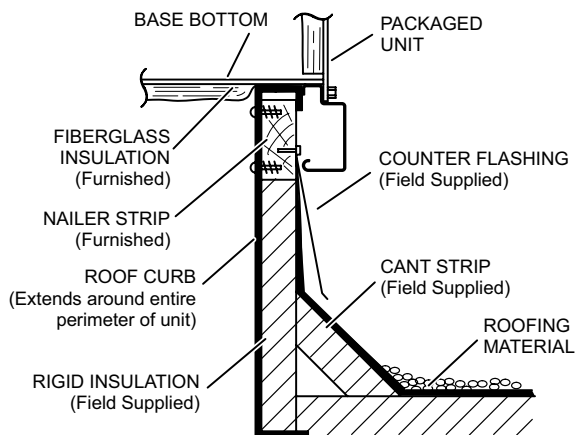


**DETAIL ROOF CURB**

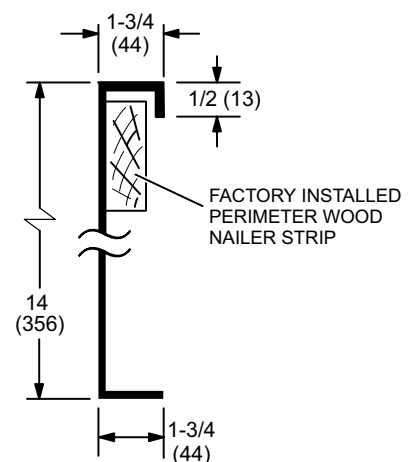

**ROOF CURBS WITH SUPPLY & RETURN AIR TRANSITIONS FOR CEILING DIFFUSERS**

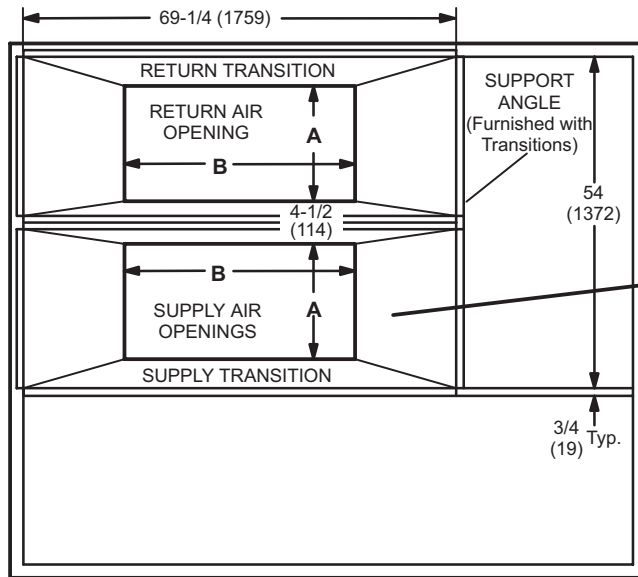


**TOP VIEW**

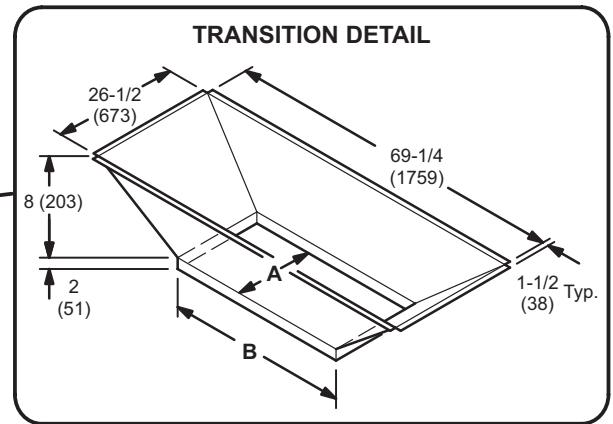


**TRANSITION OPENING SIZES**

Model Number	A		B	
	inch	mm	inch	mm
C1DIFF33C-1	18	457	36	914
C1DIFF34C-1	24	610	48	1219

**HORIZONTAL ROOF CURBS – Requires Optional Horizontal Return Air Panel Kit**

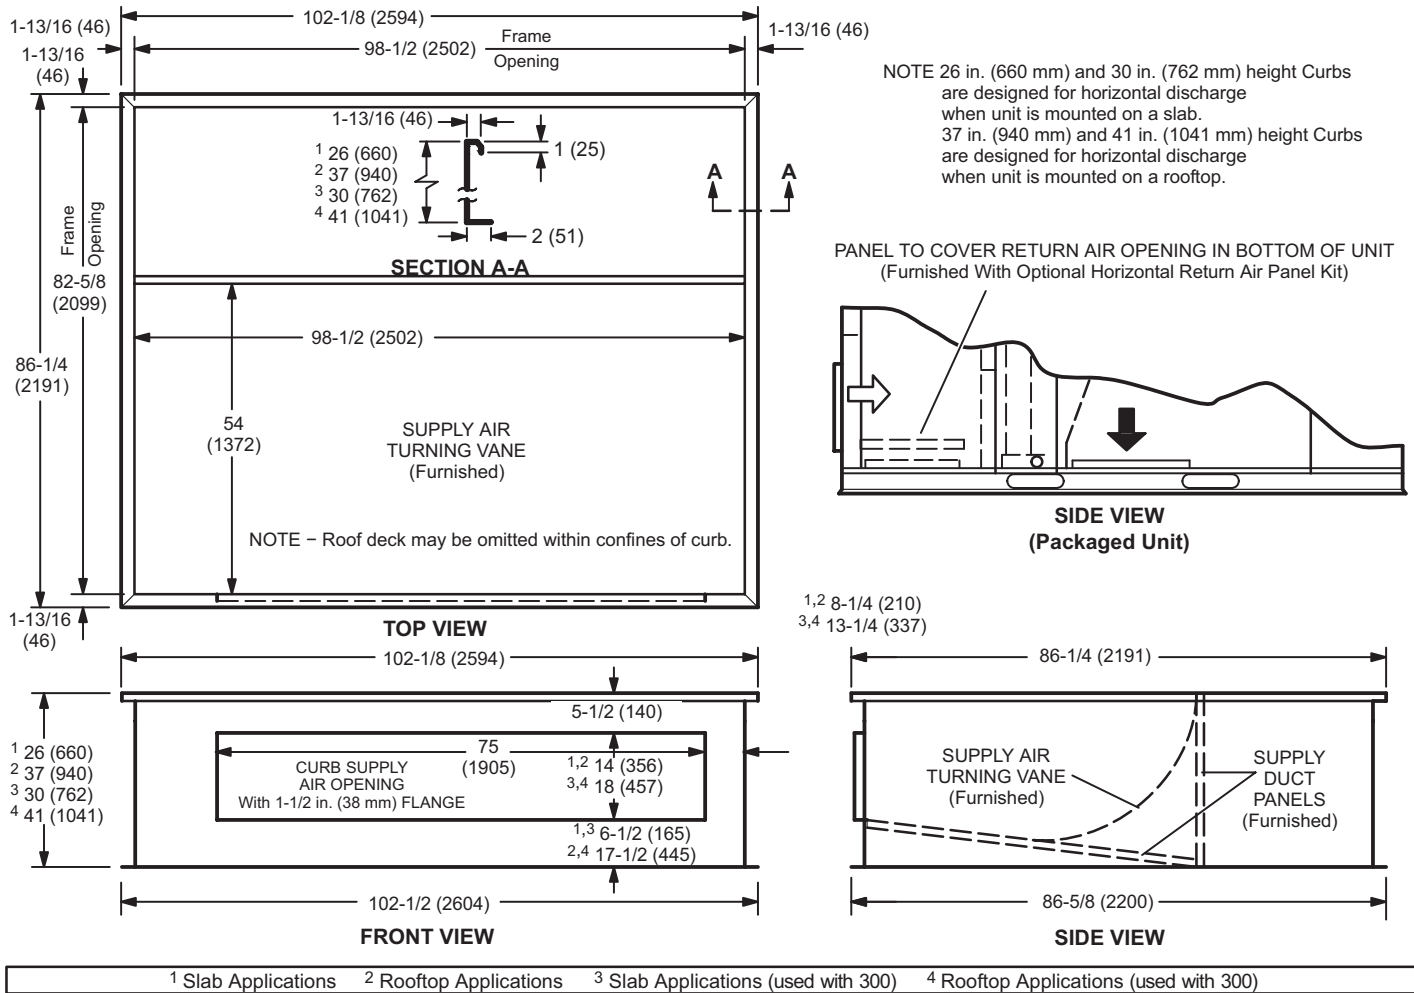


**HORIZONTAL SUPPLY AND RETURN AIR OPENINGS WITH HORIZONTAL ROOF CURB**

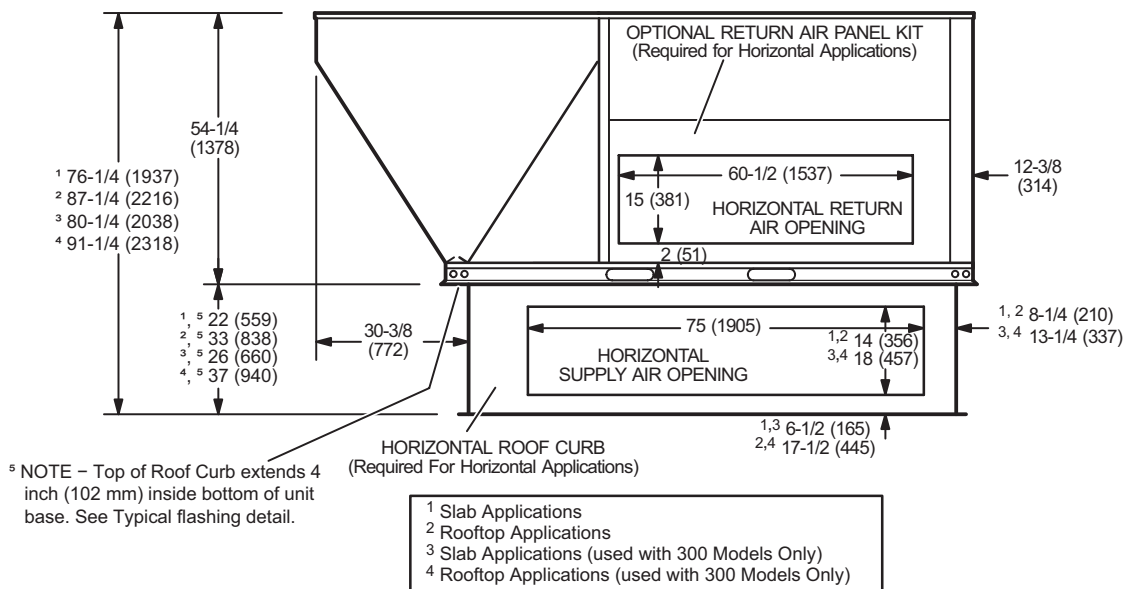


**COMBINATION CEILING SUPPLY AND RETURN DIFFUSERS**

**STEP-DOWN CEILING DIFFUSER**

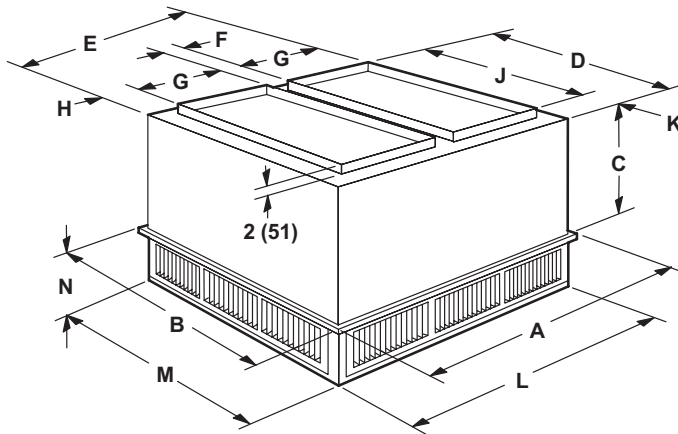

**FLUSH CEILING DIFFUSER**

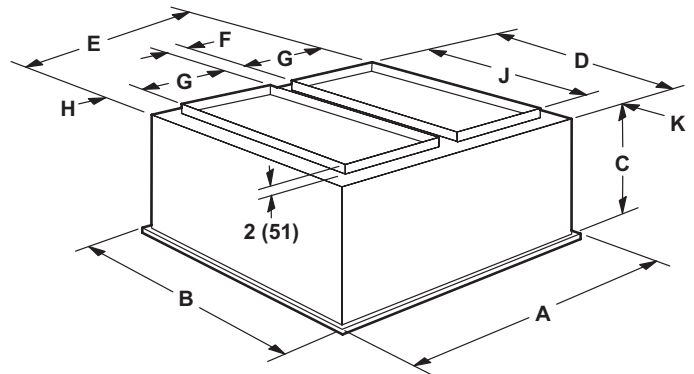

Model		RTD11-185S	RTD11-275
A	in.	47-5/8	59-5/8
	mm	1210	1514
B	in.	47-5/8	59-5/8
	mm	1210	1514
C	in.	24-5/8	30-5/8
	mm	625	778
D	in.	45-1/2	57-1/2
	mm	1156	1461
E	in.	45-1/2	57-1/2
	mm	1156	1461
F	in.	4-1/2	4-1/2
	mm	114	114
G	in.	18	24
	mm	457	610
H	in.	2-1/2	2-1/2
	mm	64	64
J	in.	36	48
	mm	914	1219
K	in.	4-3/4	4-3/4
	mm	121	121
L	in.	45-1/2	57-1/2
	mm	1156	1461
M	in.	45-1/2	57-1/2
	mm	1156	1461
N	in.	10-1/8	11-1/8
	mm	257	283
Duct Size	in.	18 x 36	24 x 48
	mm	457 x 914	610 x 1219

Model		FD11-185S	FD11-275
A	in.	47-5/8	59-5/8
	mm	1210	1514
B	in.	47-5/8	59-5/8
	mm	1210	1514
C	in.	29-1/4	35-1/4
	mm	743	895
D	in.	45	57
	mm	1143	1148
E	in.	45	57
	mm	1143	1448
F	in.	4-1/2	4-1/2
	mm	114	114
G	in.	18	24
	mm	457	610
H	in.	2-1/4	2-1/4
	mm	57	57
J	in.	36	48
	mm	914	1219
K	in.	4-1/2	4-1/2
	mm	114	114
Duct Size	in.	18 x 36	24 x 48
	mm	457 x 914	610 x 1219





## REVISIONS

Sections	Description of Change
Options/Accessories	Added Dehumidification reheat option.



Intertek



**ALLIED**<sup>TM</sup>  
Commercial

Visit us at [www.allied-commercial.com](http://www.allied-commercial.com)

For the latest technical information, visit us at [www.allied-commercial.com](http://www.allied-commercial.com)

Contact us at 1-800-448-5872

NOTE - Due to Allied Commercial ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

©2025 Allied Air Enterprises LLC, a Lennox International Inc. Company