


26 to 44 kW

Net Cooling Capacity - 23.6 to 36.5 kW (80 600 to 127 700 Btuh)


Net Heating Capacity - 23.3 to 36.3 kW (79 500 to 124 000 Btuh)

Optional Electric Heat - 5.7 to 45.9 kW

MODEL NUMBER IDENTIFICATION

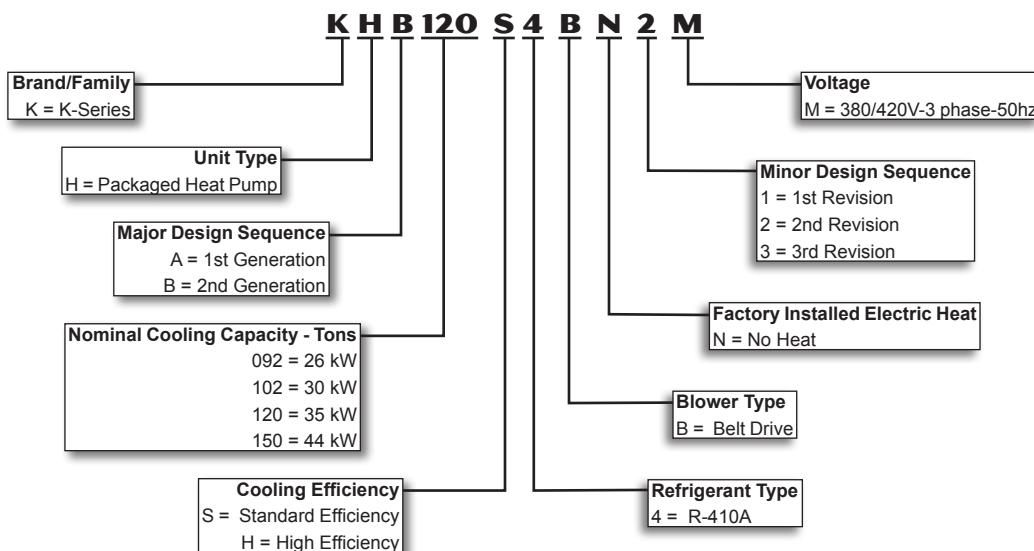

FEATURES AND BENEFITS

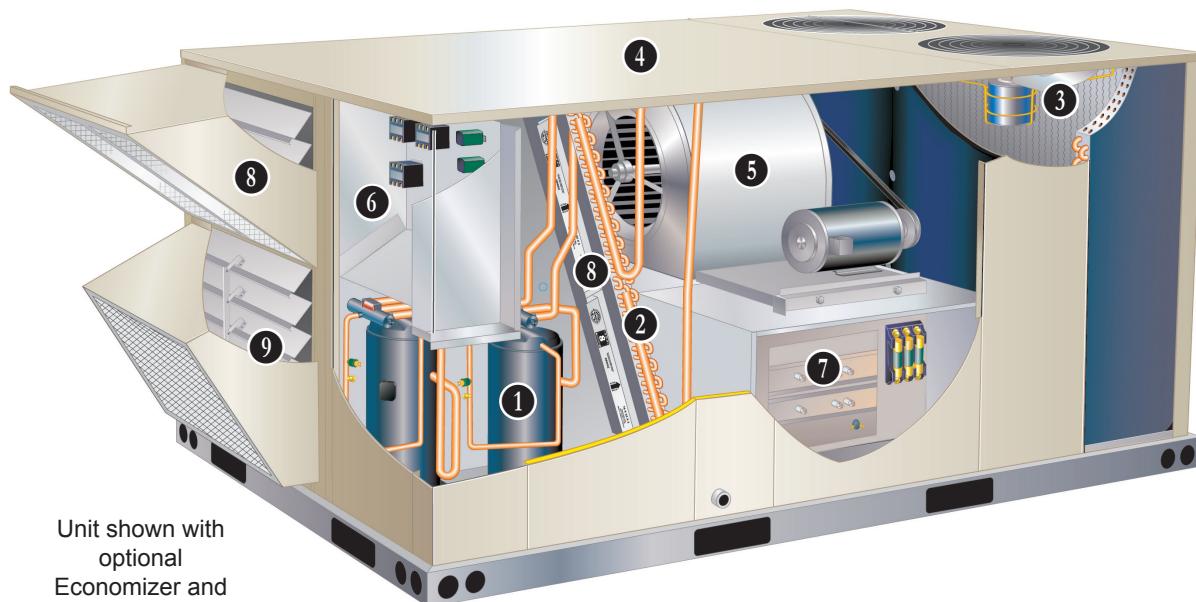

K-Series™ rooftop units from Allied are the new standard for reliable, efficient rooftop units built for long-lasting performance that can significantly improve indoor environments. K-Series™ rooftop units feature:

- **R-410A Refrigerant** - Environmentally friendly
- **Scroll Compressors** - Single speed scroll compressors are furnished on all models.
- **High Pressure Switches** - Protect compressor.
- **Isolated Compressor Compartment** - Allows performance check during normal compressor operation without disrupting airflow.
- **Independent Motor Mounts** - Allows for easy and efficient service access without removing the top panel.
- **Downflow or Horizontal Airflow** - Easy field conversion.
- **Two Fork Lift Slots on Three Sides** - Easy to pick up and transport units from almost any angle.
- **Corrosion-Resistant Removable, Reversible Drain Pan** - Provides application flexibility, durability and improved serviceability.
- **Thermostatic Expansion Valves** - Provide peak cooling performance across the entire application range.
- **MERV 8 or MERV 13 Filters** - Available as field installed option, provide an enhanced level of indoor air quality, and can help the building qualify for additional Leadership in Energy and Environmental Design (LEED) credits.
- **Common Components** - Many maintenance items are standard throughout the entire product line, reducing the need to carry different parts to the job or maintain in inventory.

FEATURES AND BENEFITS

CONTENTS

Blower Data - Belt Drive - Standard Efficiency	19
Cooling / Heating Ratings - High Efficiency	17
Cooling / Heating Ratings - Standard Efficiency	13
Dimensions - Accessories	30
Dimensions - Unit	28
Electrical/Electric Heat Data - High Efficiency	24
Electrical/Electric Heat Data - Standard Efficiency	23
Electric Heat Capacities	25
Features And Benefits	2
Options / Accessories	8
Outdoor Sound Data	25
Specifications- High Efficiency	12
Specifications- Standard Efficiency	11
Unit Clearances	25
Weight Data	27

PERFORMANCE / QUALITY

Components bonded for grounding to meet safety standards for servicing required by Underwriters Laboratories (UL) and the International Electrotechnical Commission (IEC).

Cooling performance is rated at test conditions included in Air- Conditioning, Heating and Refrigeration Institute (AHRI) Standard 340/360-2007 while operating at rated voltage and air volumes.

International Organization for Standardization (ISO) 9001 Registered Manufacturing Quality System.

CE MARK OPTION (KHA Models Only)

The CE mark has been added to our rooftop product line as a configure to order (CTO) option. This optional construction allows units to be sold into countries requiring CE marking for rooftop products.

CE marked units meet the requirements of the Machinery Directive 2006/42/EC, Low Voltage Directive 73/23/EEC, EMC Directive 89/336/EEC, and Gas Directive 90/396/EEC. Declaration of conformity certificates will be provided for each CE marked unit on demand.

Key features of this option over and above standard product features are:

Touch-proof electrical components meeting the requirements of EN 60529.

Branch circuits over 0.5 kW load have overcurrent protection.

Rotary style/finger safe disconnect switch with locking handle prevents disconnect door from being opened with the power on. Padlock can be applied to lock the disconnect switch in the OFF position.

The factory wiring has been redesigned for separation of high and low voltage circuits.



COOLING/HEATING SYSTEM

Designed to maximize sensible and latent cooling performance at design conditions.

System can operate in the cooling mode from 1°C to 52°C without any additional controls.

R-410A Refrigerant

Non-chlorine based, ozone

1 Scroll Compressors

Scroll compressors on all models for high performance, reliability and quiet operation.

Resiliently mounted on rubber grommets for quiet operation.

Compressor Crankcase Heaters

Protects against refrigerant migration that can occur during low ambient operation.

Check/THERMAL EXPANSION Valves

Assures optimal performance throughout the application range.

Removable element head.

Reversing Valves

4-way interchange reversing valve effects a rapid change in direction of refrigerant flow resulting in quick changeover from cooling to heating and vice versa.

Filter/Driers

High capacity filter/drier protects the system from dirt and moisture.

High Pressure Switches

Protects the compressor from overload conditions such as dirty condenser coils, blocked refrigerant flow, or loss of outdoor fan operation. Auto-reset.

Freezestats

Protects the evaporator coil from damaging ice build-up due to conditions such as low/no airflow, or low refrigerant charge.

2 Coil Construction

Copper tube construction, enhanced rippled-edge aluminum fins, flared shoulder tubing connections, silver soldered construction for improved heat transfer. Factory leak tested.

COOLING/HEATING SYSTEM

FEATURES AND BENEFITS

(continued)

Indoor Coil

Cross row circuiting with rifled copper tubing optimizes both sensible and latent cooling capacity.

Condenser Coil

Two independent formed coils allow separation for cleaning.

Condensate Drain Pan

Plastic pan, sloped to meet drainage requirements of American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE) 62.1.

Side or bottom drain connections. Reversible to allow connection at back of unit.

Outdoor Coil Fan Motors

High efficiency models have variable speed (ECM) fan motors for energy efficient operation and quiet operation.

Standard efficiency models have single speed PSC fan motors.

Thermal overload protected, totally enclosed, permanently lubricated sleeve (standard) ball bearings (high), shaft up, wire basket mount

3 Outdoor Coil Fans

Polyvinyl Chloride (PVC) coated fan guard furnished.

Required Selections

Cooling Capacity

Specify nominal cooling capacity of the unit

Options / Accessories

Field Installed

Condensate Drain Trap

Available in copper or polyvinyl chloride (PVC).

Drain Pan Overflow Switch

Monitors condensate level in drain pan, shuts down unit if drain becomes clogged.

Low Ambient Kit

Designed for use in ambient temperatures no lower than -17°C. Cycles the outdoor fans while allowing compressor operation in the cooling cycle. Includes field installed pressure switches on

the liquid line to determine when to operate the outdoor fans. This intermittent fan operation allows the system to operate without icing the evaporator coil and losing capacity.

Standard Efficiency Models - If the liquid line pressure drops below 1.66 Pa all outdoor fans stop until main pressure switches have reset to 3.1 Pa to resume normal cooling operation.

High Efficiency Models - If the liquid line pressure drops below 1.66 Pa outdoor fans operate at 25% normal fan speed. If pressure drops below 1.24 Pa all outdoor fans stop until pressure rises to 2.07 Pa, then fans operate at 25% normal fan speed unless main pressure switches have reset to 3.1 Pa to resume normal cooling operation and full fan speed operation.

CABINET

4 Construction

Heavy-gauge steel panels and full perimeter heavy-gauge galvanized steel base rail provides structural integrity for transportation, handling, and installation.

Base rails have rigging holes.

Three sides of the base rail have forklift slots.

Raised edges around duct and power entry openings in the bottom of the unit provide additional protection against water entering the building.

Airflow Choice

Units are shipped in downflow (vertical) configuration, can be field converted to horizontal airflow with optional Horizontal Discharge Kit.

Duct Flanges

Provided for horizontal duct attachment.

Power Entry

Electrical lines can be brought through the unit base or through horizontal access knock-outs.

Exterior Panels

Constructed of heavy-gauge, galvanized steel with a two-layer enamel paint finish.

Insulation

All panels adjacent to conditioned air are fully insulated with non-hygroscopic fiberglass insulation.

Unit base is fully insulated in conditioned area. The insulation also serves as an air seal to the roof curb, eliminating the need to add a seal during installation.

Access Panels

Access panels are provided for the filter section, heating/blower section, and the compressor/controls section.

Options / Accessories

Factory Installed

Corrosion Protection

A completely flexible immersed coating with an electrodeposited dry film process (AST ElectroFin E-Coat). Meets Mil Spec MIL-P-53084, ASTM B117. Standard Method Salt Spray Testing.

Indoor Corrosion Protection:

- Coated coil
- Painted blower housing
- Painted base

Outdoor Corrosion Protection:

- Coated coil
- Painted base

Hinged Access Panels

Large access panels are hinged and have quarter-turn latches for quick and easy access to maintenance areas (filter, compressor / controls, heating / blower).

Field Installed

Combination Coil/Hail Guards

Heavy gauge steel frame painted to match cabinet with expanded metal mesh to protect the outdoor coil from damage.

Horizontal Discharge Kit

Consists of duct covers to block off downflow supply and return air openings for horizontal applications.

Also includes return air duct flanges for end return air when economizer is used in horizontal applications.

FEATURES AND BENEFITS

CABINET (continued)

NOTE - When configuring unit for horizontal application with economizer, a separate Horizontal Barometric Relief Damper with Hood must be ordered separately for installation in the return air duct.

Return Air Adaptor Plate

For same size LC/LG/LH and TC/TG/TH unit replacement.

Installs on return air opening in unit to match return air opening on existing roof curbs. Also see Accessory Air Resistance table.

5 BLOWER

A wide selection of supply air blower options are available to meet a variety of airflow requirements.

Motor

Overload protected, equipped with ball bearings. Belt drive motors are offered on all models and are available in several different sizes to maximize air performance.

Supply Air Blower

Forward curved blades, double inlet, blower wheel is statically and dynamically balanced. Equipped with ball bearings and adjustable pulley (allows speed change).

Blower assembly slides out of unit for servicing.

Required Selections

Order blower motor horsepower and drive kit number required when base unit is ordered, see Drive Kit Specifications Table.

CONTROLS

6 Unit Control

All control voltage is provided via a 24V (secondary) transformer with built-in circuit breaker protection.

Heat/Cool Staging - Capable of up to 2 heat / 2 cool staging with a third party DDC control system or thermostat.

Low Voltage Terminal Block - Provides screw terminal connections for thermostat or controller wiring.

Night Setback Mode - Saves energy by closing outdoor air dampers and operating supply fan on thermostat demand only.

Defrost Control

Provides a defrost cycle, if needed, every 30 or 60 or 90 minutes (adjustable) of compressor on" time at outdoor coil temperature below 1.6°C. Temperature switch mounted on outdoor coil liquid line terminates defrost cycle.

Fan Control (High Efficiency Models Only)

Provides variable speed control. Outdoor fan motor speed will vary depending on full or part load applications.

Options / Accessories

Field Installed

Smoke Detector

Photoelectric type, installed in supply air section, return air section or both sections. Available with power board and single sensor (supply or return) or power board and two sensors (supply and return).

Commercial Control Systems

Aftermarket unit controller options, see Options/Accessories table.

ELECTRICAL

Required Selections

Voltage

Specify when ordering base unit.

Options / Selections

Field Installed

7 Electric Heat

Electric heat is CE marked.

Helix wound nichrome elements, individual element limit controls, wiring harness. Unit fuse block is furnished as standard. See Options / Accessories tables for ordering information.

INDOOR AIR QUALITY

8 Air Filters

Disposable 51 mm filters furnished as standard.

Options / Accessories

Field Installed

High Efficiency Air Filter

Disposable MERV 8 or MERV 13 (Minimum Efficiency Reporting Value based on ASHRAE 52.2) efficiency 51 mm pleated filters.

Replacement Filter Media Kit With Frame

Replaces existing pleated filter media. Includes washable metal mesh screen and metal frame with clip for holding replaceable non-pleated filter.

UVC Germicidal Lamps



Germicidal lamps emit ultra-violet (UV-C) energy, which has been proven to be effective in reducing microbes such as viruses, bacteria, yeasts, and molds. This process either destroys the organism or controls its ability to reproduce.

UV-C energy greatly reduces the growth and proliferation of mold and other bioaerosols (bacteria and viruses) on illuminated surfaces (particularly coil and drain pan).

Lamps are field installed in the blower/evaporator coil section.

All necessary hardware for installation is included.

Lamps operate on 220V single-phase power supply. Step-down transformer may be ordered separately for 380/420V primary to 220V secondary units. Alternately, 220V power supply may be used to directly power the UVC ballast(s).

Magnetic safety interlock terminates power when access panels are removed.

Approved by ETL.

Indoor Air Quality (CO₂) Sensors

Monitors CO₂ levels, reports to the Unit Controller which adjusts economizer dampers as needed.

ECONOMIZER OPTIONS

OPTIONS / ACCESSORIES

Factory or Field Installed

9 Economizer Features (Standard and High Performance Common Features)

Downflow or Horizontal with Outdoor Air Hood and Barometric Relief Dampers with Exhaust Hood.

10 Barometric Relief Dampers

allow relief of excess air, aluminum blade dampers prevent blow back and outdoor air infiltration during off cycle, bird screen furnished.

NOTE - Optional Horizontal Low Profile Barometric Relief Dampers with Exhaust Hood are available for field installation in a reduced space.

Occupied/Unoccupied mode with field furnished setback thermostat.

Demand Control Ventilation (DCV) ready using optional CO₂ sensors.

Mixed Air Sensor is furnished for field installation in the rooftop unit. Sensor is factory installed when Economizers are factory installed.

Single sensible sensor is furnished with Economizer and enables economizer operation if the outdoor temperature is less than the setpoint of the control.

Standard Economizer Features
Gear-driven action, return air and outdoor air dampers, plug-in connections to unit, nylon bearings, neoprene seals, 24-volt, fully-modulating spring return motor.

Standard Economizer Control Module

The Standard Economizer Control Module can be adjusted to operate based on outdoor air temperatures.



Economizer Controls:

- Damper Minimum Position - Can be set lower than traditional minimum air requirements resulting in cost savings.
- IAQ Sensor - Signals dampers to modulate and maintain 13°C when CO₂ is higher than the CO₂ setpoint.
- Demand Control Ventilation (DCV) LED - A steady green Demand Control Ventilation LED indicates the IAQ reading is higher than setpoint and requires more fresh air.
- Free Cool LED - A steady green LED indicates outdoor air is suitable for free cooling.

Free Cooling runs when outdoor air temperature is lower than the set temperature on the economizer control.

NOTE: The Free Cooling default setting for outdoor air temperature sensor is 13°C.

High Performance Economizer Features

Gear-driven action, high torque 24-volt fully-modulating spring return damper motor, return air and outdoor air dampers, plug-in connections to unit, stainless steel bearings, enhanced neoprene blade edge seals and flexible stainless steel jamb seals to minimize air leakage.

High Performance Economizer Control Module

Module provides inputs and outputs to control economizer based on parameter settings. Module automatically detects sensors by polling to determine which sensors are installed in system.



Module displays any alarm messages (fault detection and diagnostics) as an aid in troubleshooting.

Non-volatile memory retains parameter settings in case of power failure.

Keypad with four navigation buttons and LCD screen is furnished for setting economizer parameters.

- Menu Up/Exit button returns to the main menu.
- Arrow Up button moves to the previous or next parameter within the selected menu.
- Arrow Down button moves to the next parameter within the selected menu.
- Select (enter) button confirms parameter selection.

Main Menu Structure:

- STATUS (economizer and system operation status)
- SETPOINTS (settings for various setpoint parameters)
- SYSTEM SETUP (settings/information about the system)
- ADVANCED SETUP (freeze protection, CO₂ settings, stage 3 delay and additional calibration settings)
- CHECKOUT (damper positions)
- ALARMS (output signal that can be configured for remote alarm monitoring)

Refer to Installation Instructions for complete setup information and menu parameters available.

OPTIONS / ACCESSORIES

ECONOMIZER OPTIONS (continued)

Factory or Field Installed

Single Enthalpy Temperature Control

Outdoor air enthalpy sensor enables economizer if the outdoor enthalpy is less than the setpoint of the control. Single enthalpy control is furnished with economizer.

Field Installed

Differential Enthalpy Control

Order two Single Enthalpy Control Kits. One is field installed in the return air section, the other in the outdoor air section. Allows the economizer control board to select between outdoor air or return air, whichever has lower enthalpy.

EXHAUST OPTIONS

Field Installed

Horizontal Low Profile

Barometric Relief Dampers

Replaces barometric relief dampers furnished with Economizer.

For use when unit is configured for horizontal applications in a reduced space requiring an economizer.

Allows relief of excess air.

Aluminum blade dampers prevent blow back and outdoor air infiltration during off cycle.

Field installed in return air duct.

Exhaust hood with bird screen furnished.

Requires Horizontal Discharge Kit.

Power Exhaust Fan

Installs internal to unit for downflow applications only with economizer option. Provides exhaust air pressure relief. Interlocked to run when supply air blower is operating, fan runs when outdoor air dampers are 50% open (adjustable), motor is overload protected. Requires Economizer with Outdoor Air Hood and Barometric Relief Dampers. Fan is 508 mm diameter with 5 blades (K1PWRE10B) with 0.25 kW motor.

OUTDOOR AIR OPTIONS

Factory or Field Installed

Outdoor Air Damper - Downflow or Horizontal With Air Hood

Linked mechanical dampers, 0 to 25% (fixed) outdoor air adjustable, installs in unit. Includes outdoor air hood.

Automatic model features fully modulating spring return damper motor with plug-in connection.

Manual model features a slide damper.

Maximum mixed air temperature in cooling mode: 38°C.

ROOF CURBS

Nailer strip furnished, mates to unit, U.S. National Roofing Contractors Approved, shipped knocked down.

Hybrid Roof Curbs, Downflow

Roof curb can be assembled using interlocking tabs to fasten corners together. No tools required.

Curb can also be fastened together with furnished hardware.

Available in 203, 356, 457, and 610 mm heights.

Adjustable Pitch Curb

Fully adjustable pitch curb provides a level platform for rooftop units allowing flexible installations on roofs with uneven or sloped angles.

Maximum slope is 19 mm per 300 mm in any direction.

Uses interlocking tabs to fasten corners together. No tools required.

Hardware is furnished to connect upper curb with lower curb.

Available in 356 mm height.

Adaptor Curbs (not shown)

Curbs are regionally sourced. Dimensions will vary based upon the source. Contact your local sales representative for a detailed cut sheet with applicable dimensions.

CEILING DIFFUSERS

Ceiling Diffusers (Flush or Step-Down)

Aluminum grilles, large center grille, insulated diffuser box with flanges, hanging rings furnished, interior transition (even air flow), internally sealed (prevents recirculation), adapts to T-bar ceiling grids or plaster ceilings.

Transitions (Supply and Return)

Used with diffusers, installs in roof curb, galvanized steel construction, flanges furnished for duct connection to diffusers, fully insulated.

OPTIONS / ACCESSORIES

Item Description	Model Number	Catalog Number	Unit Model No			
			KHA	KHA	KHA	KHA
			092	102	120	150
CE MARK						
CE Marked Unit		Factory	X	O	O	O
COOLING SYSTEM						
Condensate Drain Trap	Polyvinyl Chloride (PVC) - C1TRAP20AD2	76W26	X	X	X	X
	Copper - C1TRAP10AD2	76W27	X	X	X	X
Corrosion Protection		Factory	O	O	O	O
Drain Pan Overflow Switch	K1SNSR71AB1-	74W42	X	X	X	X
Efficiency		Standard	O	O	O	O
		High	O	O		
Low Ambient Kit	Standard Efficiency - K1SNSR33B-1	54W16	X	X	X	X
	High Efficiency - K1SNSR34*B0	14N31	X	X		
Refrigerant Type	R-410A		O	O	O	O
BLOWER - SUPPLY AIR						
Motors	Belt Drive - 1.5 kW (2 hp)	Factory	O	O	O	O
	Belt Drive - 2.2 kW (3 hp)	Factory	O	O	O	O
	Belt Drive - 3.7 kW (5 hp)	Factory	O	O	O	O
Drive Kits	Kit #1 490-740 rev/min	Factory	O	O	O	O
See Blower Data Tables for selection	Kit #2 665-920 rev/min	Factory	O	O	O	O
	Kit #3 660-995 rev/min	Factory	O	O	O	O
	Kit #7 610-810 rev/min	Factory	O	O	O	O
	Kit #8 780-1000 rev/min	Factory	O	O	O	O
	Kit #9 845-1085 rev/min	Factory	O	O	O	O
	Kit #10 750-945 rev/min	Factory	O	O	O	O
	Kit #11 865-1095 rev/min	Factory	O	O	O	O
	Kit #12 940-1190 rev/min	Factory	O	O	O	O
CABINET						
Combination Coil/Hail Guards	Standard Efficiency - K1GARD51BS1	13T24	X	X	X	
	Standard Efficiency - K1GARD51BP1	13T25				X
	High Efficiency - K1GARD53B-1	14Y77	X	X		
Hinged Access Panels		Factory	O	O	O	O
Horizontal Discharge Kit	K1HECK00B-1	51W25	X	X	X	X
Return Air Adaptor Plate (for LC/LG/LH and TC/TG/TH unit replacement)	C1CONV10B-1	54W96	X	X	X	X
CONTROLS						
BACnet®	K0CTRL31B-1	96W15	OX	OX	OX	OX
BACnet® Thermostat with Display	K0SNSR01FF1	97W23	X	X	X	X
BACnet® Thermostat without Display	K0SNSR00FF1	97W24	X	X	X	X
Novar® 2051	K0CTRL30B-1	96W12	OX	OX	OX	OX
Plenum Cable - 23 m	K0MISC00FF1	97W25	X	X	X	X
Smoke Detector - Supply or Return (Power board and one sensor)	C1SNSR44B-2	11K76	X	X	X	X
Smoke Detector - Supply and Return (Power board and two sensors)	C1SNSR43B-2	11K80	X	X	X	X

¹ Available for KHA Models only.

NOTE - Catalog and model numbers shown are for ordering field installed accessories.

OX - Configure To Order (Factory Installed) or Field Installed

O = Configure To Order (Factory Installed)

X = Field Installed

OPTIONS / ACCESSORIES

Item Description	Model Number	Catalog Number	Unit Model No			
			KHA	KHA	KHA	KHA
			KHB	KHB	092	102

INDOOR AIR QUALITY

Air Filters

High Efficiency Air Filters 208 x 635 x 51 mm (Order 4 per unit)	MERV 8 - C1FLTR15B-1 MERV 13 - C1FLTR40B-1	50W61 52W41	X	X	X	X
Replacement Media Filter With Metal Mesh Frame (includes non-pleated filter media)	C1FLTR30B-1-	Y3063	X	X	X	X

Indoor Air Quality (CO₂) Sensors

Sensor - Wall-mount, off-white plastic cover with LCD display 208 x 635 x 51 mm (Order 4 per unit)	C0SNSR50AE1L	77N39	X	X	X	X
Sensor - Wall-mount, off-white plastic cover, no display	C0SNSR52AE1L	87N53	X	X	X	X
Sensor - Black plastic case with LCD display, rated for plenum mounting	C0SNSR51AE1L	87N52	X	X	X	X
Sensor - Wall-mount, black plastic case, no display, rated for plenum mounting	C0MISC19AE1	87N54	X	X	X	X
CO ₂ Sensor Duct Mounting Kit - for downflow applications	C0MISC19AE1-	85L43	X	X	X	X
Aspiration Box - for duct mounting non-plenum rated CO ₂ sensors (87N53 or 77N39)	C0MISC16AE1-	90N43	X	X	X	X

UVC Germicidal Lamps

¹ UVC Light Kit (220V-1ph)	C1UVCL10B-1	54W62	X	X	X	X
---------------------------------------	-------------	-------	---	---	---	---

ELECTRICAL

Voltage 50 hz with neutral (No neutral on CE marked models)	380/420V - 3 phase	Factory	O	O	O	O
---	--------------------	---------	---	---	---	---

² ELECTRIC HEAT

5.7 kW	380/420V-3ph - C1EH0057B-1M	68W04	X	X		
11.5 kW	380/420V-3ph - C1EH0115B-1M	68W05	X	X	X	X
17.2 kW	380/420V-3ph - C1EH0172B-1M	68W06	X	X	X	X
23 kW	380/420V-3ph - C1EH0230B-1M	68W07	X	X	X	X
34.5 kW	380/420V-3ph - C1EH0345B-1M	68W08	X	X	X	X
45.9 kW	380/420V-3ph - C1EH0459B-1M	68W09			X	X

¹ Lamps operate on 220V single-phase power supply. Step-down transformer may be ordered separately for 380/420V primary to 220V secondary units. Alternately, 220V power supply may be used to directly power the UVC ballast(s).

² Nominal kW at 420V-3ph-50hz.

NOTE - Catalog and model numbers shown are for ordering field installed accessories.

OX - Configure To Order (Factory Installed) or Field Installed

O = Configure To Order (Factory Installed)

X = Field Installed

OPTIONS / ACCESSORIES

Item Description	Model Number	Catalog Number	Unit Model No					
			KHA	KHA	KHA	KHA		
			092	102	120	150		
ECONOMIZER								
Standard Economizer								
Standard Economizer with Single Temperature Control Downflow or Horizontal Applications - Includes Barometric Relief Dampers and Air Hoods	K1ECON20B-2	13U45	OX	OX	OX	OX		
Standard Economizer Controls								
Single Enthalpy Control	C1SNSR64FF1	53W64	OX	OX	OX	OX		
Differential Enthalpy Control (order 2)	C1SNSR64FF1	53W64	X	X	X	X		
High Performance Economizer								
High Performance Economizer with Single Temperature Control Downflow or Horizontal Applications - Includes Barometric Relief Dampers and Air Hoods	K1ECON22B-1	10U58	OX	OX	OX	OX		
High Performance Economizer Controls								
Single Enthalpy Control	C1SNSR60FF1	10Z75	OX	OX	OX	OX		
Differential Enthalpy Control (order 2)	C1SNSR60FF1	10Z75	X	X	X	X		
Horizontal Barometric Relief Dampers With Exhaust Hood								
Horizontal Barometric Relief Dampers - Exhaust Hood Furnished	LAGEDH03/15	53K04	X	X	X	X		
OUTDOOR AIR								
Outdoor Air Dampers with Outdoor Air Hood								
Motorized	C1DAMP20B-1	14G28	OX	OX	OX	OX		
Manual	C1DAMP10B-2	14G29	OX	OX	OX	OX		
POWER EXHAUST								
Standard Static	380/420V-3ph - K1PWRE10B-1G		53W45	X	X	X		
ROOF CURBS								
Hybrid Roof Curbs, Downflow								
203 mm height	C1CURB70B-1	11F54	X	X	X	X		
356 mm height	C1CURB71B-1	11F55	X	X	X	X		
457 mm height	C1CURB72B-1	11F56	X	X	X	X		
610 mm height	C1CURB73B-1	11F57	X	X	X	X		
Adjustable Pitch Curb								
356 mm height	C1CURB55B-1	54W50	X	X	X	X		
CEILING DIFFUSERS								
Step-Down - Order one	RTD11-95S	13K61	X					
	RTD11-135S	13K62		X	X			
	RTD11-185S	13K63				X		
Flush - Order one	FD11-95S	13K56	X					
	FD11-135S	13K57		X	X			
	FD11-185S	13K58				X		
Transitions (Supply and Return) - Order one	C1DIFF30B-1	12X65	X					
	C1DIFF31B-1	12X66		X	X			
	C1DIFF32B-1	12X67				X		

NOTE - Catalog and model numbers shown are for ordering field installed accessories.

OX - Configure To Order (Factory Installed) or Field Installed

O = Configure To Order (Factory Installed)

X = Field Installed

SPECIFICATIONS- STANDARD EFFICIENCY

General Data		Nominal kW (Tons)	26 (7.5)	30 (8.5)	35 (10)	44 (12.5)
		Model Number	KHA092S4B	KHA102S4B	KHA120S4B	KHA150S4B
		Efficiency Type	Standard	Standard	Standard	Standard
		Blower Type	Constant Air Volume CAV	Constant Air Volume CAV	Constant Air Volume CAV	Constant Air Volume CAV
Cooling Performance	Gross Cooling Capacity - kW (Btuh)	23.3 (79 500)	26.2 (89 400)	31.5 (107 500)	37 (126 400)	
	¹ Net Cooling Capacity - kW (Btuh)	22.6 (77 000)	25.2 (86 100)	30.4 (103 900)	34.9 (119 400)	
	AHRI Rated Air Flow - L/s (cfm)	1415 (3000)	1605 (3400)	1700 (3600)	2124 (4500)	
	Total Unit Power - kW	6.9	7.7	9.3	11.2	
	¹ EER (Btuh/Watt)	11.2	11.2	11.2	10.7	
	² IEER (Btuh/Watt)	12.2	12.2	11.3	10.7	
	Refrigerant Type	R-410A	R-410A	R-410A	R-410A	
	Refrigerant Charge Furnished	Circuit 1 5.7 kg (12 lbs. 8 oz.)	Circuit 1 6.1 kg (13 lbs. 8 oz.)	Circuit 1 6.8 kg (15 lbs. 0 oz.)	Circuit 1 10 kg (22 lbs. 0 oz.)	
		Circuit 2 5.4 kg (12 lbs. 0 oz.)	Circuit 2 5.9 kg (13 lbs. 0 oz.)	Circuit 2 6.8 kg (15 lbs. 0 oz.)	Circuit 2 10.4 kg (23 lbs. 0 oz.)	
Heating Performance	¹ Total High Heat Capacity - kW (Btuh)	23.3 (79 500)	26.1 (89 100)	30.4 (103 900)	36.3 (124 000)	
	Total Unit Power - kW	6.7	7.5	8.8	10.9	
	¹ Coefficient of Performance	3.5	3.5	3.5	3.3	
	¹ Total Low Heat Capacity - kW (Btuh)	13.9 (47 300)	14.6 (49 000)	18.8 (64 100)	21.6 (73 700)	
	Total Unit Power (kW)	5.9	6.2	8.1	10.3	
	¹ Coefficient of Performance	2.33	2.33	2.32	2.10	
Electric Heat Available - See page 9		5.7, 11.5, 17.2, 23, 34.5 KW		11.5, 17.2, 23, 34.5, 45.9 KW		
Compressor Type (number)		Scroll (2)	Scroll (2)	Scroll (2)	Scroll (2)	
Outdoor Coils	Net face area (total) - m ² (sq. ft.)	2.68 (28.8)	2.68 (28.8)	2.68 (28.8)	3.79 (40.8)	
	Tube diameter - mm (in.)	9.5 (3/8)	9.5 (3/8)	9.5 (3/8)	9.5 (3/8)	
	Number of rows	2	2	3	3	
	Fins per m (inch)	787 (20)	787 (20)	787 (20)	787 (20)	
Outdoor Coil Fans	Motor - (No.) horsepower	(2) 249 (1/3)	(2) 373 (1/2)	(2) 373 (1/2)	(3) 249 (1/3)	
	Motor rev/min	896	896	896	896	
	Total Motor watts	508	592	616	879	
	Diameter - (No.) mm (in.)	(2) 610 (24)	(2) 610 (24)	(2) 610 (24)	(3) 610 (24)	
	Number of blades	3	3	3	3	
	Total Air volume - L/s (cfm)	3225 (6835)	3380 (7165)	3460 (7335)	4325 (9165)	
Indoor Coils	Net face area (total) - m ² (sq. ft.)	1.19 (12.8)	1.19 (12.8)	1.19 (12.8)	1.19 (12.8)	
	Tube diameter - mm (in.)	9.5 (3/8)	9.5 (3/8)	9.5 (3/8)	9.5 (3/8)	
	Number of rows	3	4	4	4	
	Fins per m (inch)	551 (14)	551 (14)	551 (14)	551 (14)	
		(1) 1 in. NPT coupling				
		Balance port TXV, removable head				
³ Indoor Blower and Drive Selection	Nominal motor kW (HP)	1.5 (2)	1.5 (2)	1.5 (2)	1.5 (2)	
	Maximum usable motor kW (HP)	1.7 (2.3)	1.7 (2.3)	1.7 (2.3)	1.7 (2.3)	
	Kit # and rev/min range	⁴ #1 490 - 740 #2 665 - 920 #3 660 - 995	⁴ #1 490 - 740 #2 665 - 920 #3 660 - 995	#1 490 - 740 #2 665 - 920 #3 660 - 995	#1 490 - 740 #2 665 - 920 #3 660 - 995	#1 490 - 740 #2 665 - 920 #3 660 - 995
	Nominal motor kW (HP)	2.2 (3)	2.2 (3)	2.2 (3)	2.2 (3)	
	Maximum usable motor kW (HP)	2.6 (3.45)	2.6 (3.45)	2.6 (3.45)	2.6 (3.45)	
	Kit # and rev/min range	#7 610 - 810 #8 780 - 1000 #9 845 - 1085	#7 610 - 810 #8 780 - 1000 #9 845 - 1085	⁴ #7 610 - 810 #8 780 - 1000 #9 845 - 1085	#7 610 - 810 #8 780 - 1000 #9 845 - 1085	#7 610 - 810 #8 780 - 1000 #9 845 - 1085
	Nominal motor kW (HP)	3.7 (5)	3.7 (5)	3.7 (5)	3.7 (5)	
	Maximum usable motor kW (HP)	4.3 (5.75)	4.3 (5.75)	4.3 (5.75)	4.3 (5.75)	
	Kit # and rev/min range	#10 750 - 945 #11 865 - 1095 #12 940 - 1190	#10 750 - 945 #11 865 - 1095 #12 940 - 1190	#10 750 - 945 #11 865 - 1095 #12 940 - 1190	#10 750 - 945 #11 865 - 1095 #12 940 - 1190	⁴ #10 750 - 945 #11 865 - 1095 #12 940 - 1190
	Blower wheel nominal diameter x width - mm (in.)	(1) 381 x 381 (15 X 15)	(1) 381 x 381 (15 X 15)	(1) 381 x 381 (15 X 15)	(1) 381 x 381 (15 X 15)	
Filters	Type of filter	Disposable				
	Number and size - in.	(4) 508 x 508 x 51 (20 x 25 x 2)				
Electrical characteristics		380/420V - 50 hertz - 3 phase with neutral (No neutral on CE marked models)				

NOTE - Net capacity includes evaporator blower motor heat deduction. Gross capacity does not include evaporator blower motor heat deduction.

¹ Tested at conditions included in the ULE certification program, which is based on AHRI Standard 340/360 while operating at rated voltage and air volumes:

Cooling Ratings - 35°C (95°F) outdoor air temperature and 27°C (80°F) db/19°C (67°F) wb entering indoor coil air.

High Temperature Heating Ratings - 8°C (47°F) db/6°C (43°F) wb outdoor air temperature and 21°C (70°F) entering indoor coil air.

Low Temperature Heating Ratings - -8°C (17°F) db/-9°C (15°F) wb outdoor air temperature and 21°C (70°F) entering indoor coil air.

² Integrated Energy Efficiency Ratio tested at conditions included in AHRI Standard 340/360 while operating at rated voltage and air volumes.

³ Using total air volume and system static pressure requirements determine from blower performance tables rev/min and motor output required. Maximum usable output of motors furnished are shown. If motors of comparable output are used, be sure to keep within the service factor limitations outlined on the motor nameplate.

⁴ Standard motor and drive kit furnished with unit.

SPECIFICATIONS- HIGH EFFICIENCY

General Data		Nominal kW (Tons)	26 (7.5)	30 (8.5)
		Model Number	KHB092H4B	KHB102H4B
		Efficiency Type	High	High
		Blower Type	Constant Air Volume CAV	Constant Air Volume CAV
Cooling Performance		Gross Cooling Capacity - kW (Btu/h)	23.6 (80 500)	26.5 (90 500)
		¹ Net Cooling Capacity - kW (Btu/h)	22.6 (77 000)	25.5 (87 000)
		AHRI Rated Air Flow - L/s (cfm)	1415 (3 000)	1604 (3 400)
		Total Unit Power - kW	6.2	7.1
		¹ EER (Btuh/Watt)	12.1	12.0
		² IEER (Btuh/Watt)	12.9	12.5
		Refrigerant Type	R-410A	R-410A
		Refrigerant Charge Furnished	Circuit 1 6.12 kg (13.5 lbs.)	6.12 kg (13.5 lbs.)
			Circuit 2 6.12 kg (13.5 lbs.)	5.89 kg (13.0 lbs.)
Heating Performance		¹ Total High Heat Capacity - kW (Btu/h)	22.3 (76 000)	25.5 (87 000)
		Total Unit Power - kW	5.8	6.4
		¹ Coefficient of Performance	3.60	3.60
		¹ Total Low Heat Capacity - kW (Btu/h)	12.9 (44 000)	15.2 (52 000)
		Total Unit Power (kW)	5.5	6.1
		¹ Coefficient of Performance	2.35	2.35
Electric Heat Available - See page 9			5.7, 11.5, 17.2, 23, 34.5 KW	
Compressor Type (number)			Scroll (2)	Scroll (2)
Outdoor Coils		Net face area (total) - m ² (sq. ft.)	2.4 (25.9)	2.4 (25.9)
		Tube diameter - mm (in.)	9.5 (3/8)	9.5 (3/8)
		Number of rows	3	3
		Fins per m (inch)	787 (20)	787 (20)
Outdoor Coil Fans		Motor - (No.) horsepower	(2) 1/3 ECM	(2) 1/3 ECM
		Motor rev/min	530-950	650-1010
		Total Motor watts	140-620	220-700
		Diameter - (No.) mm (in.)	(2) 610 (24)	(2) 610 (24)
		Number of blades	3	3
		Total Air volume - L/s (cfm)	1700-3300 (3600-7000)	2170-3540 (4600-7500)
Indoor Coils		Net face area (total) - m ² (sq. ft.)	1.18 (12.8)	1.18 (12.8)
		Tube diameter - mm (in.)	9.5 (3/8)	9.5 (3/8)
		Number of rows	4	4
		Fins per m (inch)	551 (14)	551 (14)
		Drain connection - Number and size	(1) 1 in. NPT coupling	
		Expansion device type	Balance port TXV, removable head	
³ Indoor Blower and Drive Selection		Nominal motor kW (HP)	1.5 (2)	1.5 (2)
		Maximum usable motor kW (HP)	1.7 (2.3)	1.7 (2.3)
		Kit # and rev/min range	⁴ #1 490 - 740 #2 665 - 920 #3 660 - 995	#1 490 - 740 #2 665 - 920 #3 660 - 995
		Nominal motor kW (HP)	2.2 (3)	2.2 (3)
		Maximum usable motor kW (HP)	2.6 (3.45)	2.6 (3.45)
		Kit # and rev/min range	#7 610 - 810 #8 780 - 1000 #9 845 - 1085	#7 610 - 810 #8 780 - 1000 #9 845 - 1085
		Nominal motor kW (HP)	3.7 (5)	3.7 (5)
		Maximum usable motor kW (HP)	4.3 (5.75)	4.3 (5.75)
		Kit # and rev/min range	#10 750 - 945 #11 865 - 1095 #12 940 - 1190	#10 750 - 945 #11 865 - 1095 #12 940 - 1190
		Blower wheel nominal diameter x width - mm (in.)	(1) 381 x 381 (15 X 15)	(1) 381 x 381 (15 X 15)
Filters		Type of filter	Disposable	
		Number and size - in.	(4) 508 x 508 x 51 (20 x 25 x 2)	
Electrical characteristics			380/420V - 50 hertz - 3 phase with neutral	

NOTE - Net capacity includes evaporator blower motor heat deduction. Gross capacity does not include evaporator blower motor heat deduction.

¹ Tested at conditions included in the ULE certification program, which is based on AHRI Standard 340/360 while operating at rated voltage and air volumes:
Cooling Ratings - 35°C (95°F) outdoor air temperature and 27°C (80°F) db/19°C (67°F) wb entering indoor coil air.

High Temperature Heating Ratings - 8°C (47°F) db/6°C (43°F) wb outdoor air temperature and 21°C (70°F) entering indoor coil air.

Low Temperature Heating Ratings - -8°C (17°F) db/-9°C (15°F) wb outdoor air temperature and 21°C (70°F) entering indoor coil air.

² Integrated Energy Efficiency Ratio tested at conditions included in AHRI Standard 340/360 while operating at rated voltage and air volumes.

³ Using total air volume and system static pressure requirements determine from blower performance tables rev/min and motor output required. Maximum usable output of motors furnished are shown. If motors of comparable output are used, be sure to keep within the service factor limitations outlined on the motor nameplate.

⁴ Standard motor and drive kit furnished with unit.

COOLING / HEATING RATINGS - STANDARD EFFICIENCY

NOTE – For Temperatures and Capacities not shown in tables, see bulletin – Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

26 KW COOLING STANDARD EFFICIENCY KHA092S4 (1ST STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		18.3°C						23.9°C						29.4°C						35°C					
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C				
17.2°C	1135	12.6	1.78	0.64	0.81	1	11.9	2.01	0.65	0.83	1	11.1	2.28	0.66	0.87	1	10.3	2.58	0.67	0.92	1				
	1415	13.3	1.79	0.69	0.93	1	12.5	2.02	0.7	0.96	1	11.7	2.28	0.72	1	1	10.9	2.58	0.75	1	1				
	1700	13.9	1.79	0.75	1	1	13.2	2.02	0.78	1	1	12.4	2.29	0.82	1	1	11.5	2.59	0.87	1	1				
19.4°C	1135	13.5	1.79	0.5	0.62	0.75	12.7	2.02	0.5	0.63	0.78	11.9	2.28	0.5	0.64	0.81	11	2.59	0.51	0.65	0.86				
	1415	14.2	1.79	0.53	0.67	0.88	13.3	2.03	0.54	0.68	0.91	12.4	2.29	0.54	0.7	0.96	11.5	2.59	0.55	0.72	1				
	1700	14.6	1.8	0.56	0.72	0.98	13.7	2.03	0.57	0.75	1	12.8	2.29	0.58	0.79	1	11.9	2.59	0.59	0.83	1				
21.7°C	1135	14.3	1.79	0.38	0.49	0.6	13.5	2.03	0.37	0.49	0.61	12.6	2.29	0.37	0.5	0.62	11.7	2.59	0.36	0.5	0.63				
	1415	15	1.8	0.39	0.52	0.65	14.1	2.03	0.39	0.53	0.66	13.2	2.3	0.39	0.53	0.68	12.3	2.59	0.38	0.54	0.7				
	1700	15.5	1.8	0.41	0.56	0.7	14.6	2.04	0.41	0.56	0.72	13.7	2.3	0.4	0.57	0.76	12.6	2.59	0.4	0.58	0.8				

26 KW COOLING STANDARD EFFICIENCY KHA092S4 (2ND STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		26.7°C						35°C						43.3°C						51.7°C					
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C				
17.2°C	1135	23.2	4.22	0.73	0.9	1	20.8	5.09	0.75	0.94	1	18.1	6.17	0.78	1	1	15.5	7.55	0.85	1	1				
	1415	24.5	4.23	0.79	0.99	1	22.1	5.09	0.83	1	1	19.6	6.18	0.88	1	1	16.7	7.53	0.96	1	1				
	1700	25.8	4.24	0.86	1	1	23.4	5.1	0.91	1	1	20.7	6.17	0.97	1	1	17.7	7.54	1	1	1				
19.4°C	1135	24.9	4.23	0.56	0.71	0.86	22.3	5.1	0.57	0.73	0.9	19.4	6.18	0.58	0.76	0.96	16.3	7.55	0.6	0.82	1				
	1415	26	4.24	0.6	0.77	0.96	23.3	5.1	0.61	0.8	1	20.3	6.18	0.63	0.86	1	17	7.54	0.66	0.94	1				
	1700	26.9	4.25	0.64	0.84	1	24	5.1	0.66	0.89	1	21	6.18	0.69	0.95	1	17.7	7.54	0.73	1	1				
21.7°C	1135	26.4	4.24	0.41	0.55	0.69	23.7	5.1	0.41	0.56	0.71	20.8	6.18	0.39	0.57	0.74	17.6	7.55	0.39	0.59	0.79				
	1415	27.7	4.26	0.44	0.6	0.75	24.9	5.11	0.43	0.61	0.78	21.7	6.18	0.42	0.63	0.83	18.3	7.54	0.42	0.66	0.91				
	1700	28.6	4.26	0.45	0.64	0.82	25.6	5.11	0.45	0.66	0.86	22.4	6.19	0.45	0.68	0.92	18.8	7.54	0.45	0.73	1				

26 KW HEATING STANDARD EFFICIENCY KHA092S4

Indoor Coil Air Volume 21°C Dry Bulb	Air Temperature Entering Outdoor Coil																			
	18°C						7°C						-4°C						-15°C	
	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input		
L/s	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW		
1135	28.6	5.9	21.8	5.5	14.7	5.1	9.6	4.4	4.8	3.3										
1415	29.1	5.5	22.3	5.2	15.2	4.8	10.1	4.0	5.3	3.0										
1700	29.5	5.3	22.7	4.9	15.7	4.6	10.6	3.8	5.7	2.7										

COOLING / HEATING RATINGS - STANDARD EFFICIENCY

NOTE – For Temperatures and Capacities not shown in tables, see bulletin – Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

30 KW COOLING STANDARD EFFICIENCY KHA102S4 (1ST STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		18.3°C						23.9°C						29.4°C						35°C					
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	1285	13.7	2.01	0.66	0.82	1	12.9	2.26	0.67	0.85	1	12.2	2.55	0.69	0.9	1	11.3	2.89	0.7	0.95	1				
	1605	14.3	2.01	0.72	0.96	1	13.6	2.27	0.73	0.99	1	12.8	2.56	0.74	1	1	12	2.89	0.78	1	1				
	1925	15	2.02	0.78	1	1	14.3	2.28	0.81	1	1	13.5	2.57	0.86	1	1	12.7	2.9	0.9	1	1				
19.4°C	1285	14.6	2.01	0.52	0.64	0.77	13.7	2.27	0.52	0.65	0.8	13	2.56	0.53	0.67	0.84	12.1	2.89	0.53	0.68	0.89				
	1605	15.2	2.02	0.55	0.7	0.91	14.4	2.28	0.56	0.71	0.95	13.5	2.57	0.55	0.73	0.99	12.6	2.9	0.58	0.75	1				
	1925	15.7	2.03	0.59	0.75	1	14.8	2.28	0.59	0.78	1	13.9	2.57	0.6	0.82	1	13	2.9	0.62	0.87	1				
21.7°C	1285	15.4	2.02	0.39	0.51	0.61	14.7	2.28	0.39	0.51	0.63	13.8	2.57	0.38	0.52	0.65	12.9	2.9	0.38	0.53	0.66				
	1605	16.1	2.03	0.41	0.54	0.68	15.3	2.29	0.41	0.55	0.69	14.3	2.57	0.4	0.55	0.71	13.4	2.91	0.41	0.57	0.73				
	1925	16.6	2.04	0.42	0.58	0.73	15.7	2.29	0.43	0.59	0.75	14.7	2.58	0.42	0.6	0.78	13.7	2.91	0.42	0.61	0.84				

30 KW COOLING STANDARD EFFICIENCY KHA102S4 (2ND STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		26.7°C						35°C						43.3°C						51.7°C					
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	1285	26.1	4.96	0.75	0.92	1	23.6	5.96	0.78	0.97	1	20.9	7.21	0.81	1	1	18.3	8.81	0.88	1	1				
	1605	27.4	4.97	0.82	1	1	25.1	5.97	0.86	1	1	22.5	7.23	0.91	1	1	19.5	8.79	0.99	1	1				
	1925	29	4.99	0.89	1	1	26.4	5.98	0.94	1	1	23.7	7.23	1	1	1	20.5	8.8	1	1	1				
19.4°C	1285	27.9	4.98	0.58	0.73	0.88	25.2	5.97	0.59	0.76	0.93	22.2	7.21	0.6	0.79	0.99	18.9	8.8	0.63	0.85	1				
	1605	29	4.99	0.62	0.8	0.98	26.2	5.98	0.64	0.83	1	23.1	7.22	0.67	0.89	1	19.6	8.79	0.7	0.97	1				
	1925	29.9	4.99	0.66	0.87	1	27	5.98	0.68	0.92	1	23.8	7.23	0.72	0.98	1	20.5	8.8	0.77	1	1				
21.7°C	1285	29.7	5	0.43	0.57	0.7	26.9	5.99	0.42	0.58	0.73	23.8	7.23	0.42	0.6	0.77	20.3	8.8	0.42	0.63	0.83				
	1605	30.8	5	0.45	0.61	0.78	27.9	6	0.45	0.63	0.81	24.6	7.23	0.45	0.65	0.86	21.1	8.81	0.46	0.71	0.95				
	1925	31.7	5.02	0.46	0.66	0.84	28.6	6	0.47	0.68	0.89	25.3	7.24	0.48	0.72	0.96	21.5	8.81	0.49	0.77	1				
Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		48°C						50°C																	
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	1285	19.4	8.05	0.84	1.00	1.00	18.7	8.46	0.86	1.00	1.00	1605	8.06	0.95	1.00	1.00	19.2	8.46	0.98	1.00	1.00				
	1605	20.8	8.06	0.95	1.00	1.00	20.1	8.46	0.98	1.00	1.00	1925	8.06	1.00	1.00	1.00	21.0	8.45	1.00	1.00	1.00				
	1925	21.8	8.06	1.00	1.00	1.00	21.1	8.45	1.00	1.00	1.00	1285	8.06	0.62	0.82	1.00	19.6	8.45	0.62	0.83	1.00				
19.4°C	1285	20.4	8.06	0.62	0.82	1.00	19.6	8.45	0.62	0.83	1.00	1605	8.06	0.68	0.93	1.00	20.3	8.45	0.70	0.95	1.00				
	1605	21.2	8.06	0.68	0.93	1.00	20.3	8.45	0.70	0.95	1.00	1925	8.08	.74	1.00	1.00	21.1	8.45	.76	1.00	1.00				
	1925	22.0	8.08	.74	1.00	1.00	21.1	8.45	.76	1.00	1.00	1285	8.08	.42	.61	.80	21.0	8.47	.42	.62	.81				
21.7°C	1285	21.9	8.08	.42	.61	.80	21.0	8.47	.42	.62	.81	1605	22.7	8.07	.45	.68	.91	21.7	8.46	.45	.69	.93			
	1605	22.7	8.07	.45	.68	.91	21.7	8.46	.45	.69	.93	1925	23.2	8.07	.48	.74	1.00	22.3	8.47	.49	.76	1.00			

30 KW HEATING STANDARD EFFICIENCY KHA102S4

Indoor Coil Air Volume 21°C Dry Bulb	Air Temperature Entering Outdoor Coil																				
	18°C			7°C			-4°C			-15°C			-28°C								
	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input									
L/s	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW									
1285	32.5	6.3	24.6	5.8	16.3	5.3	10.5	4.6	5.3	3.5	1605	33.0	5.9	25.0	5.4	16.8	4.9	10.9	4.3	5.7	3.1
1925	33.6	5.7	25.6	5.2	17.3	4.7	11.5	4.0	6.3</td												

COOLING / HEATING RATINGS - STANDARD EFFICIENCY

NOTE – For Temperatures and Capacities not shown in tables, see bulletin – Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

35 KW COOLING STANDARD EFFICIENCY KHA120S4 (1ST STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		18.3°C						23.9°C						29.4°C						35°C					
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	1510	16.6	2.39	0.69	0.84	1	15.6	2.72	0.7	0.87	1	14.6	3.08	0.71	0.89	1	13.5	3.48	0.73	0.93	1				
	1890	17.5	2.41	0.75	0.94	1	16.5	2.74	0.76	0.97	1	15.4	3.1	0.78	1	1	14.4	3.51	0.8	1	1				
	2265	18.2	2.43	0.81	1	1	17.3	2.77	0.83	1	1	16.2	3.13	0.86	1	1	15.2	3.54	0.89	1	1				
19.4°C	1510	17.7	2.42	0.55	0.67	0.8	16.7	2.75	0.55	0.68	0.82	15.6	3.11	0.54	0.69	0.85	14.5	3.51	0.55	0.71	0.88				
	1890	18.6	2.44	0.58	0.73	0.9	17.5	2.78	0.58	0.74	0.93	16.4	3.13	0.59	0.76	0.96	15.2	3.54	0.59	0.78	0.99				
	2265	19.2	2.46	0.61	0.78	0.99	18.1	2.79	0.62	0.8	1	16.9	3.15	0.63	0.83	1	15.6	3.55	0.63	0.87	1				
21.7°C	1510	18.9	2.45	0.41	0.53	0.65	17.8	2.78	0.41	0.54	0.66	16.7	3.15	0.4	0.54	0.68	15.5	3.55	0.39	0.54	0.68				
	1890	19.7	2.48	0.43	0.57	0.71	18.6	2.81	0.42	0.57	0.72	17.4	3.17	0.42	0.58	0.74	16.2	3.58	0.42	0.59	0.76				
	2265	20.4	2.5	0.44	0.6	0.76	19.2	2.83	0.44	0.61	0.78	18	3.2	0.44	0.63	0.81	16.7	3.6	0.43	0.64	0.84				

35 KW COOLING STANDARD EFFICIENCY KHA120S4 (2ND STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		26.7°C						35°C						43.3°C						51.7°C					
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	1510	31.4	5.8	0.74	0.9	1	28.2	6.98	0.76	0.94	1	24.6	8.41	0.79	0.99	1	21.1	10.17	0.84	1	1				
	1890	33	5.85	0.8	0.99	1	29.9	7.04	0.83	1	1	26.6	8.48	0.88	1	1	22.8	10.24	0.96	1	1				
	2265	34.8	5.9	0.87	1	1	31.6	7.1	0.91	1	1	28	8.54	0.97	1	1	24.1	10.28	1	1	1				
19.4°C	1510	33.6	5.87	0.57	0.72	0.86	30.2	7.04	0.58	0.74	0.9	26.5	8.47	0.58	0.77	0.96	22.2	10.22	0.6	0.82	1				
	1890	35.1	5.92	0.61	0.78	0.96	31.5	7.1	0.62	0.81	1	27.5	8.52	0.64	0.86	1	23.2	10.24	0.67	0.93	1				
	2265	36.3	5.95	0.65	0.85	1	32.5	7.13	0.66	0.89	1	28.5	8.54	0.69	0.95	1	24.1	10.28	0.74	1	1				
21.7°C	1510	35.8	5.94	0.42	0.56	0.7	32.3	7.12	0.41	0.56	0.71	28.5	8.55	0.4	0.58	0.75	24.1	10.29	0.39	0.59	0.79				
	1890	37.5	5.99	0.44	0.6	0.76	33.8	7.17	0.44	0.62	0.79	29.6	8.6	0.43	0.64	0.83	25.1	10.32	0.42	0.67	0.91				
	2265	38.5	6.03	0.45	0.64	0.83	34.7	7.21	0.45	0.67	0.87	30.5	8.63	0.45	0.69	0.93	25.7	10.35	0.46	0.74	0.99				

35 KW HEATING STANDARD EFFICIENCY KHA120S4

Indoor Coil Air Volume 21°C Dry Bulb	Air Temperature Entering Outdoor Coil																													
	18°C						7°C						-4°C						-15°C						-28°C					
	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity			Comp. Motor Input																								
			kW	kW	kW																									
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	kW	24°C	27°C	29°C	kW								
1510	37.2	7.8	28.7	7.2	19.9	6.5	13.7	5.7	6.6	4.3																				
1890	38.0	7.3	29.6	6.7	20.8	6.1	14.6	5.3	7.5	3.9																				
2265	38.8	7.0	30.4	6.4	21.6	5.8	15.4	5.0	8.3	3.6																				

COOLING / HEATING RATINGS - STANDARD EFFICIENCY

NOTE – For Temperatures and Capacities not shown in tables, see bulletin – Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

44 KW COOLING STANDARD EFFICIENCY KHA150S4 (1ST STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		18.3°C						23.9°C						29.4°C						35°C					
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	1795	19.7	2.89	0.67	0.85	1	18.6	3.22	0.68	0.87	1	17.3	3.57	0.68	0.89	1	15.9	3.97	0.69	0.93	1				
	2075	20.4	2.9	0.71	0.92	1	19.2	3.22	0.71	0.94	1	18	3.58	0.73	0.97	1	16.6	3.97	0.75	1	1				
	2360	21	2.9	0.75	0.98	1	19.9	3.23	0.76	1	1	18.7	3.58	0.79	1	1	17.4	3.97	0.81	1	1				
19.4°C	1795	21.1	2.9	0.52	0.65	0.8	20	3.23	0.52	0.66	0.82	18.7	3.58	0.52	0.67	0.84	17.3	3.97	0.52	0.67	0.87				
	2075	21.8	2.91	0.54	0.68	0.87	20.5	3.23	0.54	0.69	0.89	19.3	3.58	0.55	0.7	0.92	17.9	3.97	0.55	0.72	0.96				
	2360	22.4	2.91	0.57	0.72	0.93	21.2	3.23	0.57	0.74	0.96	19.8	3.58	0.57	0.75	0.99	18.4	3.97	0.58	0.78	1				
21.7°C	1795	22.6	2.91	0.4	0.51	0.63	21.4	3.23	0.39	0.51	0.63	20.1	3.58	0.38	0.52	0.64	18.7	3.97	0.36	0.51	0.65				
	2075	23.4	2.92	0.4	0.54	0.67	22.1	3.24	0.39	0.53	0.67	20.7	3.59	0.39	0.54	0.68	19.3	3.97	0.38	0.54	0.7				
	2360	23.9	2.92	0.41	0.56	0.7	22.7	3.24	0.41	0.56	0.71	21.3	3.59	0.41	0.57	0.73	19.8	3.97	0.4	0.57	0.75				

44 KW COOLING STANDARD EFFICIENCY KHA150S4 (2ND STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		26.7°C						35°C						43.3°C						51.7°C					
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	1795	37	6.63	0.74	0.91	1	33	7.76	0.76	0.94	1	28.8	9.1	0.79	0.99	1	24.4	10.72	0.83	1	1				
	2075	38.5	6.64	0.78	0.97	1	34.4	7.76	0.81	1	1	30.4	9.11	0.85	1	1	26	10.72	0.91	1	1				
	2360	39.8	6.65	0.83	1	1	36	7.77	0.86	1	1	31.9	9.1	0.9	1	1	27.4	10.73	0.97	1	1				
19.4°C	1795	39.9	6.65	0.57	0.72	0.87	35.7	7.76	0.56	0.73	0.9	31.3	9.1	0.57	0.76	0.95	26.1	10.73	0.58	0.81	1				
	2075	41.2	6.65	0.6	0.76	0.93	37	7.77	0.6	0.78	0.97	32.3	9.11	0.61	0.81	1	27.1	10.72	0.62	0.88	1				
	2360	42.3	6.66	0.62	0.8	0.98	37.9	7.78	0.63	0.83	1	33.1	9.11	0.64	0.87	1	27.8	10.71	0.67	0.94	1				
21.7°C	1795	42.9	6.66	0.42	0.56	0.7	38.6	7.78	0.39	0.56	0.71	34	9.1	0.39	0.57	0.74	28.7	10.71	0.36	0.57	0.78				
	2075	44.2	6.66	0.43	0.58	0.74	39.9	7.77	0.42	0.59	0.76	35.1	9.11	0.4	0.6	0.79	29.7	10.72	0.38	0.62	0.84				
	2360	45.4	6.67	0.44	0.61	0.78	41	7.78	0.43	0.62	0.81	36	9.11	0.42	0.64	0.85	30.5	10.72	0.41	0.66	0.91				

44 KW HEATING STANDARD EFFICIENCY KHA150S4

Indoor Coil Air Volume 21°C Dry Bulb	Air Temperature Entering Outdoor Coil																						
	18°C						7°C						-4°C						-15°C			-28°C	
	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity			Comp. Motor Input	Total Heating Capacity			Comp. Motor Input	Total Heating Capacity			Comp. Motor Input	Total Heating Capacity			Comp. Motor Input	Total Heating Capacity		Comp. Motor Input		
L/s			kW	kW	kW		kW	kW	kW		kW	kW	kW		kW	kW	kW		kW	kW			
1795	44.2	8.5	33.7	7.8	22.7	7.1	15.2	6.3	7.5	4.6													
2075	45.1	8.2	34.6	7.5	23.6	6.8	16.1	6.0	8.4	4.4													
2360	46.0	8.0	35.4	7.3	24.4	6.6	17.0	5.8	9.2	4.2													

COOLING / HEATING RATINGS - HIGH EFFICIENCY

NOTE – For Temperatures and Capacities not shown in tables, see bulletin – Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

26 KW COOLING HIGH EFFICIENCY KHB092H4 (1ST STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		18.3°C						23.9°C						29.4°C						35°C					
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	1135	12.4	1.83	0.73	0.89	1.00	11.3	2.06	0.74	0.91	1.00	10.1	2.32	0.74	0.94	1.00	8.9	2.62	0.75	0.97	1.00				
	1415	13.2	1.85	0.80	0.98	1.00	12.0	2.08	0.81	1.00	1.00	10.9	2.34	0.83	1.00	1.00	9.8	2.63	0.85	1.00	1.00				
	1700	14.0	1.86	0.87	1.00	1.00	12.9	2.09	0.89	1.00	1.00	11.8	2.35	0.92	1.00	1.00	10.5	2.65	0.95	1.00	1.00				
19.4°C	1135	13.5	1.85	0.57	0.71	0.86	12.3	2.08	0.56	0.72	0.88	11.0	2.34	0.55	0.73	0.90	9.8	2.63	0.53	0.73	0.93				
	1415	14.2	1.87	0.61	0.78	0.95	13.0	2.09	0.60	0.79	0.98	11.7	2.35	0.60	0.81	1.00	10.3	2.64	0.59	0.83	1.00				
	1700	14.7	1.88	0.66	0.85	1.00	13.5	2.10	0.65	0.87	1.00	12.1	2.36	0.65	0.90	1.00	10.8	2.65	0.66	0.93	1.00				
21.7°C	1135	14.5	1.87	0.42	0.56	0.70	13.3	2.10	0.40	0.56	0.70	12.1	2.36	0.38	0.54	0.71	10.8	2.65	0.35	0.53	0.71				
	1415	15.3	1.88	0.45	0.61	0.77	14.0	2.11	0.42	0.60	0.77	12.7	2.37	0.41	0.61	0.79	11.3	2.66	0.38	0.60	0.81				
	1700	15.8	1.89	0.46	0.65	0.83	14.5	2.12	0.45	0.65	0.85	13.1	2.38	0.43	0.65	0.87	11.7	2.67	0.41	0.65	0.91				

26 KW COOLING HIGH EFFICIENCY KHB092H4 (2ND STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		26.7°C						35°C						43.3°C						51.7°C					
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	1135	22.7	4.28	0.73	0.91	1.00	21.1	4.84	0.75	0.94	1.00	19.5	5.50	0.76	0.98	1.00	17.9	6.27	0.79	1.00	1.00				
	1415	23.9	4.27	0.79	1.00	1.00	22.5	4.84	0.81	1.00	1.00	21.0	5.50	0.85	1.00	1.00	19.3	6.27	0.90	1.00	1.00				
	1700	25.3	4.28	0.87	1.00	1.00	23.8	4.85	0.91	1.00	1.00	22.2	5.49	0.95	1.00	1.00	20.5	6.24	0.99	1.00	1.00				
19.4°C	1135	24.3	4.28	0.56	0.71	0.86	22.7	4.84	0.57	0.73	0.90	21.0	5.49	0.57	0.74	0.93	19.1	6.26	0.58	0.76	0.98				
	1415	25.4	4.28	0.60	0.77	0.97	23.7	4.84	0.61	0.80	1.00	21.9	5.49	0.62	0.83	1.00	20.0	6.25	0.64	0.87	1.00				
	1700	26.2	4.28	0.64	0.85	1.00	24.4	4.84	0.66	0.88	1.00	22.5	5.49	0.68	0.92	1.00	20.6	6.25	0.70	0.97	1.00				
21.7°C	1135	25.9	4.28	0.41	0.55	0.69	24.3	4.85	0.41	0.56	0.70	22.5	5.49	0.40	0.56	0.72	20.5	6.25	0.40	0.57	0.74				
	1415	27.1	4.29	0.43	0.59	0.75	25.3	4.84	0.43	0.61	0.77	23.4	5.49	0.42	0.61	0.80	21.4	6.25	0.42	0.63	0.84				
	1700	27.9	4.29	0.44	0.64	0.82	26.1	4.85	0.45	0.66	0.86	24.1	5.49	0.45	0.66	0.89	22.0	6.25	0.45	0.69	0.95				
Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		46°C						48°C						50°C											
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	1135	17.9	6.25	.82	1.00	1.00	17.3	6.56	.83	1.00	1.00	16.8	6.89	.84	1.00	1.00	16.8	6.89	.84	1.00	1.00				
	1415	19.4	6.25	.91	1.00	1.00	18.8	6.55	.93	1.00	1.00	18.1	6.87	.95	1.00	1.00	18.1	6.87	.95	1.00	1.00				
	1700	20.5	6.22	.99	1.00	1.00	19.8	6.54	1.00	1.00	1.00	19.1	6.86	1.00	1.00	1.00	19.1	6.86	1.00	1.00	1.00				
19.4°C	1135	19.1	6.25	.59	.79	.98	18.4	6.56	.60	.81	1.00	17.8	6.87	.61	.82	1.00	17.8	6.87	.61	.82	1.00				
	1415	20.0	6.24	.66	.89	1.00	19.3	6.54	.66	.91	1.00	18.5	6.87	.67	.92	1.00	18.5	6.87	.67	.92	1.00				
	1700	20.7	6.24	.72	.98	1.00	19.9	6.54	.73	.99	1.00	19.2	6.86	.74	1.00	1.00	19.2	6.86	.74	1.00	1.00				
21.7°C	1135	20.6	6.23	.40	.58	.76	19.9	6.55	.41	.59	.78	19.2	6.86	.41	.60	.79	20.5	6.85	.41	.60	.79				
	1415	21.5	6.24	.43	.65	.87	20.7	6.53	.43	.67	.88	20.0	6.85	.43	.67	.89	21.4	6.85	.43	.67	.90				
	1700	22.1	6.23	.46	.72	.96	21.3	6.53	.46	.73	.97	20.5	6.85	.46	.74	.99	22.0	6.85	.46	.74	.99				

26 KW HEATING HIGH EFFICIENCY KHB092H4

Indoor Coil Air Volume 21°C Dry Bulb	Air Temperature Entering Outdoor Coil																			
	18°C						7°C						-4°C						-15°C	
	Total 																			

COOLING / HEATING RATINGS - HIGH EFFICIENCY

NOTE – For Temperatures and Capacities not shown in tables, see bulletin – Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

30 KW COOLING HIGH EFFICIENCY KHB102H4 (1ST STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		18.3°C						23.9°C						29.4°C						35°C					
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	1285	14.1	2.14	0.68	0.85	1.00	13.0	2.44	0.69	0.88	1.00	11.8	2.77	0.70	0.92	1.00	10.6	3.14	0.71	0.96	1.00				
	1605	14.9	2.15	0.75	0.97	1.00	13.8	2.46	0.76	1.00	1.00	12.7	2.79	0.77	1.00	1.00	11.6	3.16	0.80	1.00	1.00				
	1925	15.8	2.17	0.82	1.00	1.00	14.7	2.48	0.84	1.00	1.00	13.6	2.81	0.88	1.00	1.00	12.4	3.18	0.92	1.00	1.00				
19.4°C	1285	15.2	2.15	0.53	0.66	0.81	14.0	2.46	0.53	0.67	0.83	12.9	2.80	0.52	0.68	0.86	11.6	3.16	0.51	0.69	0.90				
	1605	15.9	2.17	0.57	0.73	0.93	14.7	2.48	0.57	0.74	0.96	13.5	2.81	0.57	0.75	1.00	12.2	3.18	0.57	0.77	1.00				
	1925	16.5	2.18	0.61	0.79	1.00	15.3	2.49	0.62	0.81	1.00	14.0	2.82	0.62	0.85	1.00	12.7	3.19	0.61	0.89	1.00				
21.7°C	1285	16.3	2.17	0.39	0.52	0.65	15.1	2.48	0.39	0.51	0.65	14.0	2.82	0.37	0.52	0.66	12.7	3.19	0.35	0.51	0.67				
	1605	17.1	2.19	0.42	0.56	0.71	15.9	2.50	0.40	0.57	0.72	14.6	2.83	0.39	0.55	0.73	13.3	3.20	0.38	0.57	0.76				
	1925	17.7	2.20	0.44	0.60	0.77	16.4	2.51	0.42	0.61	0.79	15.0	2.85	0.41	0.60	0.82	13.7	3.21	0.39	0.62	0.86				

30 KW COOLING HIGH EFFICIENCY KHB102H4 (2ND STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		26.7°C						35°C						43.3°C						51.7°C					
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	1285	25.5	4.72	0.75	0.92	1.00	23.9	5.39	0.76	0.95	1.00	22.2	6.13	0.78	0.98	1.00	20.5	6.96	0.80	1.00	1.00				
	1605	26.8	4.74	0.81	1.00	1.00	25.4	5.40	0.84	1.00	1.00	23.8	6.14	0.87	1.00	1.00	22.0	6.97	0.91	1.00	1.00				
	1925	28.4	4.75	0.88	1.00	1.00	26.8	5.41	0.92	1.00	1.00	25.1	6.15	0.95	1.00	1.00	23.2	6.97	0.99	1.00	1.00				
19.4°C	1285	27.3	4.74	0.58	0.72	0.87	25.6	5.40	0.58	0.74	0.91	23.8	6.14	0.59	0.76	0.94	21.8	6.96	0.59	0.78	0.98				
	1605	28.5	4.75	0.61	0.79	0.98	26.6	5.41	0.62	0.81	1.00	24.7	6.15	0.63	0.84	1.00	22.7	6.97	0.65	0.88	1.00				
	1925	29.4	4.76	0.66	0.86	1.00	27.5	5.42	0.68	0.90	1.00	25.5	6.15	0.68	0.93	1.00	23.4	6.99	0.71	0.97	1.00				
21.7°C	1285	29.1	4.76	0.42	0.56	0.70	27.4	5.42	0.42	0.57	0.72	25.5	6.16	0.42	0.58	0.73	23.4	6.98	0.41	0.58	0.76				
	1605	30.3	4.76	0.44	0.61	0.77	28.4	5.43	0.44	0.60	0.79	26.5	6.17	0.44	0.63	0.82	24.3	6.99	0.44	0.64	0.85				
	1925	31.3	4.78	0.46	0.66	0.84	29.2	5.44	0.46	0.66	0.87	27.2	6.17	0.46	0.68	0.90	25.0	7.01	0.46	0.71	0.95				

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		46°C						48°C						50°C							
		Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap. Input	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	
17.2°C	1285	20.5	6.94	0.82	1.00	1.00	19.9	7.26	0.84	1.00	1.00	19.3	7.60	0.85	1.00	1.00	18.0	7.60	0.82	1.00	1.00
	1605	22.1	6.96	0.92	1.00	1.00	21.5	7.28	0.93	1.00	1.00	20.7	7.63	0.95	1.00	1.00	19.5	7.63	0.92	1.00	1.00
	1925	23.3	6.96	0.99	1.00	1.00	22.6	7.28	1.00	1.00	1.00	21.8	7.63	1.00	1.00	1.00	20.3	7.62	0.98	1.00	1.00
19.4°C	1285	21.8	6.94	0.60	0.80	0.98	21.1	7.28	0.61	0.81	1.00	20.3	7.62	0.62	0.82	1.00	19.0	7.62	0.68	0.92	1.00
	1605	22.8	6.95	0.66	0.89	1.00	22.0	7.28	0.68	0.91	1.00	21.2	7.62	0.68	0.89	1.00	19.8	7.62	0.74	1.00	1.00
	1925	23.4	6.96	0.72	0.98	1.00	22.7	7.29	0.73	0.99	1.00	21.9	7.63	0.74	1.00	1.00	20.5	7.62	0.78	1.00	1.00
21.7°C	1285	23.4	6.96	0.42	0.60	0.78	22.7	7.30	0.42	0.60	0.78	21.9	7.64	0.42	0.61	0.80	22.7	7.64	0.44	0.68	0.90
	1605	24.4	6.97	0.44	0.65	0.87	23.6	7.30	0.44	0.67	0.88	22.7	7.64	0.44	0.68	0.90	23.4	7.64	0.46	0.71	0.99
	1925	25.0	6.98	0.47	0.71	0.96	24.2	7.31	0.48	0.73	0.97	23.3	7.64	0.48	0.74	0.99	24.0	7.64	0.49	0.75	1.00

30 KW HEATING HIGH EFFICIENCY KHB102H4

Indoor Coil Air Volume 21°C Dry Bulb	Air Temperature Entering Outdoor Coil																					
18°C						7°C						-4°C						-15°C			-28°C	
Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor Input	Total Heating Capacity	Comp. Motor															

BLOWER DATA - BELT DRIVE - STANDARD EFFICIENCY

KHA092S4B – BASE UNIT

BLOWER TABLE INCLUDES RESISTANCE FOR BASE UNIT ONLY (NO HEAT SECTION) WITH DRY INDOOR COIL AND AIR FILTERS IN PLACE. FOR ALL UNITS ADD:

1 – Wet indoor coil air resistance of selected unit.

2 – Any factory installed options air resistance (heat section, economizer, etc.)

3 – Any field installed accessories air resistance (duct resistance, diffuser, etc.)

Then determine from blower table blower motor output required.

See page 21 for blower motors and drives.

See page 21 for wet coil and option/accessory air resistance data.

MINIMUM AIR VOLUME REQUIRED FOR USE WITH OPTIONAL ELECTRIC HEAT - Maximum Static Pressure - 500 Pa (2.0 in. w.g.)

5.7 kW, 11.5 kW, 17.2 kW, 23 kW and 34.5 kW - 1320 L/s (2800 cfm)

Air Volume		TOTAL STATIC PRESSURE - Pa (Inches Water Gauge)																					
		50 (0.20)				100 (0.40)				150 (0.60)				200 (0.80)				250 (1.00)				300 (1.20)	
L/s	cfm	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	
1062	2250	---	---	---	---	---	---	707	0.10	0.14	753	0.37	0.5	800	0.63	0.84	847	0.86	1.15	892	1.03	1.38	
1180	2500	---	---	---	---	---	---	714	0.22	0.29	758	0.48	0.64	803	0.72	0.97	849	0.94	1.26	893	1.10	1.48	
1298	2750	---	---	680	0.08	0.11	721	0.34	0.45	763	0.58	0.78	807	0.81	1.09	852	1.02	1.37	896	1.18	1.58		
1416	3000	---	---	689	0.22	0.29	728	0.46	0.61	770	0.69	0.93	812	0.92	1.23	856	1.11	1.49	901	1.27	1.7		
1534	3250	661	0.13	0.17	698	0.34	0.46	737	0.58	0.78	777	0.81	1.09	819	1.03	1.38	862	1.22	1.63	908	1.37	1.84	
1652	3500	672	0.27	0.36	708	0.48	0.65	746	0.71	0.95	786	0.93	1.25	827	1.14	1.53	870	1.33	1.78	916	1.48	1.99	
1770	3750	684	0.42	0.56	719	0.63	0.85	756	0.85	1.14	795	1.07	1.43	836	1.27	1.7	880	1.45	1.95	927	1.61	2.16	
1888	4000	697	0.58	0.78	731	0.78	1.05	768	1.00	1.34	807	1.21	1.62	848	1.41	1.89	892	1.59	2.13	940	1.75	2.34	
2006	4250	710	0.75	1.0	745	0.95	1.27	781	1.16	1.55	819	1.37	1.83	861	1.56	2.09	906	1.74	2.33	954	1.90	2.55	
2124	4500	725	0.92	1.23	759	1.12	1.5	795	1.32	1.77	834	1.53	2.05	875	1.72	2.31	921	1.90	2.55	970	2.07	2.77	
2242	4750	741	1.10	1.48	775	1.30	1.74	811	1.50	2.01	850	1.71	2.29	892	1.90	2.55	939	2.08	2.79	986	2.25	3.01	
2360	5000	758	1.30	1.74	791	1.49	2.0	828	1.69	2.27	867	1.89	2.54	911	2.09	2.8	958	2.28	3.05	1004	2.44	3.27	
2477	5250	775	1.50	2.01	809	1.69	2.27	846	1.90	2.55	886	2.10	2.82	931	2.30	3.08	977	2.48	3.33	1021	2.66	3.56	
2595	5500	794	1.72	2.3	829	1.91	2.56	866	2.12	2.84	907	2.32	3.11	952	2.52	3.38	997	2.71	3.63	1039	2.88	3.86	
2713	5750	814	1.95	2.61	849	2.15	2.88	887	2.35	3.15	930	2.56	3.43	974	2.76	3.7	1018	2.95	3.95	1058	3.13	4.19	
2831	6000	836	2.19	2.93	871	2.39	3.21	910	2.60	3.49	953	2.81	3.77	997	3.01	4.04	1038	3.21	4.3	1077	3.39	4.54	

Air Volume		TOTAL STATIC PRESSURE - Pa (Inches Water Gauge)																				
		400 (1.60)				450 (1.80)				500 (2.00)				550 (2.20)				600 (2.40)				
L/s	cfm	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP
1062	2250	934	1.14	1.53	979	1.23	1.65	1051	1.39	1.86	1126	1.58	2.12	1183	1.76	2.36	1238	1.95	2.62			
1180	2500	936	1.22	1.63	983	1.31	1.75	1052	1.46	1.96	1124	1.66	2.22	1184	1.86	2.49	1241	2.07	2.77			
1298	2750	940	1.30	1.74	989	1.40	1.88	1053	1.55	2.08	1121	1.75	2.34	1185	1.96	2.63	1244	2.19	2.93			
1416	3000	947	1.40	1.87	996	1.51	2.02	1055	1.65	2.21	1120	1.84	2.47	1186	2.07	2.78	1248	2.31	3.1			
1534	3250	955	1.50	2.01	1004	1.62	2.17	1059	1.76	2.36	1122	1.95	2.62	1189	2.19	2.94	1252	2.45	3.28			
1652	3500	965	1.62	2.17	1013	1.74	2.33	1065	1.88	2.52	1126	2.08	2.79	1193	2.33	3.12	1257	2.59	3.47			
1770	3750	976	1.75	2.34	1023	1.87	2.51	1073	2.02	2.71	1133	2.22	2.98	1198	2.48	3.32	1263	2.74	3.67			
1888	4000	988	1.89	2.53	1034	2.02	2.71	1083	2.17	2.91	1141	2.38	3.19	1205	2.63	3.53	1270	2.90	3.89			
2006	4250	1001	2.04	2.74	1046	2.19	2.93	1094	2.34	3.14	1151	2.55	3.42	1214	2.80	3.76	1278	3.07	4.12			
2124	4500	1015	2.22	2.97	1059	2.36	3.16	1106	2.52	3.38	1162	2.74	3.67	1224	2.98	4.0	1287	3.25	4.36			
2242	4750	1030	2.40	3.22	1072	2.55	3.42	1119	2.72	3.64	1174	2.93	3.93	1235	3.18	4.26	1297	3.44	4.61			
2360	5000	1046	2.60	3.48	1087	2.75	3.69	1134	2.92	3.92	1188	3.14	4.21	1247	3.38	4.53	1309	3.64	4.88			
2477	5250	1062	2.81	3.77	1103	2.97	3.98	1150	3.15	4.22	1203	3.36	4.5	1261	3.60	4.82	1321	3.85	5.16			
2595	5500	1079	3.04	4.08	1120	3.20	4.29	1166	3.38	4.53	1218	3.58	4.8	1275	3.82	5.12	1335	4.07	5.45			
2713	5750	1096	3.29	4.41	1138	3.45	4.62	1183	3.62	4.85	1235	3.82	5.12	1290	4.05	5.43	---	---	---			
2831	6000	1115	3.54	4.75	1156	3.70	4.96	1202	3.87	5.19	1252	4.07	5.45	1307	4.29	5.75	---	---	---			

BLOWER DATA - BELT DRIVE - STANDARD / HIGH EFFICIENCY

KHA102S4B, KHA120S4B, KHA150S4B AND KHB092H4B, KHB102H4B – BASE UNIT

BLOWER TABLE INCLUDES RESISTANCE FOR BASE UNIT ONLY (NO HEAT SECTION) WITH DRY INDOOR COIL AND AIR FILTERS IN PLACE. FOR ALL UNITS ADD:

1 – Wet indoor coil air resistance of selected unit.

2 – Any factory installed options air resistance (heat section, economizer, etc.)

3 – Any field installed accessories air resistance (duct resistance, diffuser, etc.)

Then determine from blower table blower motor output required.

See page 21 for blower motors and drives.

See page 21 for wet coil and option/accessory air resistance data.

MINIMUM AIR VOLUME REQUIRED FOR USE WITH OPTIONAL ELECTRIC HEAT - Maximum Static Pressure - 500 Pa (2.0 in. w.g.)

5.7 kW, 11.5 kW, 17.2 kW, 23 kW and 34.5 kW - 1320 L/s (2800 cfm)

45.9 kW - 1885 (4000 cfm)

Air Volume		TOTAL STATIC PRESSURE - Pa (Inches Water Gauge)																				
		50 (0.20)			100 (0.40)			150 (0.60)			200 (0.80)			250 (1.00)			300 (1.20)			350 (1.40)		
L/s	cfm	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP
1062	2250	587	0.06	0.08	637	0.23	0.31	690	0.42	0.56	746	0.61	0.82	805	0.79	1.06	865	0.95	1.28	927	1.09	1.46
1180	2500	601	0.18	0.24	650	0.35	0.47	703	0.53	0.71	757	0.71	0.95	815	0.88	1.18	875	1.04	1.4	938	1.17	1.57
1298	2750	616	0.31	0.41	664	0.46	0.62	715	0.63	0.85	769	0.81	1.09	826	0.98	1.31	886	1.13	1.52	950	1.27	1.7
1416	3000	632	0.43	0.58	679	0.59	0.79	729	0.75	1.01	782	0.92	1.23	839	1.08	1.45	899	1.24	1.66	963	1.37	1.84
1534	3250	649	0.57	0.76	695	0.72	0.96	744	0.87	1.17	797	1.04	1.39	853	1.19	1.6	913	1.35	1.81	976	1.48	1.99
1652	3500	666	0.71	0.95	712	0.85	1.14	761	1.01	1.35	813	1.16	1.55	868	1.31	1.76	929	1.47	1.97	990	1.62	2.17
1770	3750	685	0.87	1.16	730	1.00	1.34	779	1.14	1.53	830	1.30	1.74	886	1.45	1.94	946	1.60	2.15	1005	1.76	2.36
1888	4000	706	1.02	1.37	750	1.16	1.55	798	1.29	1.73	849	1.44	1.93	905	1.60	2.14	965	1.75	2.35	1019	1.92	2.57
2006	4250	727	1.19	1.6	772	1.32	1.77	819	1.45	1.95	871	1.60	2.15	926	1.75	2.35	984	1.92	2.58	1034	2.09	2.8
2124	4500	750	1.37	1.84	795	1.50	2.01	843	1.63	2.19	894	1.78	2.38	949	1.93	2.59	1003	2.11	2.83	1050	2.29	3.07
2242	4750	775	1.57	2.1	820	1.69	2.26	868	1.82	2.44	919	1.96	2.63	972	2.13	2.86	1023	2.32	3.11	1067	2.51	3.36
2360	5000	802	1.77	2.37	847	1.89	2.53	895	2.02	2.71	945	2.17	2.91	997	2.36	3.16	1044	2.56	3.43	1087	2.75	3.69
2477	5250	831	1.99	2.67	876	2.11	2.83	924	2.25	3.01	973	2.41	3.23	1022	2.61	3.5	1066	2.82	3.78	1108	3.01	4.04
2595	5500	862	2.22	2.98	907	2.34	3.14	955	2.48	3.33	1002	2.68	3.59	1048	2.90	3.89	1090	3.11	4.17	1132	3.30	4.42
2713	5750	895	2.47	3.31	940	2.60	3.48	987	2.77	3.71	1032	2.99	4.01	1075	3.22	4.32	1116	3.42	4.59	1158	3.60	4.82
2831	6000	931	2.73	3.66	976	2.89	3.87	1021	3.10	4.16	1064	3.35	4.49	1104	3.57	4.78	1144	3.74	5.02	1185	3.90	5.23

Air Volume		TOTAL STATIC PRESSURE - Pa (Inches Water Gauge)																			
		400 (1.60)			450 (1.80)			500 (2.00)			550 (2.20)			600 (2.40)			650 (2.60)				
L/s	cfm	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP	rev/min	kW	BHP		
1062	2250	985	1.17	1.57	1034	1.25	1.68	1084	1.34	1.8	1136	1.45	1.95	1189	1.59	2.13	1239	1.73	2.32		
1180	2500	996	1.27	1.7	1045	1.36	1.82	1095	1.46	1.96	1147	1.59	2.13	1201	1.72	2.31	1253	1.88	2.52		
1298	2750	1008	1.37	1.84	1056	1.48	1.98	1105	1.59	2.13	1158	1.72	2.31	1213	1.88	2.52	1266	2.04	2.73		
1416	3000	1019	1.48	1.99	1066	1.60	2.15	1115	1.73	2.32	1169	1.87	2.51	1225	2.04	2.73	1279	2.21	2.96		
1534	3250	1030	1.61	2.16	1076	1.74	2.33	1126	1.88	2.52	1181	2.04	2.73	1237	2.20	2.95	1293	2.38	3.19		
1652	3500	1041	1.75	2.35	1087	1.89	2.53	1138	2.04	2.73	1193	2.20	2.95	1250	2.38	3.19	1307	2.56	3.43		
1770	3750	1053	1.90	2.55	1098	2.05	2.75	1150	2.21	2.96	1207	2.39	3.2	1264	2.57	3.44	1321	2.75	3.69		
1888	4000	1065	2.07	2.78	1111	2.23	2.99	1164	2.40	3.22	1221	2.58	3.46	1279	2.76	3.7	1336	2.95	3.96		
2006	4250	1079	2.25	3.02	1126	2.42	3.25	1180	2.60	3.49	1236	2.78	3.73	1295	2.97	3.98	1352	3.16	4.24		
2124	4500	1094	2.46	3.3	1142	2.63	3.53	1196	2.81	3.77	1253	3.00	4.02	1311	3.19	4.27	1369	3.38	4.53		
2242	4750	1112	2.69	3.6	1161	2.86	3.84	1215	3.04	4.08	1271	3.22	4.32	1329	3.41	4.57	1387	3.60	4.83		
2360	5000	1131	2.93	3.93	1181	3.10	4.16	1235	3.28	4.4	1291	3.46	4.64	1349	3.65	4.89	1406	3.83	5.14		
2477	5250	1153	3.19	4.27	1203	3.36	4.51	1256	3.54	4.74	1312	3.72	4.98	1369	3.89	5.22	1426	4.08	5.47		
2595	5500	1177	3.46	4.64	1226	3.63	4.87	1278	3.80	5.09	1333	3.97	5.32	1390	4.15	5.56	---	---	---	---	---
2713	5750	1202	3.75	5.03	1251	3.91	5.24	1302	4.07	5.46	1356	4.24	5.68	---	---	---	---	---	---	---	---
2831	6000	1229	4.05	5.43	1276	4.20	5.63	---	---	---	---	---	---	---	---	---	---	---	---	---	---

BLOWER DATA

FACTORY INSTALLED BELT DRIVE KIT SPECIFICATIONS

Nominal		Maximum		Drive Kit Number	rev/min Range
kW	hp	kW	hp		
1.5	2	1.7	2.3	1	490 - 740
1.5	2	1.7	2.3	2	665 - 920
1.5	2	1.7	2.3	3	660 - 995
2.2	3	2.6	3.45	7	610 - 810
2.2	3	2.6	3.45	8	780 - 1000
2.2	3	2.6	3.45	9	845 - 1085
3.7	5	4.3	5.75	10	750 - 945
3.7	5	4.3	5.75	11	865 - 1095
3.7	5	4.3	5.75	12	940 - 1190

POWER EXHAUST FAN PERFORMANCE

Return Air System Static Pressure		Air Volume Exhausted	
Pa	in. w.g.	L/s	cfm
0	0	1498	3175
12	0.05	1394	2955
25	0.10	1267	2685
37	0.15	1137	2410
50	0.20	1022	2165
62	0.25	906	1920
75	0.30	670	1420
87	0.35	566	1200

FACTORY INSTALLED OPTIONS/FIELD INSTALLED ACCESSORY AIR RESISTANCE

Air Volume		Wet Indoor Coil				Electric Heat		Economizer		Filters				Return Air Adaptor Plate	
		KHA092		KHA 102, 120, 150 KHB 092, 102						MERV 8		MERV 13			
L/s	cfm	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.
1062	2250	25	0.1	32	0.13	10	0.04	20	0.08	2	0.01	10	0.04	0	0.00
1180	2500	30	0.12	37	0.15	10	0.04	27	0.11	2	0.01	12	0.05	0	0.00
1298	2750	30	0.12	42	0.17	12	0.05	30	0.12	5	0.02	12	0.05	0	0.00
1416	3000	37	0.15	47	0.19	15	0.06	32	0.13	5	0.02	15	0.06	5	0.02
1534	3250	45	0.18	57	0.23	15	0.06	37	0.15	5	0.02	15	0.06	5	0.02
1652	3500	52	0.21	65	0.26	22	0.09	37	0.15	7	0.03	17	0.07	10	0.04
1770	3750	57	0.23	72	0.29	22	0.09	37	0.15	7	0.03	20	0.08	17	0.07
1888	4000	62	0.25	77	0.31	22	0.09	47	0.19	10	0.04	20	0.08	22	0.09
2006	4250	67	0.27	85	0.34	32	0.13	47	0.19	10	0.04	22	0.09	27	0.11
2124	4500	75	0.3	92	0.37	35	0.14	55	0.22	10	0.04	22	0.09	30	0.12
2242	4750	80	0.32	99	0.4	42	0.17	62	0.25	12	0.05	25	0.1	40	0.16
2360	5000	87	0.35	107	0.43	50	0.2	72	0.29	15	0.06	25	0.1	45	0.18
2477	5250	90	0.36	114	0.46	55	0.22	80	0.32	15	0.06	27	0.11	47	0.19
2595	5500	99	0.4	124	0.5	62	0.25	85	0.34	17	0.07	30	0.12	55	0.22
2713	5750	107	0.43	139	0.56	77	0.31	112	0.45	17	0.07	30	0.12	62	0.25
2831	6000	114	0.46	147	0.59	82	0.33	129	0.52	20	0.08	32	0.13	67	0.27

BLOWER DATA

CEILING DIFFUSERS AIR RESISTANCE

Unit Size	RTD11 Step-Down Diffuser								FD11 Flush Diffuser	
	Air Volume		2 Ends Open		1 Side, 2 Ends Open		All Ends & Sides Open			
	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.
092 Models	1133	2400	52	0.21	45	0.18	37	0.15	35	0.14
	1227	2600	60	0.24	52	0.21	45	0.18	42	0.17
	1321	2800	67	0.27	60	0.24	52	0.21	50	0.20
	1416	3000	80	0.32	72	0.29	62	0.25	62	0.25
	1510	3200	102	0.41	92	0.37	80	0.32	77	0.31
	1604	3400	124	0.50	112	0.45	97	0.39	92	0.37
	1699	3600	152	0.61	134	0.54	119	0.48	109	0.44
	1793	3800	182	0.73	157	0.63	142	0.57	127	0.51
102 & 120 Models	1699	3600	90	0.36	70	0.28	57	0.23	37	0.15
	1793	3800	99	0.40	80	0.32	65	0.26	45	0.18
	1888	4000	109	0.44	90	0.36	72	0.29	52	0.21
	1982	4200	122	0.49	99	0.40	82	0.33	60	0.24
	2076	4400	134	0.54	109	0.44	92	0.37	67	0.27
	2171	4600	149	0.60	122	0.49	104	0.42	77	0.31
	2265	4800	162	0.65	132	0.53	114	0.46	87	0.35
	2360	5000	172	0.69	144	0.58	124	0.50	97	0.39
	2454	5200	186	0.75	154	0.62	134	0.54	107	0.43
150 Models	1982	4200	55	0.22	47	0.19	40	0.16	25	0.10
	2076	4400	70	0.28	60	0.24	50	0.20	30	0.12
	2171	4600	85	0.34	72	0.29	60	0.24	37	0.15
	2265	4800	99	0.40	85	0.34	72	0.29	47	0.19
	2360	5000	114	0.46	97	0.39	85	0.34	57	0.23
	2454	5200	129	0.52	109	0.44	97	0.39	67	0.27
	2548	5400	144	0.58	122	0.49	107	0.43	77	0.31
	2643	5600	159	0.64	134	0.54	117	0.47	87	0.35
	2737	5800	174	0.70	147	0.59	127	0.51	97	0.39

CEILING DIFFUSER AIR THROW DATA

Model No.	Air Volume		¹ Effective Throw Range				FD11 Flush	
			RTD11 Step-Down		FD11 Flush			
	L/s	cfm	m	ft.	m	ft.		
092 Models	1227	2600	7 - 9	24 - 29	6 - 7	19 - 24		
	1321	2800	8 - 9	25 - 30	6 - 9	20 - 28		
	1416	3000	8 - 10	27 - 33	6 - 9	21 - 29		
	1510	3200	9 - 11	28 - 35	7 - 9	22 - 29		
	1604	3400	9 - 11	30 - 37	7 - 9	22 - 30		
102, 120 Models	1699	3600	8 - 10	25 - 33	7 - 9	22 - 29		
	1793	3800	8 - 11	27 - 35	7 - 9	22 - 30		
	1888	4000	9 - 11	29 - 37	7 - 10	24 - 33		
	1982	4200	10 - 12	32 - 40	8 - 11	26 - 35		
	2076	4400	10 - 13	34 - 42	9 - 11	28 - 37		
150 Models	2643	5600	12 - 15	39 - 49	9 - 11	28 - 37		
	2737	5800	13 - 16	42 - 51	9 - 12	29 - 38		
	2831	6000	13 - 17	44 - 54	12 - 15	40 - 50		
	2926	6200	14 - 17	45 - 55	13 - 16	42 - 51		
	3020	6400	14 - 17	46 - 55	13 - 16	43 - 52		
	3115	6600	14 - 17	47 - 56	14 - 17	45 - 56		

¹ Throw is the horizontal or vertical distance an air stream travels on leaving the outlet or diffuser before the maximum velocity is reduced to 15 m (50 ft.) per minute. Four sides open.

ELECTRICAL/ELECTRIC HEAT DATA - STANDARD EFFICIENCY

	KHA092S4	KHA102S4	KHA120S4	KHA150S4									
¹ Voltage - 50hz 3 Phase with neutral	380/420V	380/420V	380/420V	380/420V									
Compressor 1	Rated Load Amps	6.1	6.3	7.8									
	Locked Rotor Amps	41	55	51.5									
Compressor 2	Rated Load Amps	6.1	6.3	7.8									
	Locked Rotor Amps	41	55	51.5									
Outdoor Fan Motors	Full Load Amps (total)	(2) 1.3 (2.6)	(2) 1.5 (3)	(2) 1.5 (3)									
				(3) 1.3 (3.9)									
Power Exhaust (1) 0.25 kW (0.33 HP)	Full Load Amps	1.3	1.3	1.3									
Indoor Blower Motor	kW	1.5 3.6	2.2 8.2	3.7 5.3	1.5 3.6	2.2 5.3	3.7 8.2	1.5 3.6	2.2 5.3	3.7 8.2			
² Maximum Overcurrent Protection	Unit Only	25	25	30	25	25	30	30	30	35	35	40	40
	With 0.25 kW (0.33 HP) Power Exhaust	25	25	30	25	30	35	30	30	35	40	40	40
³ Minimum Circuit Ampacity	Unit Only	20	22	26	21	23	26	25	26	29	30	32	34
	With 0.25 kW (0.33 HP) Power Exhaust	22	23	27	23	24	28	26	28	31	31	33	36

ELECTRIC HEAT DATA

Electric Heat Voltage		420V	420V	420V	420V	420V	420V	420V	420V	420V	420V	420V	420V
² Maximum Overcurrent Protection	Unit+ ⁴ Electric Heat	5.7 kW	30	35	40	35	35	40	---	---	---	---	---
		11.5 kW	40	45	45	45	45	50	45	50	50	50	60
		17.2 kW	50	60	60	60	60	60	60	60	60	70	70
		23 kW	60	70	70	70	70	70	70	70	70	80	80
		34.5 kW	80	90	90	80	90	90	90	90	90	100	100
		45.9 kW	---	---	---	---	---	90	90	100	100	100	100
³ Minimum Circuit Ampacity	Unit+ ⁴ Electric Heat	5.7 kW	30	32	35	31	33	36	---	---	---	---	---
		11.5 kW	40	42	45	41	43	46	44	46	49	50	51
		17.2 kW	50	52	55	51	53	56	54	56	59	59	61
		23 kW	60	62	65	61	62	66	64	66	69	69	71
		34.5 kW	80	81	85	80	82	86	84	86	89	89	91
		45.9 kW	---	---	---	---	---	88	89	92	93	95	98
² Maximum Overcurrent Protection	Unit+ ⁴ Electric Heat and 0.25 kW (0.33 HP) Power Exhaust	5.7 kW	35	35	40	35	35	40	---	---	---	---	---
		11.5 kW	45	45	50	45	45	50	50	50	50	60	60
		17.2 kW	60	60	60	60	60	60	60	60	60	70	70
		23 kW	70	70	70	70	70	70	70	70	70	80	80
		34.5 kW	90	90	90	90	90	90	90	90	90	100	100
		45.9 kW	---	---	---	---	---	90	100	100	100	100	100
³ Minimum Circuit Ampacity	Unit+ ⁴ Electric Heat and 0.25 kW (0.33 HP) Power Exhaust	5.7 kW	32	33	37	32	34	37	---	---	---	---	---
		11.5 kW	41	43	47	42	44	47	46	47	50	51	53
		17.2 kW	51	53	56	52	54	57	56	57	60	61	65
		23 kW	61	63	66	62	64	66	65	67	70	71	75
		34.5 kW	81	83	86	82	83	86	85	87	90	90	95
		45.9 kW	---	---	---	---	---	89	91	94	94	96	99

¹ Extremes of operating range are plus and minus 10% of line voltage.

² Heating / Air Conditioning / Refrigeration (HACR) type breaker or fuse.

³ Refer to local codes to determine wire, fuse and disconnect size requirements.

⁴ Nominal kW based on 420V-3ph-50hz.

ELECTRICAL/ELECTRIC HEAT DATA - HIGH EFFICIENCY

		KHB092H4		KHB102H4		
¹ Voltage - 50hz 3 Phase with neutral		380/420V		380/420V		
Compressor 1	Rated Load Amps	6.1		6.3		
	Locked Rotor Amps	41		55		
Compressor 2	Rated Load Amps	6.1		6.3		
	Locked Rotor Amps	41		55		
Outdoor Fan Motors	Full Load Amps	(2) 2.8		(2) 2.8		
	(total)	5.6		5.6		
Power Exhaust (1) 0.25 kW (0.33 HP)	Full Load Amps	1.3		1.3		
Indoor Blower Motor	kW	1.5	2.2	3.7	1.5	2.2
	Full Load Amps	3.6	5.3	8.2	3.6	5.3
² Maximum Overcurrent Protection	Unit Only	25	30	35	25	30
	With 0.25 kW (0.33 HP) Power Exhaust	30	30	35	30	35
³ Minimum Circuit Ampacity	Unit Only	23	25	29	24	26
	With 0.25 kW (0.33 HP) Power Exhaust	25	26	30	25	27

ELECTRIC HEAT DATA

Electric Heat Voltage		420V	420V	420V	420V	420V	420V
² Maximum Overcurrent Protection	Unit+ ⁴ Electric Heat	5.7 kW	35	35	40	35	35
		11.5 kW	45	45	50	45	45
		17.2 kW	60	60	60	60	60
		23 kW	70	70	70	70	70
		34.5 kW	90	90	90	90	90
³ Minimum Circuit Ampacity	Unit+ ⁴ Electric Heat	5.7 kW	33	35	38	34	35
		11.5 kW	43	45	48	44	45
		17.2 kW	53	55	58	53	55
		23 kW	63	65	68	63	65
		34.5 kW	83	84	88	83	85
² Maximum Overcurrent Protection	Unit+ ⁴ Electric Heat and 0.25 kW (0.33 HP) Power Exhaust	5.7 kW	35	40	45	35	40
		11.5 kW	45	50	50	45	50
		17.2 kW	60	60	60	60	60
		23 kW	70	70	70	70	70
		34.5 kW	90	90	90	90	90
³ Minimum Circuit Ampacity	Unit+ ⁴ Electric Heat and 0.25 kW (0.33 HP) Power Exhaust	5.7 kW	35	36	40	35	37
		11.5 kW	44	46	50	45	47
		17.2 kW	54	56	59	55	56
		23 kW	64	66	69	65	66
		34.5 kW	84	86	89	84	86

¹ Extremes of operating range are plus and minus 10% of line voltage.

² Heating / Air Conditioning / Refrigeration (HACR) type breaker or fuse.


³ Refer to local codes to determine wire, fuse and disconnect size requirements.

⁴ Nominal kW based on 420V-3ph-50hz.

ELECTRIC HEAT CAPACITIES

Volts Input	5.7 kW			11.5 kW			17.2 kW			23 kW			34.5 kW			45.9 kW		
	kW Input	Btuh Output	No. of Stages															
380	4.7	16 000	1	9.4	32 100	1	14.1	48 200	1	18.8	64 200	2	28.2	96 300	2	37.6	128 400	2
400	5.2	17 800	1	10.4	35 500	1	15.6	53 300	1	20.9	71 400	2	31.2	106 600	2	41.6	142 100	2
420	5.7	19 500	1	11.5	39 300	1	17.2	58 700	1	23	78 500	2	34.5	117 500	2	45.9	156 800	2

UNIT CLEARANCES - MM (INCHES)

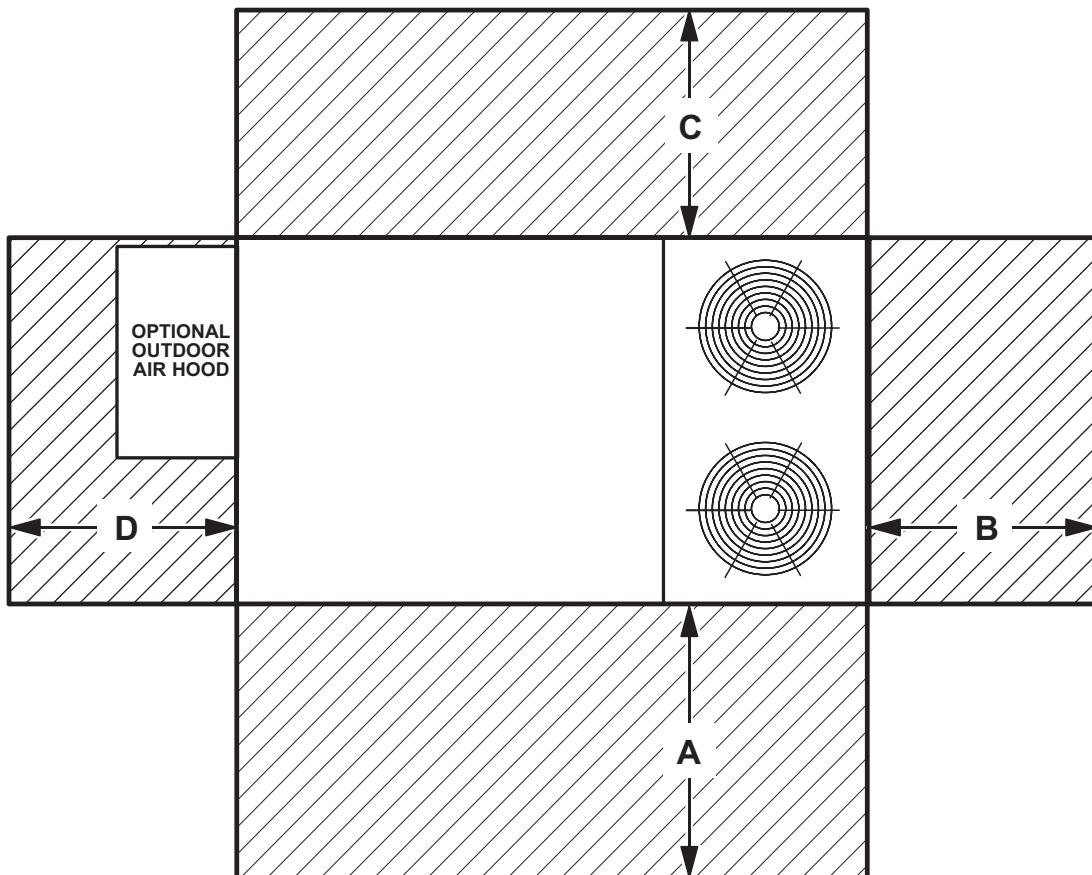

¹ Unit Clearance	A		B		C		D		Top Clearance
	mm	in.	mm	in.	mm	in.	mm	in.	
Service Clearance	1524	60	914	36	914	36	1524	60	Unobstructed
Minimum Operation Clearance	914	36	914	36	914	36	914	36	

NOTE - Entire perimeter of unit base requires support when elevated above the mounting surface.

¹ Service Clearance - Required for removal of serviceable parts.

Minimum Operation Clearance - Required clearance for proper unit operation.

OUTDOOR SOUND DATA

Unit Model Number	Octave Band Linear Sound Power Levels dBA, re 10⁻¹² Watts Center Frequency - Hz							¹ Sound Rating Number (SRN) (dBA)
	125	250	500	1000	2000	4000	8000	
KHA092, 102 and 120	76	79	84	83	79	73	66	88
KHA150	77	80	85	84	79	74	66	88
KHB092, 102	72	75	76	73	67	60	50	86

Note - The octave sound power data does not include tonal corrections.

¹ Sound Rating Number according to ARI Standard 270-95 or ARI Standard 370-2001 (includes pure tone penalty). "SRN" is the overall A-Weighted Sound Power Level, (L_{WA}), dB (100 Hz to 10,000 Hz).

THIS PAGE INTENTIONALLY BLANK

WEIGHT DATA

Model Number	Net		Shipping		Model Number	Net		Shipping	
	kg	Ibs.	kg	Ibs.		kg	Ibs.	kg	Ibs.
KHA092S Base Unit	477	1052	516	1137	KHB092H Base Unit	487	1073	526	1158
KHA092S Max. Unit	548	1209	587	1294	KHB092H Max. Unit	569	1253	608	1340
KHA102S Base Unit	492	1084	530	1169	KHB102H Base Unit	488	1075	527	1160
KHA102S Max. Unit	563	1241	601	1326	KHB102H Max. Unit	570	1255	608	1340
KHA120S Base Unit	522	1150	560	1235					
KHA120S Max. Unit	596	1314	635	1399					
KHA150S Base Unit	612	1350	651	1435					
KHA150S Max. Unit	687	1514	725	1599					

OPTIONS / ACCESSORIES





Model Number	Shipping Weight				
	kg	Ibs.			
ECONOMIZER / OUTDOOR AIR / EXHAUST					
Economizer					
Economizer Dampers	27	60			
Barometric Relief Dampers (downflow)	4	8			
Barometric Relief Damper Hood (downflow)	11	25			
Outdoor Air Hood (downflow)	10	23			
Outdoor Air Dampers					
Outdoor Air Damper Section (downflow) - Automatic	4	9			
Outdoor Air Damper Section (downflow) - Manual	1	2			
Outdoor Air Damper Hood (downflow)	4	9			
Power Exhaust					
	14	31			
ELECTRIC HEAT					
5.7 kW	23	50			
11.5 kW	23	50			
17.2 kW	26	57			
23 kW	26	57			
34.5 kW	27	59			
45.9 kW	31	68			
ROOF CURBS					
Hybrid Roof Curbs, Downflow					
203 mm height	27	60			
356 mm height	39	85			
457 mm height	45	100			
610 mm height	57	125			
Adjustable Pitch Curb, Downflow					
356 mm height	82	191			
CEILING DIFFUSERS					
Step-Down					
RTD11-95S	118	54			
RTD11-135S	135	61			
RTD11-185S	168	76			
Flush					
FD11-95S	118	54			
FD11-135S	135	61			
FD11-185S	168	76			
Transitions					
C1DIFF30B-1	14	30			
C1DIFF31B-1	15	32			
C1DIFF32B-1	16	36			
PACKAGING					
LTL Packaging (less than truck load)	48	105			

DIMENSIONS - UNIT - MM (INCHES) - 092-102-120 MODELS

Model No.	CORNER WEIGHTS												CENTER OF GRAVITY											
	AA		BB		CC		DD		EE		FF													
	Base	Max.	Base	Max.	Base	Max.	Base	Max.	Base	Max.	Base	Max.	mm	in.	mm	in.	mm	in.	mm	in.				
	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	mm	in.	mm	in.	mm	in.	mm	in.				
KHA092	120	264	140	310	108	237	123	271	117	258	131	290	133	293	154	339	1181	46.5	1156	45.5	622	24.5	648	25.5
KHB092	129	283	150	331	108	237	126	277	113	249	132	290	138	304	161	355	1118	44	1092	43	686	27	711	28
KHA102	123	272	144	318	111	244	126	278	121	266	135	297	137	302	158	348	1181	46.5	1156	45.5	622	24.5	648	25.5
KHB102	129	284	151	332	108	237	126	277	113	249	132	291	138	304	161	355	1118	44	1092	43	686	27	711	28
KHA120	129	284	151	333	120	264	135	298	131	288	145	320	143	315	165	363	1181	46.5	1156	45.5	622	24.5	648	25.5

Std. Unit - The unit with NO INTERNAL OPTIONS.

Max. Unit - The unit with ALL INTERNAL OPTIONS Installed. (Economizer, Standard Static Power Exhaust Fans, Controls, etc.). Does not include accessories external to unit or high static power exhaust.

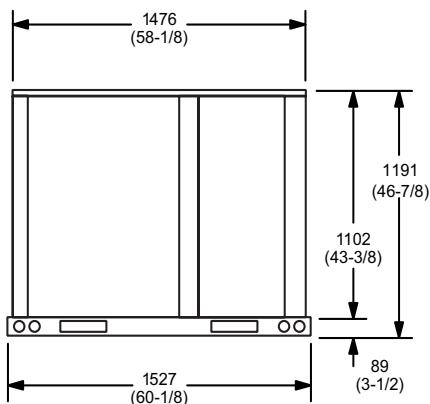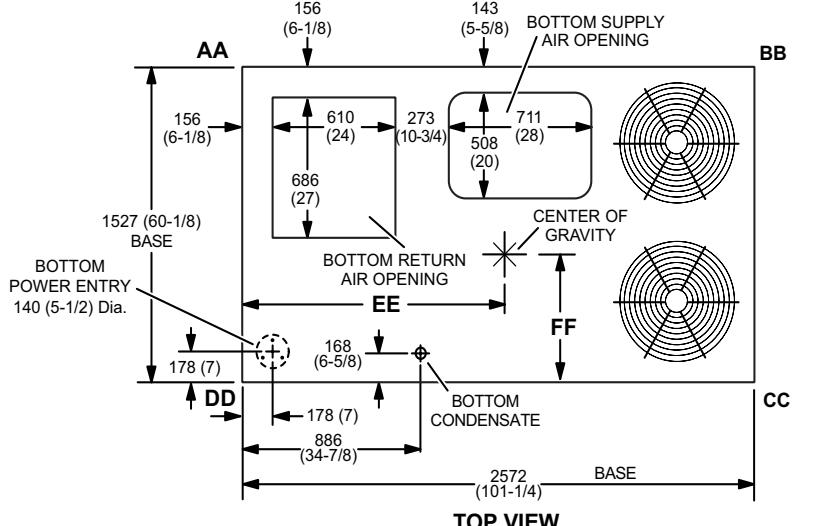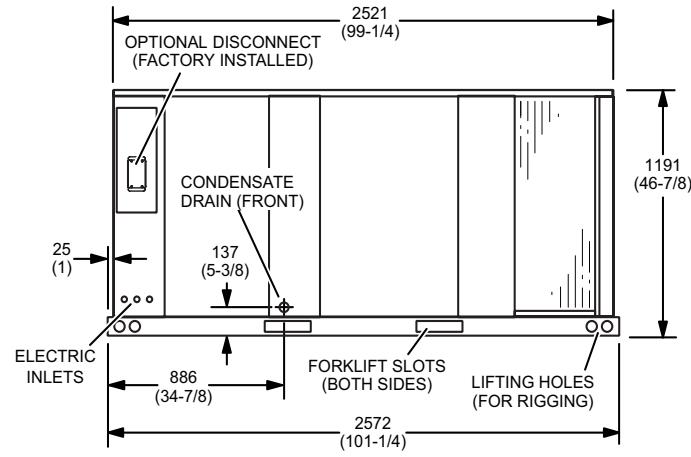
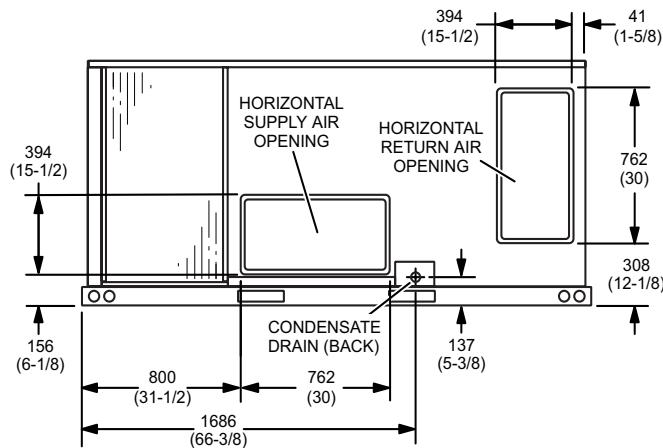

END VIEW

SIDE VIEW

SIDE VIEW
(Horizontal Openings)

DIMENSIONS - UNIT - MM (INCHES) - 150 MODELS


Model No.	CORNER WEIGHTS										CENTER OF GRAVITY													
	AA		BB		CC		DD		EE		FF													
	Base	Max.	Base	Max.	Base	Max.	Base	Max.	Base	Max.	Base	Max.	mm	in.	mm	in.	mm	in.						
	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	mm	in.	mm	in.	mm	in.						
KHA150	158	348	180	398	137	303	153	337	146	321	160	353	171	377	193	426	1181	46.5	1156	45.5	622	24.5	648	25.5

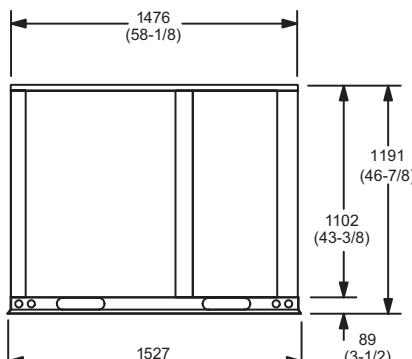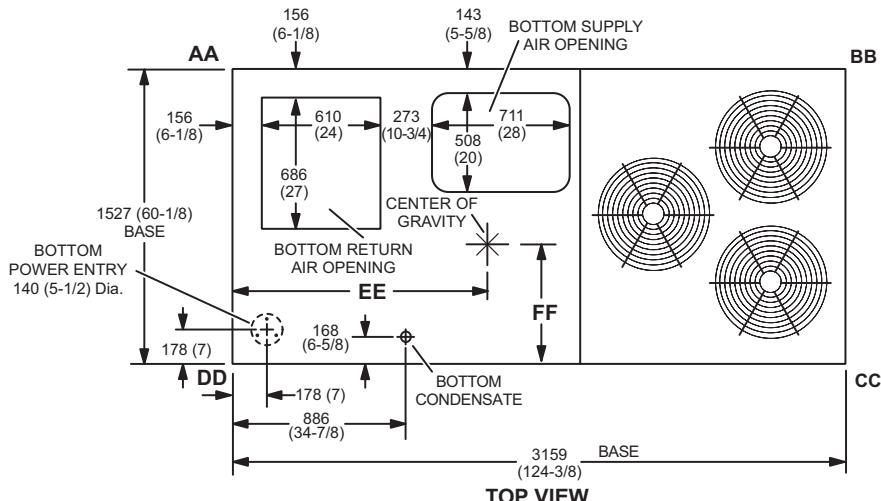Std. Unit - The unit with NO INTERNAL OPTIONS.


Max. Unit - The unit with ALL INTERNAL OPTIONS Installed. (Economizer, Standard Static Power Exhaust Fans, Controls, etc.). Does not include accessories external to unit or high static power exhaust.



END VIEW

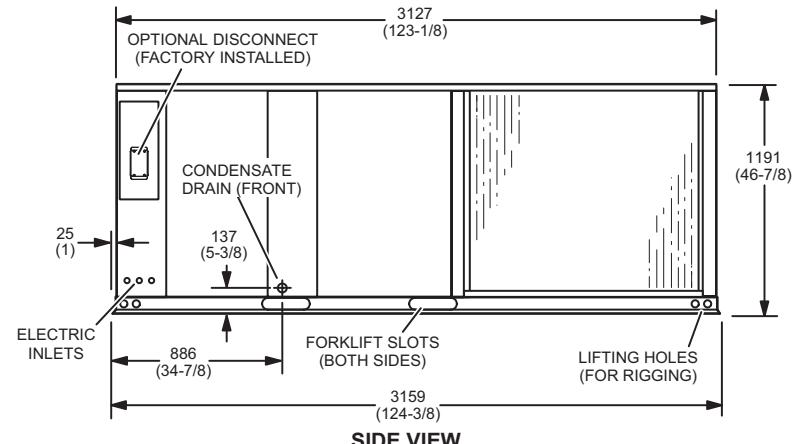



SIDE VIEW

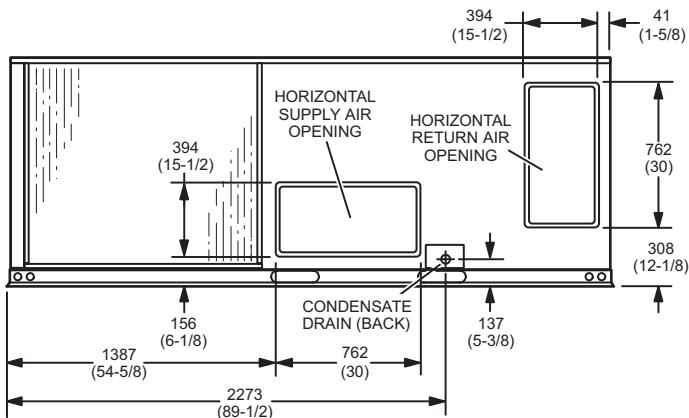

SIDE VIEW
(Horizontal Openings)


DIMENSIONS - ACCESSORIES - MM (INCHES)

UNIT ON CURB LOCATION – KHA150

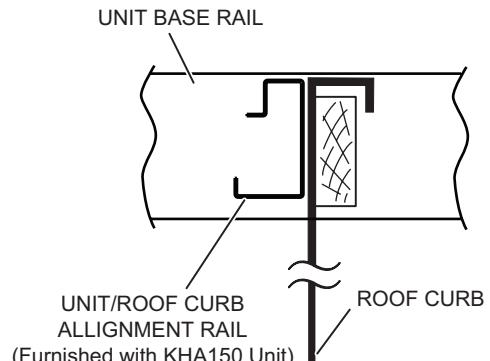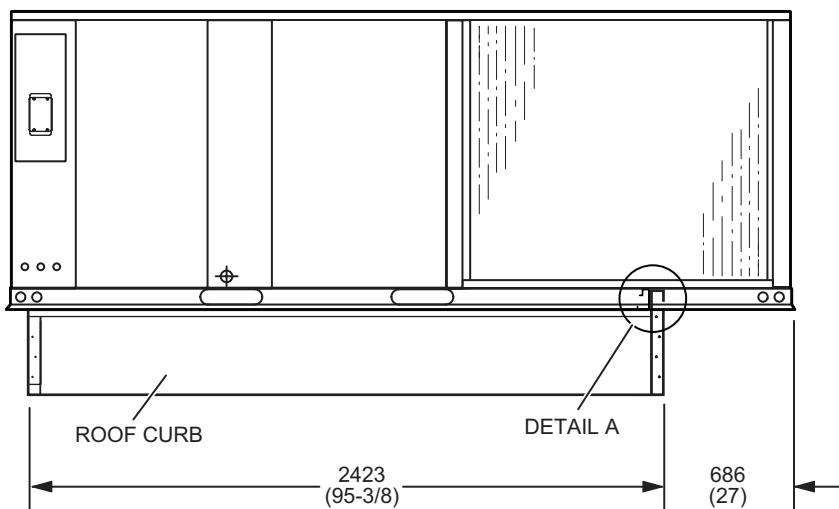

SIDE VIEW



OUTDOOR AIR HOOD DETAIL

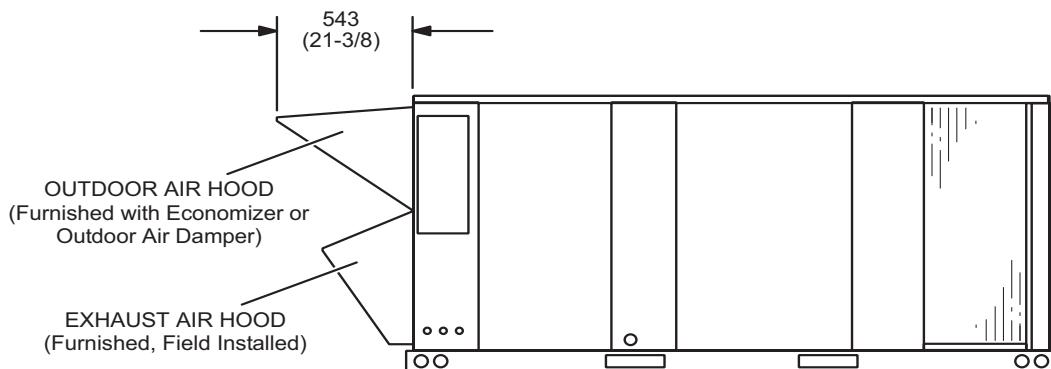

DIMENSIONS - ACCESSORIES - MM (INCHES)

HORIZONTAL ECONOMIZER APPLICATION


(With Furnished Barometric Relief Dampers and Optional Horizontal Discharge Kit - Required)

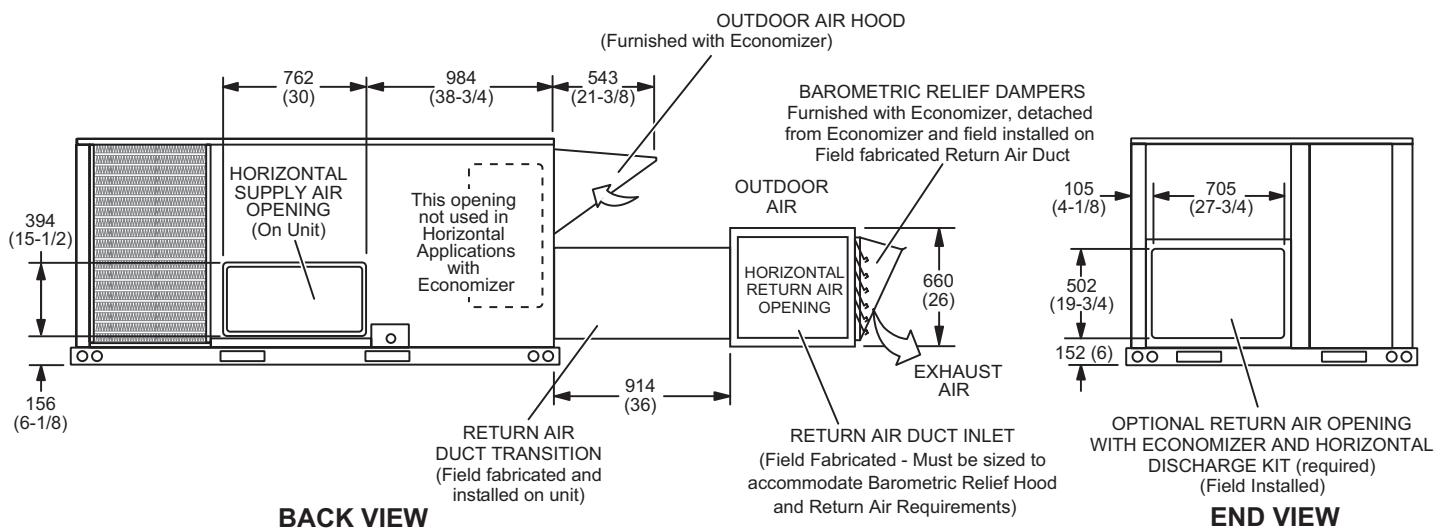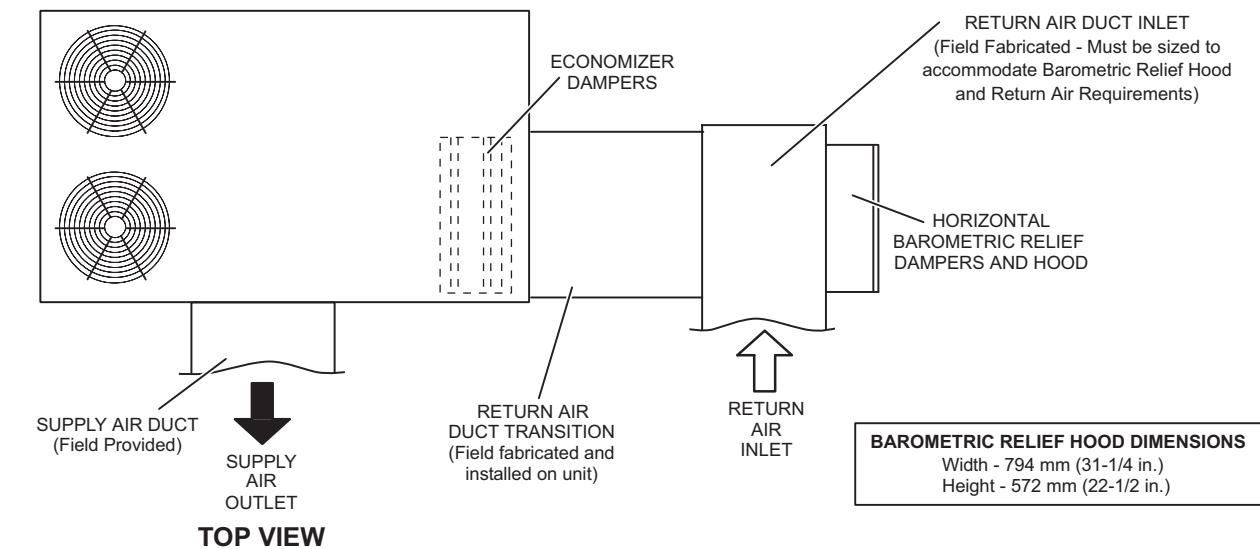


NOTE - Return Air Duct and Transition must be supported.

BAROMETRIC RELIEF DAMPERS (Furnished with Economizer)

(Field installed in horizontal return air duct adjacent to unit)

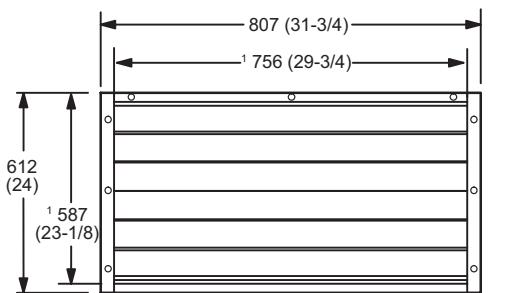

FRONT VIEW





SIDE VIEW

* NOTE - Opening size required in return air duct

DIMENSIONS - ACCESSORIES - MM (INCHES)

HORIZONTAL ECONOMIZER APPLICATION


(with Optional Low Profile Horizontal Barometric Relief Dampers and Horizontal Discharge Kit - Required)

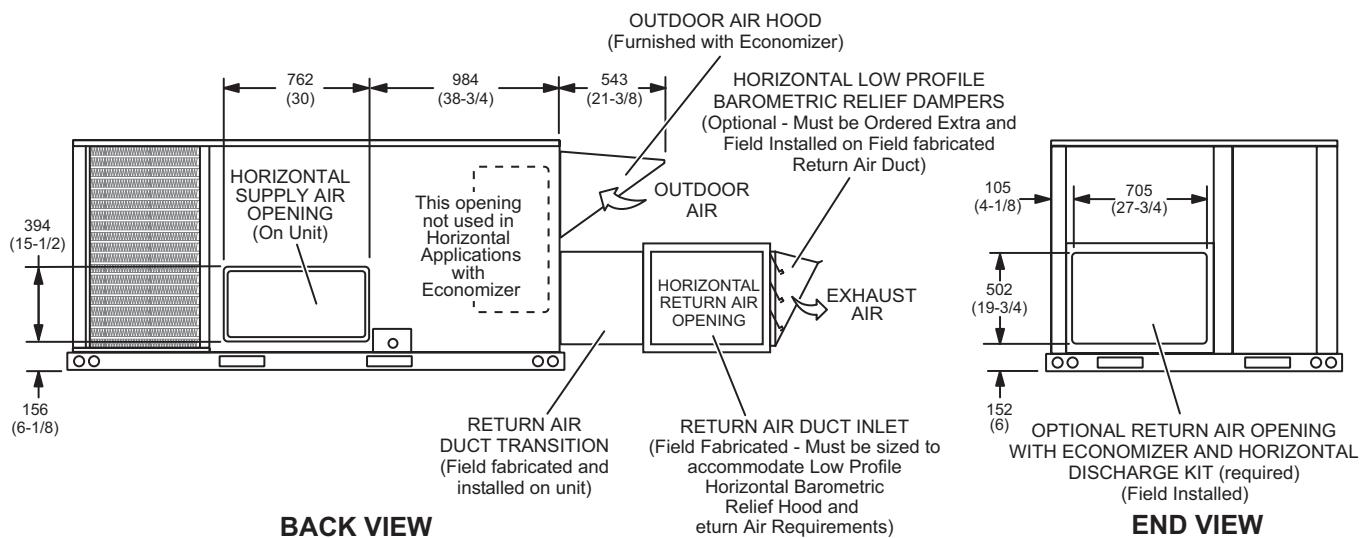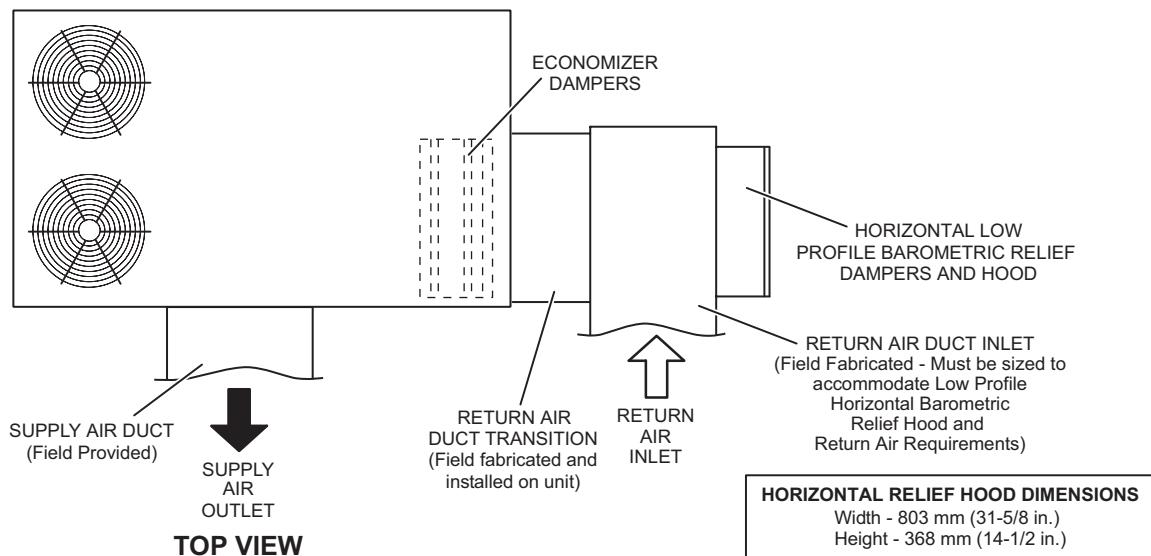

NOTE - Return Air Duct and Transition must be supported.

HORIZONTAL LOW PROFILE BAROMETRIC RELIEF DAMPERS


(Field installed in horizontal return air duct adjacent to unit)

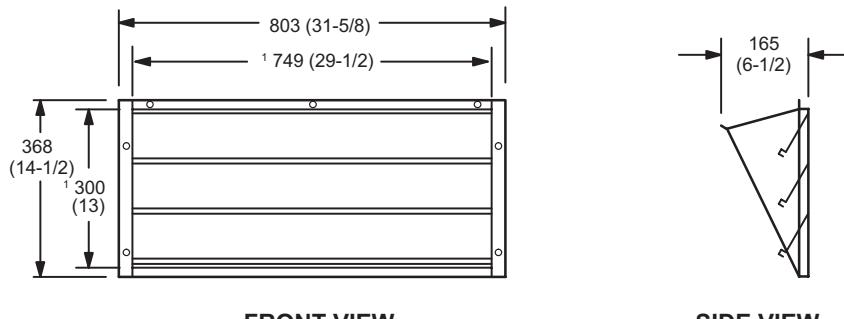


¹ NOTE - Opening size required in return air duct.

DIMENSIONS - ACCESSORIES - MM (INCHES)


HYBRID ROOF CURBS - DOUBLE DUCT OPENING

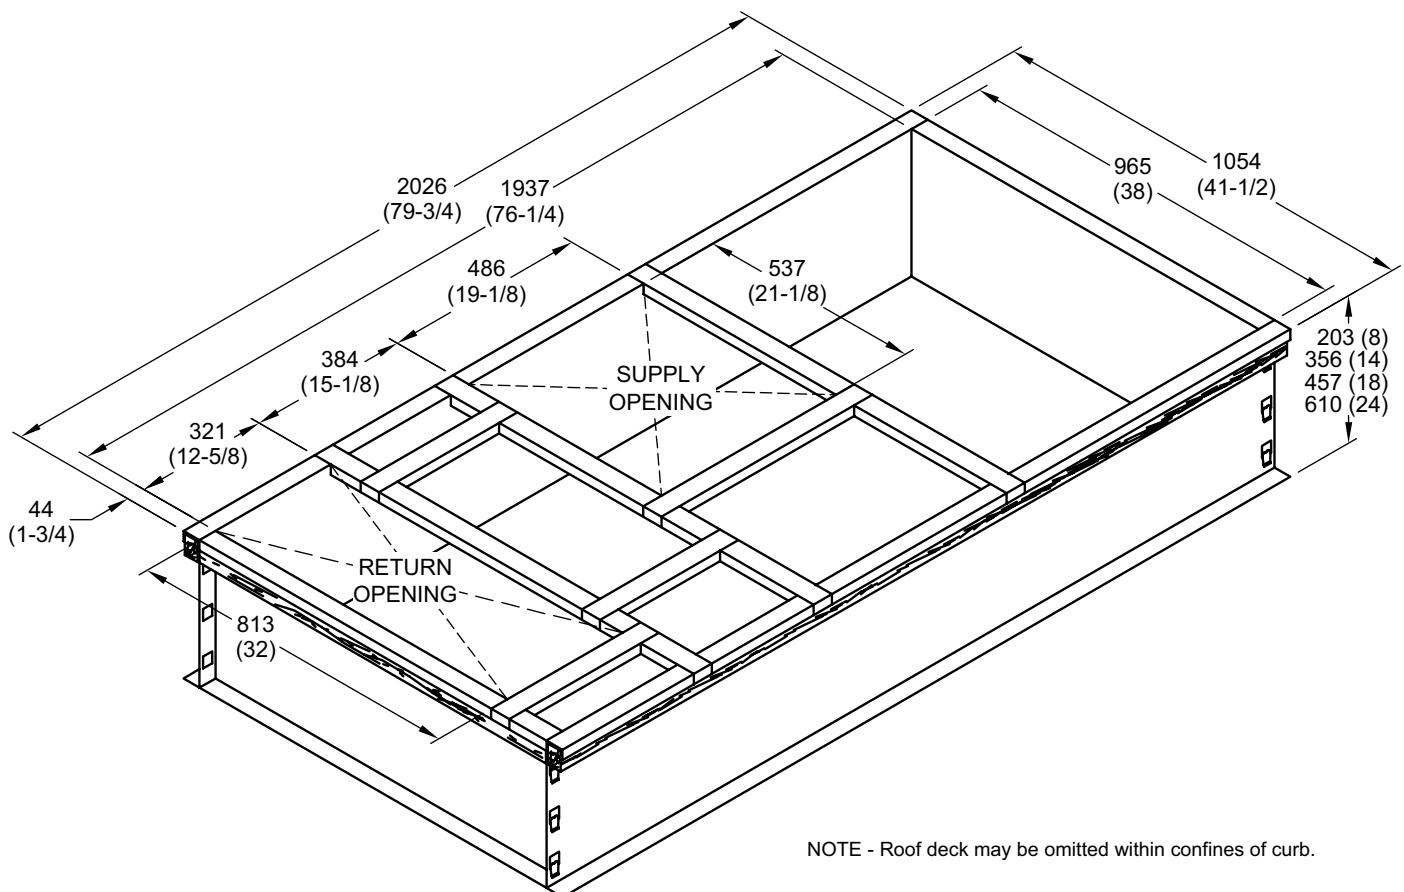

TYPICAL FLASHING DETAIL FOR ROOF CURB

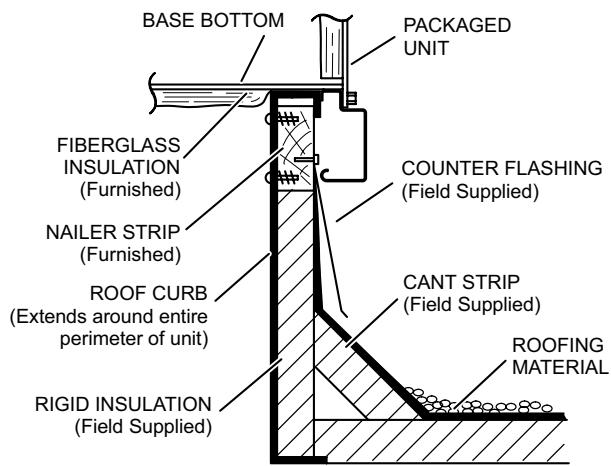


DETAIL ROOF CURB

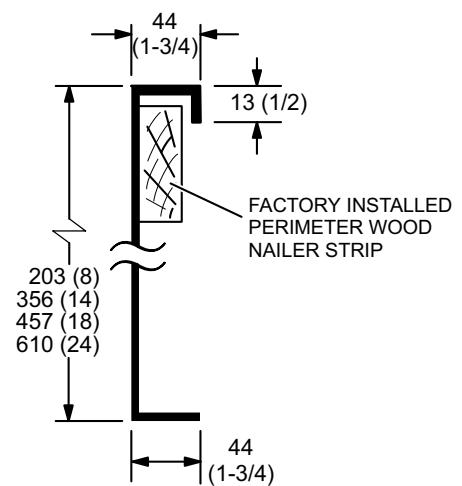


DIMENSIONS - ACCESSORIES - MM (INCHES)

ADJUSTABLE PITCH CURBS - DOUBLE DUCT OPENING

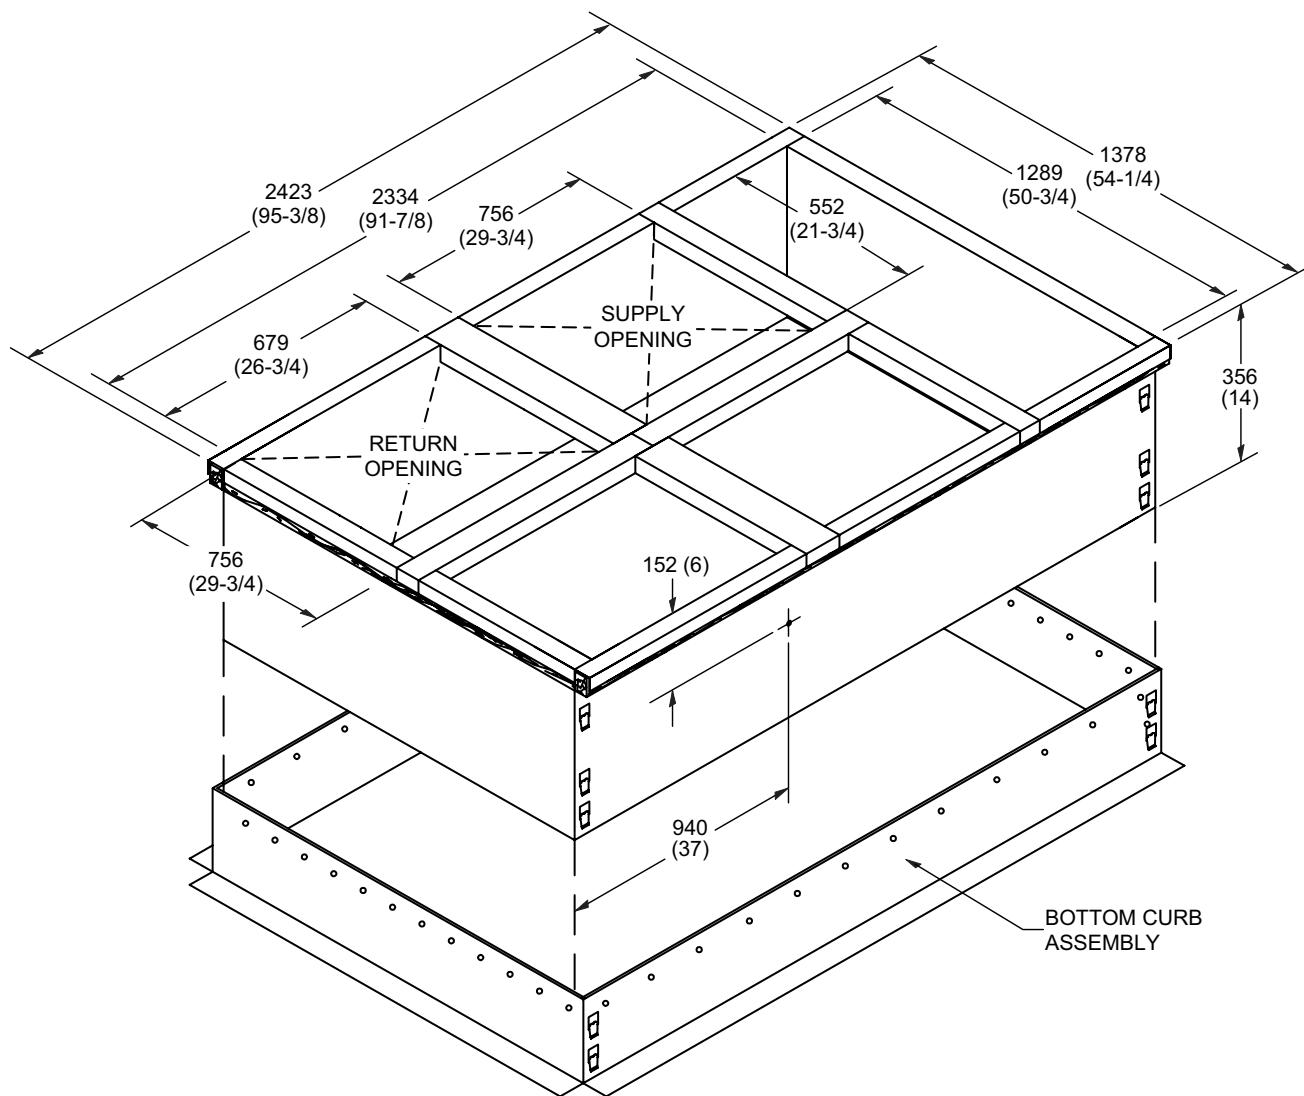


NOTE - Maximum slope pitch is 19 mm per 305 mm (3/4 in. per 1 foot) in any one direction.

TYPICAL FLASHING DETAIL FOR ROOF CURB

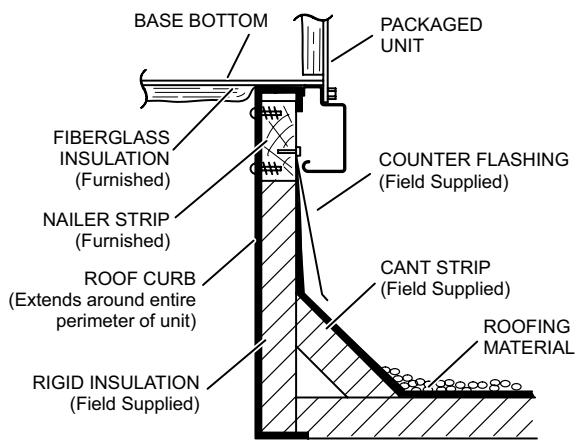


DETAIL ROOF CURB

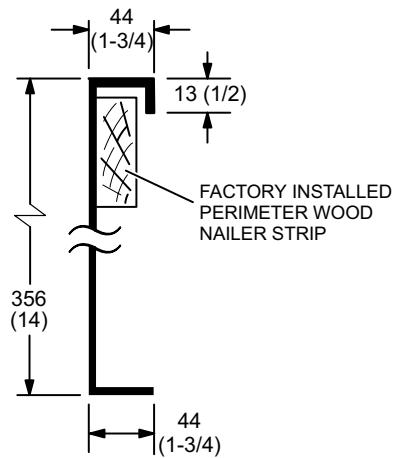

DIMENSIONS - ACCESSORIES - MM (INCHES)


ROOF CURBS WITH SUPPLY & RETURN AIR TRANSITIONS FOR CEILING DIFFUSERS

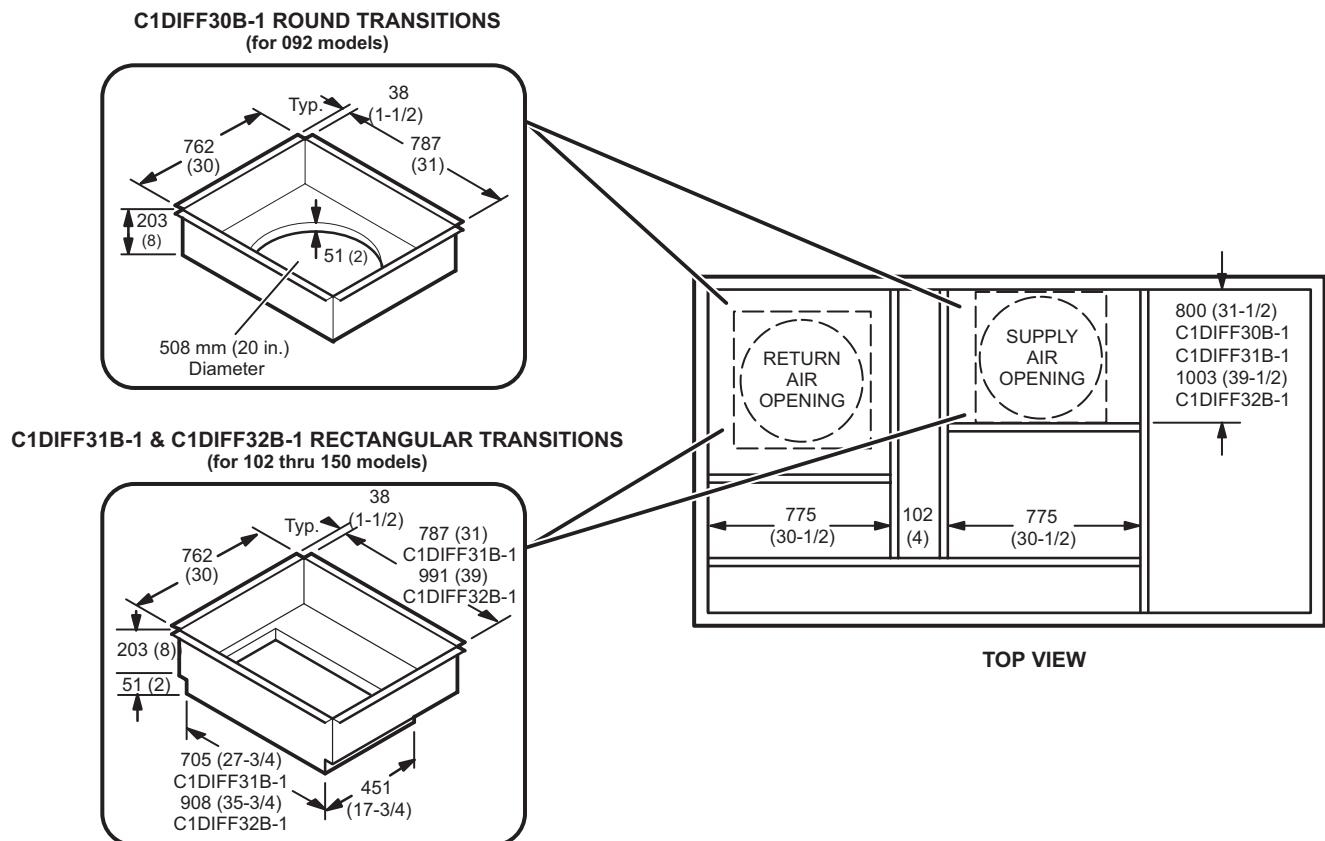


DIMENSIONS - ACCESSORIES - MM (INCHES)

COMBINATION CEILING SUPPLY AND RETURN DIFFUSERS

STEP-DOWN CEILING DIFFUSER

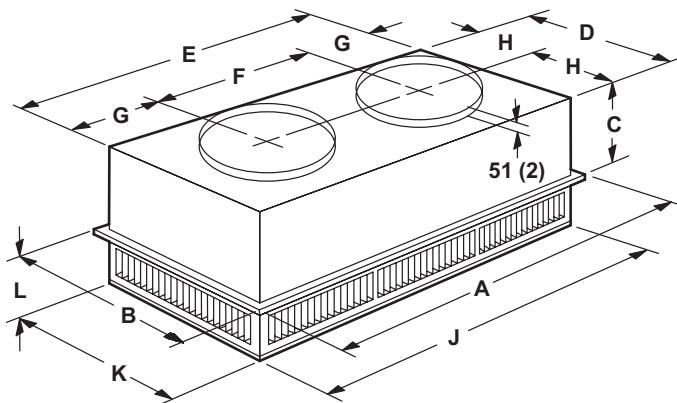

FLUSH CEILING DIFFUSER

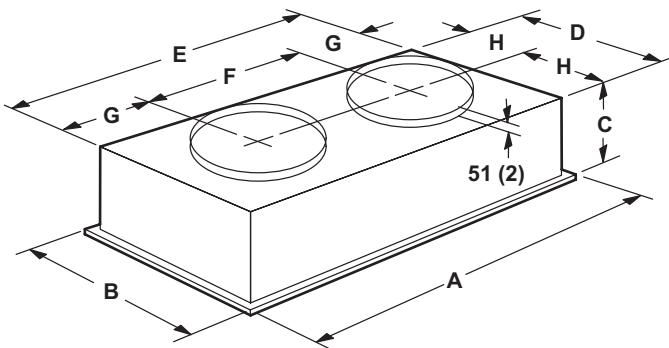


Model Number		RTD11-95S	
A	mm	1159	
	in.	47-5/8	
B	mm	752	
	in.	29-5/8	
C	mm	365	
	in.	14-3/8	
D	mm	699	
	in.	27-1/2	
E	mm	1158	
	in.	45-1/2	
F	mm	572	
	in.	22-1/2	
G	mm	292	
	in.	11-1/2	
H	mm	349	
	in.	13-3/4	
J	mm	1156	
	in.	45-1/2	
K	mm	699	
	in.	27-1/2	
L	mm	206	
	in.	8-1/8	
Duct Size	mm	508 round	
	in.	20 round	

Model Number		FD11-95S	
A	mm	1159	
	in.	47-5/8	
B	mm	752	
	in.	29-5/8	
C	mm	422	
	in.	16-5/8	
D	mm	686	
	in.	27	
E	mm	1143	
	in.	45	
F	mm	22-1/2	
	in.	572	
G	mm	286	
	in.	11-1/4	
H	mm	343	
	in.	13-1/2	
Duct Size	mm	508 round	
	in.	20 round	


DIMENSIONS - ACCESSORIES - MM (INCHES)

COMBINATION CEILING SUPPLY AND RETURN DIFFUSERS

STEP-DOWN CEILING DIFFUSER

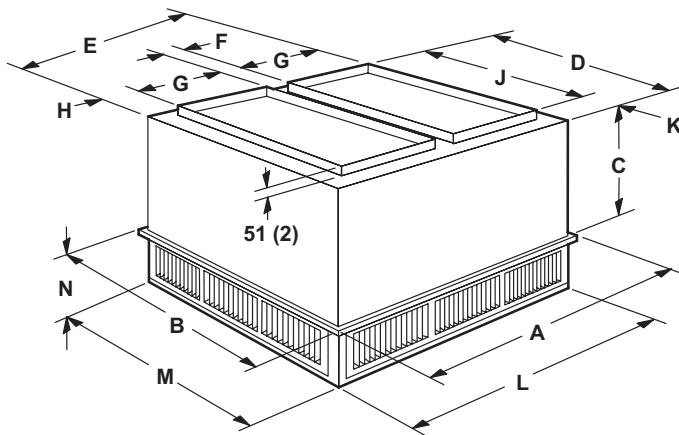

FLUSH CEILING DIFFUSER

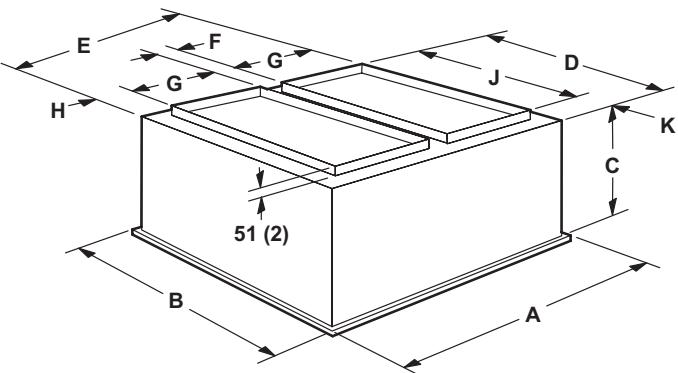

Model Number		RTD11-135S	RTD11-185S
A	mm	1210	1210
	in.	47-5/8	47-5/8
B	mm	905	1210
	in.	35-5/8	47-5/8
C	mm	524	625
	in.	20-5/8	24-5/8
D	mm	851	1156
	in.	33-1/2	45-1/2
E	mm	1156	1156
	in.	45-1/2	45-1/2
F	mm	114	114
	in.	4-1/2	4-1/2
G	mm	457	457
	in.	18	18
H	mm	64	64
	in.	2-1/2	2-1/2
J	mm	711	914
	in.	28	36
K	mm	70	121
	in.	2-3/4	4-3/4
L	mm	1156	1156
	in.	45-1/2	45-1/2
M	mm	851	1156
	in.	33-1/2	45-1/2
N	mm	232	257
	in.	9-1/8	10-1/8
Duct Size	mm	457 x 711	457 x 914
	in.	18 x 28	18 x 36

Model Number		FD11-135S	FD11-185S
A	mm	1210	1210
	in.	47-5/8	47-5/8
B	mm	905	1210
	in.	35-5/8	47-5/8
C	mm	591	743
	in.	23-1/4	29-1/4
D	mm	838	1143
	in.	33	45
E	mm	1143	1143
	in.	45	45
F	mm	112	112
	in.	4-1/2	4-1/2
G	mm	457	457
	in.	18	18
H	mm	57	57
	in.	2-1/4	2-1/4
J	mm	711	914
	in.	28	36
K	mm	64	114
	in.	2-1/2	4-1/2
Duct Size	mm	457 x 711	457 x 914
	in.	18 x 28	18 x 36

REVISIONS

Section	Description
Document	New Product - Added Specifications, Ratings and Dimensions for KHB092 and KHB102 High Efficiency models.



Visit us at www.allied-commercial.com

For the latest technical information, visit us at www.allied-commercial.com

Contact us at 1-800-448-5872

NOTE - Due to Allied Commercial ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

©2016 Allied Air Enterprises LLC, a Lennox International Inc. Company