


PRODUCT SPECIFICATIONS

Bulletin No. ZCB-036-074 (04/2019)


Z-SERIES™

DESIGNED TO FIT. FAST.

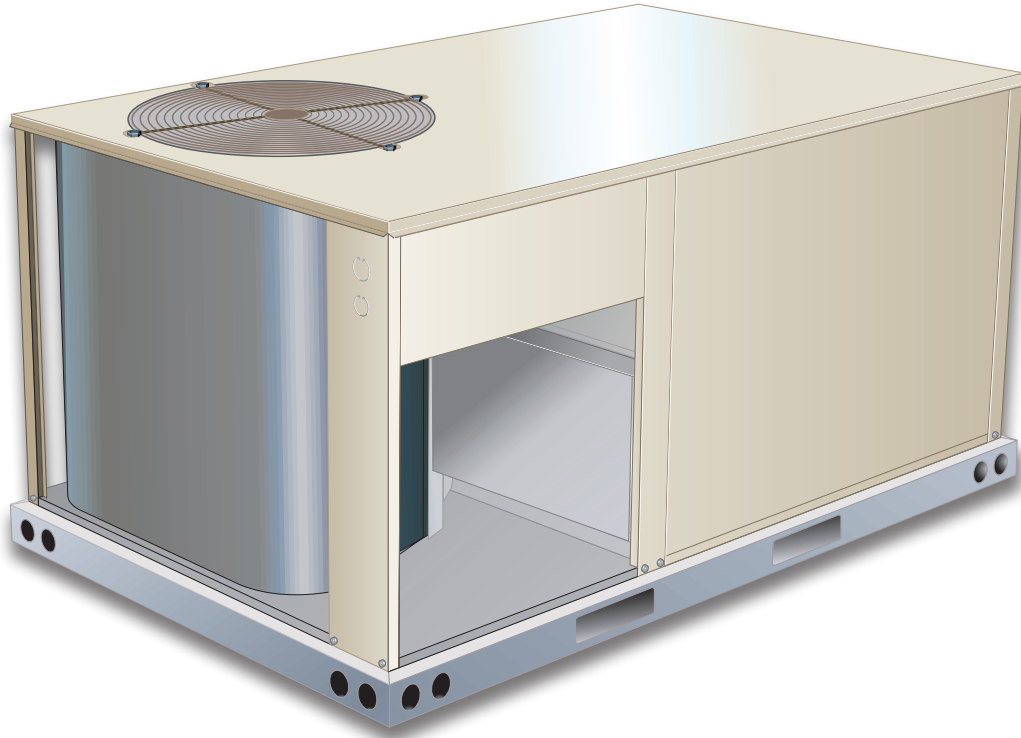


10.5 to 21 kW (3 to 6 Tons)
Net Cooling Capacity – 8.8 to 16.9 kW (30 200 to 57 500 Btuh)
Optional Electric Heat - 3.8 to 23 kW

MODEL NUMBER IDENTIFICATION

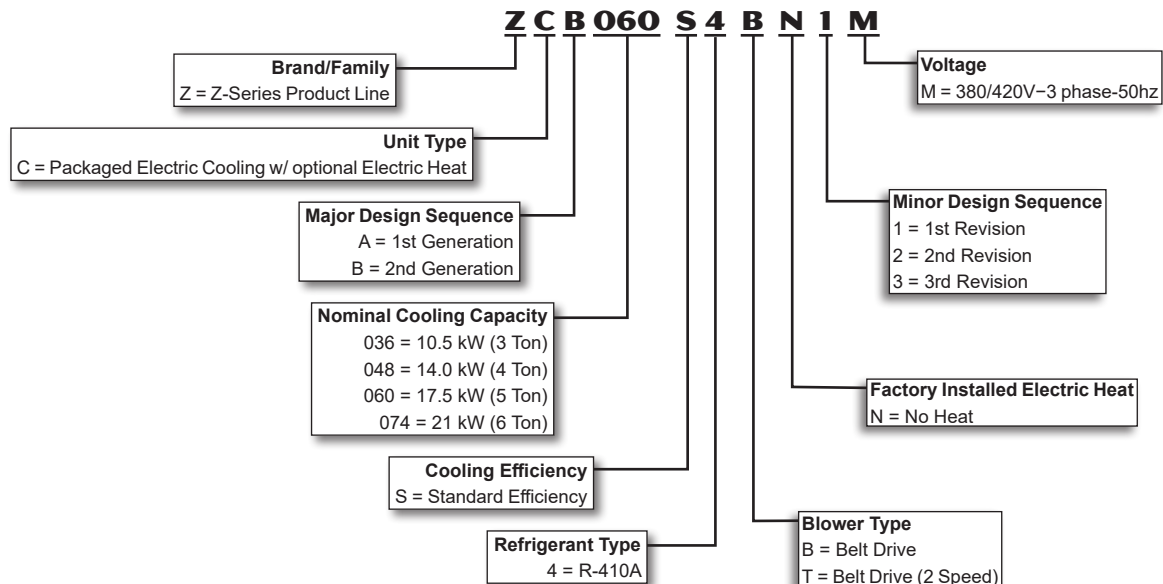

FEATURES AND BENEFITS

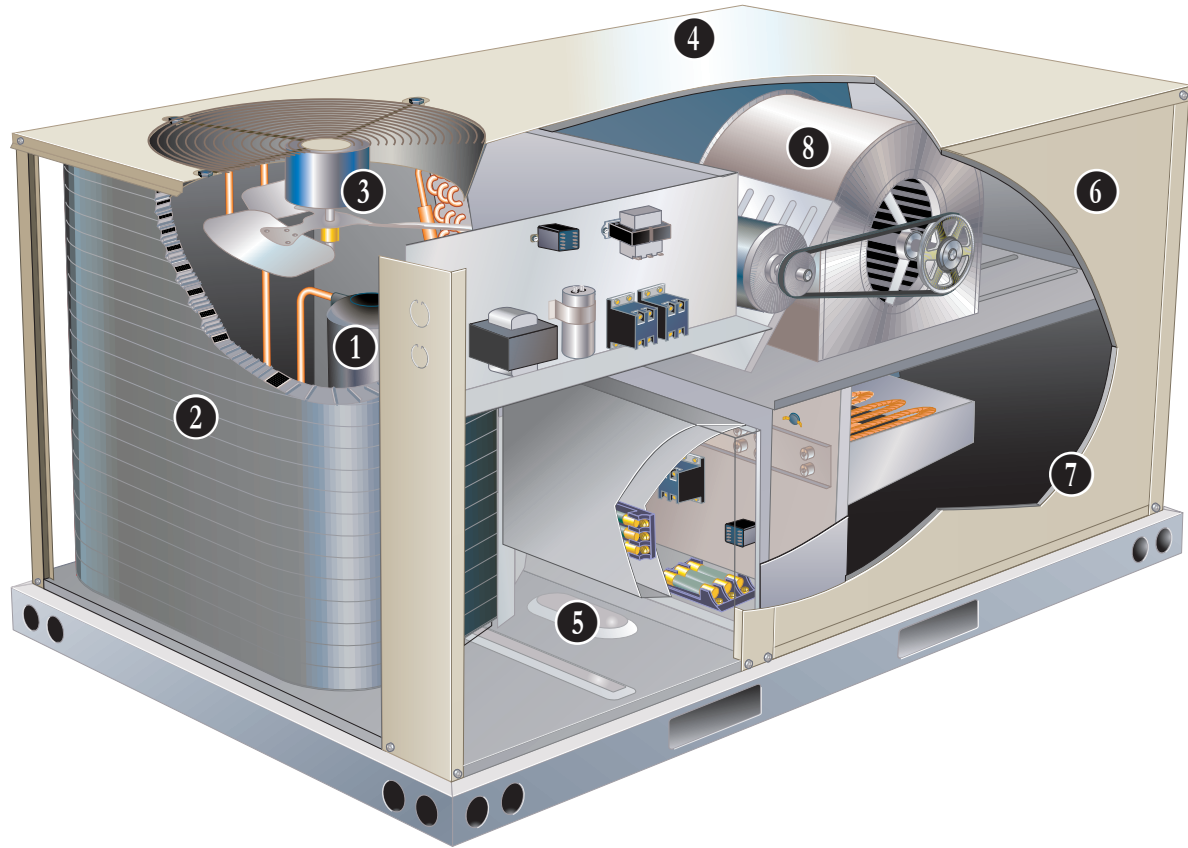

Z-Series rooftop units from Allied are the new standard for cost efficient, reliable rooftop units built for long-lasting performance that can significantly improve indoor environments. Z-Series rooftop units feature:

- **Quick and Easy Retrofit** - Fast installation for replacement of many existing rooftop units - fits high volume competitor's roof curbs.
- **R-410A Refrigerant** - Environmentally friendly.
- **Single Speed Scroll Compressor** - Furnished on 036 through 060 models.
- **Two-Stage Scroll Compressor** - Furnished on 074 models. Allows rooftop units to deliver just the necessary amount of cooling needed to meet the space's demand.
- **Eco-Last™ Coil System** - Smaller, lighter condenser coil.
- **High Pressure Switch** - Protects compressor.
- **Belt Drive Blower Motor** - To maximize air performance.
- **Downflow or Horizontal Airflow** - Easy field conversion.
- **Two Fork Lift Slots on Three Sides** - Easy to pick up and transport units from almost any angle.
- **Corrosion-Resistant Drain Pan** - Provides application flexibility, durability, and improved serviceability.
- **Common Components** - Many maintenance items are standard throughout the entire product line, reducing the need to carry different parts to the job or maintain in inventory.

FEATURES AND BENEFITS

CONTENTS

Blower Data	16
Dimensions - Accessories.	32
Dimensions - Unit	31
Electrical Data.	26
Electric Heat Capacities.	27
Features And Benefits	2
Model Number Identification	1
Optional Conventional Temperature Control Systems	29
Options / Accessories.	8
Outdoor Sound Data	27
Ratings	12
Specifications	10
Unit Clearances.	28
Weight Data.	30

TESTING

Components bonded for grounding to meet safety standards for servicing required by Underwriters Laboratories (UL) and the International Electrotechnical Commission (IEC).

Cooling performance is rated at test conditions included in Air-Conditioning, Heating and Refrigeration Institute (AHRI) Standards 210/240-2008 (10.5 - 17.5 kW) and 340/360-2007 (21 kW models) while operating at rated voltage and air volumes.

International Organization for Standardization (ISO) 9001 Registered Manufacturing Quality System.

COOLING SYSTEM

Designed to maximize sensible and latent cooling performance at design conditions.

System can operate from 2°C to 52°C without any additional controls.

R-410A Refrigerant

Non-chlorine based, ozone friendly, R-410A.

Unit is factory pre-charged with refrigerant. See Specifications Table.

1 Single Speed Scroll Compressor (036 through 060)

Resiliently mounted on rubber grommets for quiet operation.

Scroll compressors for high performance, reliability and quiet operation.

Two-Stage Compressor (074 Models)

Two-stage scroll compressors for increased part load efficiency, high performance, reliability and quiet operation.

Resiliently mounted on rubber grommets for quiet operation.

Compressor Crankcase Heater

Protects against refrigerant migration that can occur during low ambient operation.

Thermal Expansion Valve (074 Models)

Assures optimal performance throughout the application range.

Removable element head.

Refrigerant Metering Orifice (036 through 060 Models)

Accurately meters refrigerant in system.

Refrigerant control is accomplished by exact sizing of refrigerant metering orifice.

High Pressure Switch

Protects the compressor from overload conditions such as dirty condenser coils, blocked refrigerant flow, or loss of outdoor fan operation.

Automatic reset.

Filter/Drier

High capacity filter/drier protects the system from dirt and moisture.

2 Eco-Last™ Coil System

Condenser coil features lightweight, all aluminum brazed fin construction.


Constructed of three components:

a flat extrusion tube, fins in-between the flat extrusion tube and two refrigerant manifolds.

Eco-Last™ Coil System Features:

- Improved heat transfer performance due to high primary surface area (flat tubes) versus secondary surface (fins).
- Smaller internal volume (reduced refrigerant charge).
- High durability (all aluminum construction).
- Fewer brazed joints.
- Compact design (reduces unit weight).
- Easy maintenance/cleaning.

Mounting brackets with rubber inserts secure coil to unit providing vibration dampening and corrosion protection.



FEATURES AND BENEFITS

COOLING SYSTEM

(continued)

Evaporator Coil

Copper tube construction, enhanced rippled-edge aluminum fins, flared shoulder tubing connections, silver soldered construction for improved heat transfer. Factory leak tested. Cross row circuiting with rifled tubing optimizes both sensible and latent cooling capacity.

Condensate Drain Pan

Plastic pan, sloped to meet drainage requirements of the American Society of Heating Refrigeration and Air Conditioning Engineers (ASHRAE) 62.1.

End drain connection.

3 Outdoor Coil Fan Motor

Thermal overload protected, totally enclosed, permanently lubricated bearings, shaft down, fan guard mount.

Outdoor Coil Fan Guard

Polyvinyl chloride (PVC) coated fan guard furnished.

Required Selections

Cooling Capacity

Specify nominal cooling capacity of the unit.

Options / Accessories

Field Installed

Condensate Drain Trap

Field installed only.

Available in copper or polyvinyl chloride (PVC).

Drain Pan Overflow Switch

Monitors condensate level in drain pan, shuts down unit if drain becomes clogged.

Low Ambient Kit

Cycles the outdoor fan while allowing compressor operation in the cooling cycle. This intermittent fan operation allows the system to operate without icing the evaporator coil and losing capacity. Designed for use in ambient temperatures no lower than -18°C. A crankcase heater must be installed on the compressor.

CABINET

4 Construction

Heavy-gauge steel panels and full perimeter heavy-gauge galvanized steel base rail provides structural integrity for transportation, handling, and installation.

Base rails have rigging holes. Three sides of the base rail have fork slots.

Raised edges around duct and power entry openings in the bottom of the unit provide additional protection against water entering the building.

Airflow Choice

Units are shipped in downflow (vertical) configuration, can be field converted to horizontal air flow configuration without the need of a kit.

5 Power Entry

Electrical lines can be brought through the unit base or through horizontal access knock-outs.

Optional Bottom Power Entry Kit is available.

6 Exterior Panels

Constructed of heavy-gauge, galvanized steel with a two-layer enamel paint finish.

7 Insulation

All panels adjacent to conditioned air are fully insulated with non-hygroscopic fiberglass insulation.

Access Panels

Access panels are provided for the compressor, heating, controls, blower and air filter/economizer section.

Options / Accessories

Factory Installed

Corrosion Protection

A completely flexible immersed coating with an electro-deposited dry film process (AST ElectroFin E-Coat). Meets Mil Spec MIL-P-53084, ASTM B117 Standard Method Salt Spray Testing.

Indoor Corrosion Protection:

- Coated coil

Outdoor Corrosion Protection:

- Coated coil

Field Installed

Combination Coil/Hail Guards

Heavy gauge steel frame painted to match cabinet with expanded metal mesh to protect the outdoor coil from damage.

FEATURES AND BENEFITS

CONTROLS

Unit Control

All control voltage is provided via a 24V (secondary) transformer with inline fuse protection.

Heat/Cool Staging

Capable of up to 1 heat / 2 cool staging with a thermostat.

Night Setback Mode

Saves energy by closing outdoor air dampers and operating supply fan on thermostat demand only.

Smoke Detectors

NOTE - Smoke detectors are not available and must be field provided by installer.

Options / Accessories

Field Installed

Thermostats

Control system and thermostat options, see page 29

8 BLOWER

A wide selection of supply air blower options are available to meet a variety of air flow requirements.

Motor

Overload protected, equipped with ball bearings. Belt drive motors are offered on all models and are available in several different sizes to maximize air performance.

Two-speed belt drive motor (low static/high static) is available on 074 models.

Supply Air Blower

Forward curved blades, blower wheel is statically and dynamically balanced.

Equipped with ball bearings and adjustable pulley (allows speed change).

Required Selections

Supply Air Blower

Order blower motor kW and drive kit number required when base unit is ordered, see Drive Kit Specifications Table.

INDOOR AIR QUALITY

Air Filters

Disposable 51 mm filters furnished as standard.

Options / Accessories

Field Installed

Indoor Air Quality (CO₂) Sensor

Monitors CO₂ levels adjusts economizer dampers as needed for Demand Control Ventilation.

ELECTRICAL

Marked & Color-Coded Wiring

All electrical wiring is color-coded and marked to identify which components it is connecting.

Electrical Plugs

Positive connection electrical plugs are used to connect common accessories or maintenance parts for easy removal or installation.

Required Selections

Voltage Choice

Specify when ordering base unit.

Field Installed

Electric Heat

Helix wound nichrome elements, individual element limit controls, wiring harness. See Options / Accessories tables for ordering information.

NOTE - Unit Fuse Block is required and must be ordered separately. See Electrical/Electric Heat tables for ordering information.

ECONOMIZER OPTIONS

Factory or Field Installed

**Economizer
(Downflow or Horizontal)
(Standard and High Performance
Common Features)**

Outdoor Air Hood is furnished.

Economizer includes Barometric Relief Dampers with Exhaust Hood.

Barometric Relief Dampers allow relief of excess air, aluminum blade dampers prevent blow back and outdoor air infiltration during off cycle, bird screen furnished. Hood is furnished.

Single Sensible Temperature Control is furnished with the economizer

Outdoor air sensor enables Economizer if the outdoor temperature is less than the setpoint of the control.

Demand Control Ventilation (DCV) ready using optional CO₂ sensors.

NOTE - Horizontal Economizer is field installed only.

Standard Economizer Features

Gear-driven action, return air and outdoor air dampers, plug-in connections to unit, neoprene seals, 24-volt, fully-modulating spring return motor.

Standard Economizer Control Module

The Standard Economizer Control Module can be adjusted to operate based on outdoor air temperatures.



Economizer Controls:

- Damper Minimum Position - Can be set lower than traditional minimum air requirements resulting in cost savings.
- IAQ Sensor - Signals dampers to modulate and maintain 13°C when CO₂ is higher than the CO₂ setpoint.
- Demand Control Ventilation (DCV) LED - A steady green Demand Control Ventilation LED indicates the IAQ reading is higher than setpoint and requires more fresh air.
- Free Cool LED - A steady green LED indicates outdoor air is suitable for free cooling.

Free Cooling runs when outdoor air temperature is lower than the set temperature on the economizer control.

NOTE: The Free Cooling default setting for outdoor air temperature sensor is 13°C.

High Performance Economizer Features

Gear-driven action, high torque 24-volt fully-modulating spring return damper motor, return air and outdoor air dampers, plug-in connections to unit, nylon bearings, enhanced neoprene blade edge seals and flexible stainless steel jamb seals to minimize air leakage.

High Performance Economizer Control Module

Module provides inputs and outputs to control economizer based on parameter settings.



Module automatically detects sensors by polling to determine which sensors are installed in system.

Module displays any alarm messages (fault detection and diagnostics) as an aid in troubleshooting.

Non-volatile memory retains parameter settings in case of power failure.

Keypad with four navigation buttons and LCD screen is furnished for setting economizer parameters.

- Menu Up/Exit (↑) button returns to the main menu.
- Arrow Up (▲) button moves to the previous or next parameter within the selected menu.
- Arrow Down (▼) button moves to the next parameter within the selected menu.
- Select (enter) (↵) button confirms parameter selection.

Main Menu Structure:

- STATUS (economizer and system operation status)
- SETPOINTS (settings for various setpoint parameters)
- SYSTEM SETUP (settings/information about the system)
- ADVANCED SETUP (freeze protection, CO₂ settings, stage 3 delay and additional calibration settings)
- CHECKOUT (damper positions)
- ALARMS (output signal that can be configured for remote alarm monitoring)

Refer to Installation Instructions for complete setup information and menu parameters available.

Field Installed

Single Enthalpy Temperature Control

Outdoor air enthalpy sensor enables Economizer if the outdoor enthalpy is less than the setpoint of the control.

OPTIONS / ACCESSORIES

EXHAUST OPTIONS

Field Installed

Power Exhaust Fan - Downflow or Horizontal

Installs external to unit for applications with Economizer option. Provides exhaust air pressure relief. Interlocked to run when supply air blower is operating, fan runs when outdoor air dampers are 50% open (adjustable), motor is overload protected.

Fan is 305 mm diameter with 5 fan blades 0.25 kW motor.

OUTDOOR AIR OPTIONS

Field Installed

Outdoor Air Dampers - Downflow

Single blade damper, 0 to 25% (fixed) outdoor air adjustable, installs in unit.

Automatic model features fully modulating spring return damper motor with plug-in connection.

Manual model features a slide damper. Maximum mixed air temperature in cooling mode: 38°C.

ROOF CURBS

Hybrid Roof Curbs, Downflow

Nailer strip furnished, mates to unit, US National Roofing Contractors Approved, shipped knocked down.

Roof curb can be assembled using interlocking tabs to fasten corners together. No tools required.

Curb can also be fastened together with furnished hardware.

Available in 203, 356, 457, and 610 mm heights.

Adaptor Curbs (not shown)

Curbs are regionally sourced. Dimensions will vary based upon the source. Contact your local sales representative for a detailed cut sheet with applicable dimensions.

CEILING DIFFUSERS

Ceiling Diffusers (Flush and Step-Down)

Diffuser face and grilles with white powder coat finish, insulated (UL listed duct liner), diffuser box with collars for duct connection, fixed blades (flush diffusers) and double deflection blades (step-down diffusers), provisions for suspending, internally sealed (prevents recirculation), removable return air grille, adapts to T-bar ceiling grids or plaster ceilings.

Transitions (Supply and Return)

NOTE - Ceiling Diffuser Transitions are not furnished and must be field fabricated.

OPTIONS / ACCESSORIES

Item		Catalog No.	ZCB 036	ZCB 048	ZCB 060	ZCB 074
COOLING SYSTEM						
Condensate Drain Trap	Polyvinyl Chloride (PVC) - C1TRAP20AD2	76W26	X	X	X	X
	Copper - C1TRAP10AD2	76W27	X	X	X	X
Drain Pan Overflow Switch	Z1SNSR90A1	99W59	X	X	X	X
Low Ambient Kit	Z1SNSR33A-1	99W67	X	X	X	X
BLOWER - SUPPLY AIR						
Motors	Belt Drive - 0.62 kW Standard Efficiency	Factory	O	O		
	Belt Drive - 0.93 kW Standard Efficiency	Factory	O	O	O	
	Belt Drive - 1.24 kW Standard Efficiency	Factory			O	O
	Belt Drive - 1.24 kW (2 Speed)	Factory				O
Drive Kits See Blower Data Tables for selection	Kit #ZA07 - 705-1077 rev/min	Factory	O			
	Kit #ZA08 - 759-1158 rev/min	Factory		O		
	Kit #ZA09 - 919-1247 rev/min	Factory			O	
	Kit #ZA10 - 1025-1391 rev/min	Factory	O			
	¹ Kit #ZA11 - 1111-1437 rev/min	Factory		O		
	² Kit #ZA12 - 1190-1540 rev/min	Factory			O	
	Kit #ZAA03 - 665-921 rev/min	Factory				O
	Kit #ZAA04 - 768-1023 rev/min	Factory				O
	Kit #ZAA05 - 921-1177 rev/min	Factory				O
CABINET						
Combination Coil/Hail Guards	Z1GARD52A-1	12X19	X	X		
	Z1GARD52AT1	12X20			X	X
Corrosion Protection		Factory	O	O	O	O
ELECTRICAL						
Voltage 50 hz with neutral	380/420V - 3 phase	Factory	O	O	O	O
Bottom Power Entry Kit	Z1PEKT01A-1	98W08	X	X	X	X
³ ELECTRIC HEAT						
3.8 kW	380/420V-3ph - Z1EH0050AN1G	99W06	X	X	X	O
5.7 kW	380/420V-3ph - Z1EH0075AN1G	99W07	X	X	X	X
7.7 kW	380/420V-3ph - Z1EH0100AN1G	99W08	X	X	X	X
11.5 kW	380/420V-3ph - Z1EH0150AN1G	99W09	X	X	X	X
17.2 kW	380/420V-3ph - Z1EH0225AN1G	99W10		X	X	X
23 kW	380/420V-3ph - Z1EH0300A-1G	13U02				X
ELECTRIC HEAT ACCESSORIES						
Unit Fuse Block (required) - See Electrical/Electric Heat Tables for Selection			X	X	X	X

¹ ZA11 drive kits require the 0.93 kW motor.

² ZA12 drive kit requires the 1.24 kW motor.

³ Nominal kW at 420V-3ph-50hz.

NOTE - The catalog and model numbers that appear here are for ordering field installed accessories only.

OX - Field Installed or Configure to Order (factory installed)

O - Configure to Order (Factory Installed)

X - Field Installed.

OPTIONS / ACCESSORIES

Item	Catalog No.	ZCB 036	ZCB 048	ZCB 060	ZCB 074
ECONOMIZER					
Standard Economizer With Outdoor Air Hood					
Standard Economizer (Downflow) Includes Barometric Relief Dampers and Exhaust Hood	Z1ECON30A-2	14D94	OX	OX	OX
Standard Economizer (Horizontal) Includes Barometric Relief Dampers and Exhaust Hood	Z1ECON16A-2	14D92	X	X	X
Standard Economizer Controls					
Single Enthalpy Control	C1SNSR64FF1	53W64	X	X	X
High Performance Economizer With Outdoor Air Hood					
High Performance Economizer (Downflow) Includes Barometric Relief Dampers and Exhaust Hood	Z1ECON32A-2	14D95	OX	OX	OX
High Performance Economizer (Horizontal) Includes Barometric Relief Dampers and Exhaust Hood	Z1ECON33A-2	14D93	X	X	X
High Performance Economizer Controls					
Single Enthalpy Control	C1SNSR61FF1	11G21	X	X	X
OUTDOOR AIR					
Outdoor Air Dampers With Outdoor Air Hood					
Motorized	Z1DAMP21A-2	15D19	X	X	X
Manual	Z1DAMP11A-2	15D20	X	X	X
POWER EXHAUST FAN					
Standard Static (Downflow)	380/420V-3ph - Z1PWRE10A-1G	23E01	X	X	X
Standard Static (Horizontal)	380/420V-3ph - Z1PWRE15A-1G	28E01	X	X	X
INDOOR AIR QUALITY					
Indoor Air Quality (CO₂) Sensors					
Sensor - Wall-mount, off-white plastic cover with LCD display	C0SNSR50AE1L	77N39	X	X	X
Sensor - Wall-mount, black plastic case, no display, rated for plenum mounting	C0SNSR53AE1L	87N54	X	X	X
CO ₂ Sensor Duct Mounting Kit - for downflow applications	C0MISC19AE1	85L43	X	X	X
Aspiration Box - for duct mounting non-plenum rated CO ₂ sensor (77N39)	C0MISC16AE1	90N43	X	X	X
ROOF CURBS					
Hybrid Roof Curbs, Downflow					
203 mm height	Z1CURB70A-1	11F76	X	X	X
356 mm height	Z1CURB71A-1	11F77	X	X	X
457 mm height	Z1CURB72A-1	11F78	X	X	X
610 mm height	Z1CURB73A-1	11F79	X	X	X
CEILING DIFFUSERS					
Step-Down - Order one	RTD9-65S	13K60	X	X	X
	RTD11-95S	13K61			X
Flush - Order one	FD9-65S	13K55	X	X	X
	FD11-95S	13K56			X

NOTE - Ceiling Diffuser Transitions are not furnished and must be field fabricated.

NOTE - The catalog and model numbers that appear here are for ordering field installed accessories only.

OX - Field Installed or Configure to Order (factory installed)

O - Configure to Order (Factory Installed)

X - Field Installed.

SPECIFICATIONS

General Data		Nominal Size	10.5 kW (3 Ton)	14.0 kW (4 Ton)	17.5 kW (5 Ton)
		Model No.	ZCB036S4B	ZCB048S4B	ZCB060S4B
		Efficiency Type	Standard	Standard	Standard
		Blower Type	Single Speed Belt Drive	Single Speed Belt Drive	Single Speed Belt Drive
Cooling Performance	Gross Cooling Capacity - kW (Btuh)		9.2 (31 400)	12.0 (40 900)	14.6 (49 900)
	¹ Net Cooling Capacity - kW (Btuh)		8.8 (30 200)	11.6 (39 700)	14.2 (48 600)
	Rated Air Flow - L/s (cfm)		560 (1190)	650 (1380)	815 (1725)
	³ Sound Rating Number (SRN)(dBA)		77	80	78
	Total Unit Power - kW		2.55	3.5	4.3
	¹ SEER (Btuh/Watt)		14.0	14.0	14.0
	¹ EER (Btuh/Watt) at 35°C (95°F)		¹ 11.8	¹ 11.3	¹ 11.3
² EER (Btuh/Watt) at 46°C (115°F)		8.6	8.2	7.3	
Refrigerant	Type		R-410A	R-410A	R-410A
	Charge Furnished		2.32 kg (5 lbs. 2 oz.)	2.38 kg (5 lbs. 4 oz.)	3.32 kg (7 lbs. 5 oz.)
Electric Heat Available - See page 8			3.8, 5.7, 7.7, 11.5 kW		
Compressor Type (one per unit)			Scroll	Scroll	Scroll
Outdoor Coil	Net face area - m ² (sq. ft.)		1.4 (15.2)	1.4 (15.2)	1.84 (19.9)
	Number of rows		1	1	1
	Fins per meter (in.)		906 (23)	906 (23)	906 (23)
Outdoor Coil Fan	Motor W (HP)		187 (1/4)	187 (1/4)	187 (1/4)
	Motor rev/min		690	690	690
	Total motor watts		260	260	260
	Diameter - mm (in.)		559 (22)	559 (22)	559 (22)
	Number of blades		4	4	4
	Total air volume - L/s (cfm)		1454 (3080)	1454 (3080)	1454 (3080)
Indoor Coil	Net face area - m ² (sq. ft.)		0.78 (8.4)	0.78 (8.4)	1.0 (10.8)
	Tube diameter - mm (in.)		9.5 (3/8)	9.5 (3/8)	9.5 (3/8)
	Number of rows		3	3	3
	Fins per m (in.)		551 (14)	551 (14)	551 (14)
	Drain Connection (no. and size) -cm (in.)		(1) 1 NPT	(1) 1 NPT	(1) 1 NPT
	Expansion device type		Fixed Orifice	Fixed Orifice	Fixed Orifice
⁴ Indoor Blower & Drive Selection	Nominal Motor kW (hp)		0.62 (0.83)	0.62 (0.83)	0.93 (1.25)
			0.93 (1.25)	0.93 (1.25)	1.24 (1.66)
		Maximum Usable Motor kW (hp)	0.71 (0.95)	0.71 (0.95)	1.07 (1.43)
	Available Drive Kits		ZA07 705-1077 rev/min	ZA08 759-1158 rev/min	ZA09 919-1247 rev/min
			ZA10 1025-1391 rev/min	⁵ ZA11 1111-1437 rev/min	⁶ ZA12 1190-1540 rev/min
		Wheel nominal diameter x width - mm (in.)	254 x 254 (10 x 10)	254 x 254 (10 x 10)	254 x 254 (10 x 10)
	Filters	Type		Disposable	
Number and size - mm (in.)			(4) 356 x 508 x 51 (14 x 20 x 2)	(2) 406 x 508 x 51 (16 x 20 x 2)	(2) 508 x 508 x 51 (20 x 20 x 2)
Electrical Characteristics - 50 Hz			380/420V - 50 hertz - 3 phase with neutral		

NOTE - Net capacity includes evaporator blower motor heat deduction. Gross capacity does not include evaporator blower motor heat deduction.

¹ Tested at conditions included in AHRI Standard 210/240; 35°C (95°F) outdoor air temperature and 27°C (80°F) dry bulb /19°C (67°F) wet bulb entering evaporator air; minimum external duct static pressure while operating at rated voltage and air volumes.

² Rated at 46°C (115°F) outdoor air temperature and 27°C (80°F) db/19°C (67°F) wb entering evaporator air (T3 Conditions).

³ Sound Rating Number (SRN) rated in accordance with test conditions included in ANSI/AHRI Standard 270-2008.

⁴ Using total air volume and system static pressure requirements determine from blower performance tables rev/min and motor size required. Maximum usable size of motors furnished is shown. If motors of comparable size are used, be sure to keep within the service factor limitations outlined on the motor nameplate.

0.62 kW = 0.83 hp (1.0 nominal hp) while operating at rated voltage and frequency.

0.93 kW = 1.25 hp (1.5 nominal hp) while operating at rated voltage and frequency.

1.24 kW = 1.66 hp (2.0 nominal hp) while operating at rated voltage and frequency.

⁵ ZA11 drive kits require the 0.93 kW motor.

⁶ ZA12 drive kit requires the 1.24 kW motor.

SPECIFICATIONS

General Data		Nominal Size	21 kW (6 Ton)	21 kW (6 Ton)	
		Model No.	ZCB074S4T	ZCB074S4B	
		Efficiency Type	Standard	Standard	
		Blower Type	Two Speed Belt Drive	Single Speed Belt Drive	
Cooling Performance	Gross Cooling Capacity - kW (Btuh)		17.3 (59 000)	17.3 (59 000)	
	¹ Net Cooling Capacity - kW (Btuh)		16.9 (57 500)	16.9 (57 500)	
	Rated Air Flow - L/s (cfm)		1038 (2200)	1038 (2200)	
	³ Sound Rating Number (SRN)(dBA)		84	84	
	Total Unit Power - kW		5.1	5.1	
	¹ IEER (Btuh/Watt)		15.0	13.0	
	¹ EER (Btuh/Watt) at 35°C (95°F)		11.3	11.3	
	² EER (Btuh/Watt) at 46°C (115°F)		7.7	7.7	
Refrigerant	Type		R-410A	R-410A	
	Charge Furnished		3.26 kg (7 lbs. 3 oz.)	3.26 kg (7 lbs. 3 oz.)	
Electric Heat Available - See page 8			5.7, 7.7, 11.5, 17.2, 23 kW		
Compressor Type (one per unit)			Scroll	Scroll	
Outdoor Coil	Net face area - m ² (sq. ft.)		1.85 (19.9)	1.85 (19.9)	
	Number of rows		1	1	
	Fins per meter (in.)		906 (23)	906 (23)	
Outdoor Coil Fan	Motor W (HP)		249 (1/3)	249 (1/3)	
	Motor rev/min		900	900	
	Total motor watts		290	290	
	Diameter - mm (in.)		559 (22)	559 (22)	
	Number of blades		3	3	
	Total air volume - L/s (cfm)		1680 (3560)	1680 (3560)	
Indoor Coil	Net face area - m ² (sq. ft.)		1.0 (10.8)	1.0 (10.8)	
	Tube diameter - mm (in.)		9.5 (3/8)	9.5 (3/8)	
	Number of rows		3	3	
	Fins per m (in.)		551 (14)	551 (14)	
	Drain Connection (no. and size) -cm (in.)		(1) 1 NPT	(1) 1 NPT	
	Expansion device type		Balance port TXV, removable head		
⁴ Indoor Blower & Drive Selection	Nominal Motor kW (hp)		1.24 (1.66)	1.24 (1.66)	
	Maximum Usable Motor kW (hp)		1.42 (1.91)	1.42 (1.91)	
	Available Drive Kits	ZAA03		ZAA03	ZAA03
		665-921 rev/min		665-921 rev/min	665-921 rev/min
		ZAA04		ZAA04	ZAA04
		768-1023 rev/min		768-1023 rev/min	768-1023 rev/min
		ZAA05		ZAA05	ZAA05
921-1177 rev/min		921-1177 rev/min	921-1177 rev/min		
Wheel nominal diameter x width - mm (in.)		381 x 229 (15 x 9)	381 x 229 (15 x 9)		
Filters	Type		Disposable		
	Number and size - mm (in.)		(2) 406 x 508 x 51 (16 x 20 x 2) (2) 508 x 508 x 51 (20 x 20 x 2)		
Electrical Characteristics - 50 Hz			380/420V - 50 hertz - 3 phase with neutral		

NOTE - Net capacity includes evaporator blower motor heat deduction. Gross capacity does not include evaporator blower motor heat deduction.

¹ Rating test conditions are those included in Air-Conditioning, Heating and Refrigeration Institute (AHRI) Standard 340/360; 35°C (95°F) outdoor air temperature and 27°C (80°F) db/19°C (67°F) wb entering evaporator air; minimum external duct static pressure while operating at rated voltage and air volumes.

² Rated at 46°C (115°F) outdoor air temperature and 27°C (80°F) db/19°C (67°F) wb entering evaporator air (T3 Conditions).

³ Sound Rating Number (SRN) rated in accordance with test conditions included in ANSI/AHRI Standard 270-2008.

⁴ Using total air volume and system static pressure requirements determine from blower performance tables rev/min and motor size required. Maximum usable size of motors furnished is shown. If motors of comparable size are used, be sure to keep within the service factor limitations outlined on the motor nameplate.

0.62 kW = 0.83 hp (1.0 nominal hp) while operating at rated voltage and frequency.

0.93 kW = 1.25 hp (1.5 nominal hp) while operating at rated voltage and frequency.

1.24 kW = 1.66 hp (2.0 nominal hp) while operating at rated voltage and frequency.

RATINGS

NOTE - For Temperatures and Capacities not shown in tables, see bulletin - Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

10.5 KW - ZCB036S4

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		26.7°C					35°C					43.3°C					46°C				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	
17.2°C	455	9.1	1.62	.73	.89	1.00	8.3	1.92	.75	.94	1.00	7.4	2.29	.79	.99	1.00	7.1	2.43	.84	1.00	1.00
	565	9.6	1.62	.79	.99	1.00	8.8	1.93	.82	1.00	1.00	7.9	2.30	.88	1.00	1.00	7.6	2.44	.92	1.00	1.00
	680	10.0	1.63	.86	1.00	1.00	9.2	1.94	.91	1.00	1.00	8.3	2.31	.97	1.00	1.00	8.0	2.45	.99	1.00	1.00
19.4°C	455	9.6	1.63	.57	.71	.85	8.8	1.93	.58	.73	.90	7.9	2.30	.60	.77	.96	7.5	2.44	.62	.81	.98
	565	10.1	1.63	.61	.77	.95	9.2	1.94	.62	.80	1.00	8.1	2.31	.65	.86	1.00	7.8	2.45	.68	.90	1.00
	680	10.4	1.64	.65	.83	1.00	9.5	1.94	.67	.88	1.00	8.4	2.31	.69	.95	1.00	8.0	2.45	.73	.98	1.00
21.7°C	455	10.2	1.64	.43	.56	.69	9.3	1.94	.43	.57	.71	8.3	2.31	.43	.59	.74	7.9	2.45	.43	.61	.78
	565	10.7	1.65	.44	.60	.75	9.7	1.95	.45	.62	.78	8.6	2.31	.45	.64	.83	8.3	2.45	.46	.67	.87
	680	11.0	1.66	.46	.64	.81	10.0	1.95	.46	.66	.86	8.9	2.32	.48	.69	1.00	8.5	2.46	.48	.73	.96

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil														
		48°C					50°C					51.7°C				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb		
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	
17.2°C	455	6.9	2.54	.82	1.00	1.00	6.7	2.65	.84	1.00	1.00	6.7	2.81	.83	.97	.97
	565	7.3	2.55	.93	1.00	1.00	7.1	2.66	.95	1.00	1.00	7.1	2.81	.92	.97	.97
	680	7.7	2.55	1.00	1.00	1.00	7.4	2.67	1.00	1.00	1.00	7.5	2.82	.97	.97	.97
19.4°C	455	7.2	2.54	.62	.80	1.00	6.9	2.66	.62	.81	1.00	7.0	2.81	.62	.81	.97
	565	7.5	2.55	.67	.90	1.00	7.2	2.66	.68	.92	1.00	7.3	2.82	.68	.90	.97
	680	7.7	2.55	.72	.99	1.00	7.4	2.67	.73	1.00	1.00	7.5	2.82	.73	.97	.97
21.7°C	455	7.7	2.55	.43	.61	.78	7.4	2.66	.43	.62	.79	7.4	2.82	.43	.61	.79
	565	8.0	2.56	.45	.66	.87	7.6	2.67	.46	.68	.90	7.7	2.82	.46	.67	.88
	680	8.1	2.56	.48	.72	.97	7.8	2.67	.49	.73	.99	7.9	2.83	.48	.73	.95

14.0 KW - ZCB048S4

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		26.7°C					35°C					43.3°C					46°C				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	
17.2°C	604	11.7	2.29	0.75	0.90	1.00	11.1	2.74	0.78	0.95	1.00	10.6	3.30	0.82	1.00	1.00	10.5	3.51	.87	1.00	1.00
	755	12.1	2.30	0.79	0.99	1.00	11.6	2.75	0.84	1.00	1.00	11.1	3.33	0.90	1.00	1.00	10.9	3.54	.94	1.00	1.00
	906	12.5	2.32	0.86	1.00	1.00	12.0	2.77	0.92	1.00	1.00	11.4	3.35	0.98	1.00	1.00	11.3	3.57	1.00	1.00	1.00
19.4°C	604	12.2	2.30	0.59	0.72	0.86	11.6	2.76	0.62	0.76	0.91	11.0	3.33	0.65	0.79	0.97	10.8	3.54	.69	.86	.97
	755	12.6	2.32	0.62	0.78	0.96	12.0	2.77	0.65	0.81	1.00	11.3	3.34	0.69	0.87	1.00	11.1	3.56	.74	.94	1.00
	906	12.9	2.33	0.66	0.84	1.00	12.2	2.79	0.69	0.89	1.00	11.5	3.36	0.73	0.96	1.00	11.3	3.57	.78	1.00	1.00
21.7°C	604	12.7	2.32	0.45	0.57	0.70	12.1	2.78	0.47	0.60	0.73	11.4	3.35	0.50	0.64	0.77	11.2	3.57	.53	.69	.79
	755	13.2	2.34	0.46	0.61	0.75	12.5	2.80	0.49	0.64	0.79	11.8	3.38	0.52	0.68	0.85	11.5	3.59	.55	.74	.87
	906	13.5	2.36	0.47	0.65	0.81	12.8	2.81	0.50	0.69	0.87	12.0	3.39	0.53	0.72	0.93	11.7	3.60	.57	.79	.94

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil														
		48°C					50°C					51.7°C				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb		
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	
17.2°C	604	10.3	3.69	.84	1.00	1.00	10.2	3.87	.86	1.00	1.00	10.1	4.05	0.88	1.00	1.00
	755	10.7	3.72	.93	1.00	1.00	10.6	3.91	.95	1.00	1.00	10.4	4.08	0.97	1.00	1.00
	906	11.0	3.75	1.00	1.00	1.00	10.9	3.94	1.00	1.00	1.00	10.7	4.11	1.00	1.00	1.00
19.4°C	604	10.6	3.71	.67	.82	1.00	10.5	3.90	.69	.84	1.00	10.3	4.07	0.69	0.85	1.00
	755	10.9	3.73	.71	.91	1.00	10.7	3.92	.73	.93	1.00	10.6	4.09	0.74	0.95	1.00
	906	11.1	3.75	.76	.99	1.00	10.9	3.93	.77	1.00	1.00	10.7	4.11	0.78	1.00	1.00
21.7°C	604	11.0	3.75	.52	.66	.80	10.8	3.93	.53	.67	.81	10.7	4.10	0.54	0.68	0.83
	755	11.3	3.77	.53	.70	.89	11.1	3.96	.54	.72	.91	10.9	4.13	0.55	0.73	0.93
	906	11.5	3.78	.55	.75	.98	11.3	3.97	.56	.76	.99	11.0	4.14	0.57	0.77	1.00

RATINGS

NOTE – For Temperatures and Capacities not shown in tables, see bulletin – Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

17.5 KW - ZCB060S4

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		26.7°C					35°C					43.3°C					46°C				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	
17.2°C	755	14.7	2.88	0.78	0.93	1.00	12.7	3.43	0.79	0.96	1.00	10.7	4.12	0.81	0.99	1.00	10.2	4.38	.80	1.00	1.00
	945	15.5	2.89	0.86	0.99	1.00	13.7	3.44	0.87	1.00	1.00	11.8	4.16	0.9	1.00	1.00	11.2	4.43	.91	1.00	1.00
	1135	16.5	2.91	0.91	1.00	1.00	14.7	3.47	0.94	1.00	1.00	12.6	4.19	0.97	1.00	1.00	12.0	4.46	.99	1.00	1.00
19.4°C	755	15.9	2.9	0.6	0.76	0.91	13.9	3.45	0.59	0.77	0.93	11.7	4.16	0.57	0.79	0.97	11.0	4.41	.56	.80	.95
	945	16.7	2.91	0.64	0.83	0.97	14.6	3.46	0.64	0.86	1.00	12.4	4.18	0.64	0.89	1.00	11.6	4.44	.63	.90	1.00
	1135	17.4	2.92	0.69	0.89	1.00	15.1	3.47	0.69	0.92	1.00	12.9	4.20	0.71	0.96	1.00	12.1	4.46	.70	.99	1.00
21.7°C	755	17.0	2.91	0.43	0.59	0.74	15.0	3.48	0.41	0.58	0.75	12.7	4.19	0.36	0.57	0.77	12.0	4.46	.36	.58	.72
	945	17.9	2.93	0.45	0.64	0.81	15.8	3.49	0.43	0.63	0.83	13.5	4.22	0.4	0.65	0.87	12.7	4.49	.39	.66	.82
	1135	18.6	2.95	0.48	0.69	0.88	16.3	3.51	0.46	0.69	0.90	13.9	4.25	0.44	0.71	0.94	13.1	4.52	.43	.72	.91

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil														
		48°C					50°C					51.7°C				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb		
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	
17.2°C	755	9.6	4.59	.83	1.00	1.00	9.1	4.82	.85	1.00	1.00	8.7	5.03	0.86	1.00	1.00
	945	10.6	4.64	.93	1.00	1.00	10.1	4.88	.94	1.00	1.00	9.6	5.09	0.96	1.00	1.00
	1135	11.3	4.68	1.00	1.00	1.00	10.8	4.91	1.00	1.00	1.00	10.3	5.13	1.00	1.00	1.00
19.4°C	755	10.4	4.63	.57	.81	.99	9.8	4.86	.57	.82	1.00	9.3	5.07	0.56	0.84	1.00
	945	11.0	4.66	.64	.92	1.00	10.4	4.89	.65	.93	1.00	9.8	5.10	0.65	0.94	1.00
	1135	11.4	4.69	.72	.99	1.00	10.8	4.92	.73	1.00	1.00	10.3	5.13	0.73	1.00	1.00
21.7°C	755	11.4	4.68	.33	.57	.79	10.8	4.91	.32	.57	.80	10.2	5.12	0.32	0.57	0.81
	945	12.0	4.71	.38	.65	.90	11.3	4.94	.37	.65	.91	10.8	5.16	0.36	0.66	0.92
	1135	12.4	4.74	.42	.73	.97	11.8	4.98	.41	.73	.98	11.2	5.19	0.41	0.75	1.00

RATINGS

NOTE – For Temperatures and Capacities not shown in tables, see bulletin – Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

21 KW - ZCB074S4T - COOLING CAPACITY (1ST STAGE)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		18.1°C						24°C						29°C						35°C					
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	565	13.0	1.85	0.74	0.88	0.98	12.1	2.13	0.74	0.90	1.00	11.3	2.39	0.75	0.92	1.00	10.3	2.76	0.76	0.95	1.00				
	755	14.1	1.84	0.81	0.99	1.00	13.2	2.12	0.82	1.00	1.00	12.4	2.39	0.83	1.00	1.00	11.5	2.76	0.86	1.00	1.00				
	945	15.2	1.83	0.88	1.00	1.00	14.3	2.11	0.90	1.00	1.00	13.5	2.39	0.93	1.00	1.00	12.5	2.75	0.95	1.00	1.00				
19.4°C	565	13.9	1.84	0.59	0.73	0.83	13.0	2.12	0.59	0.74	0.84	12.2	2.39	0.59	0.75	0.86	11.1	2.76	0.59	0.76	0.88				
	755	15.1	1.83	0.65	0.82	0.93	14.0	2.12	0.65	0.83	0.95	13.1	2.39	0.65	0.84	0.97	12.0	2.76	0.66	0.87	1.00				
	945	15.8	1.83	0.70	0.89	1.00	14.7	2.11	0.70	0.91	1.00	13.8	2.38	0.71	0.93	1.00	12.6	2.75	0.72	0.97	1.00				
21.7°C	565	15.2	1.83	0.41	0.54	0.63	14.3	2.12	0.40	0.54	0.63	13.5	2.39	0.39	0.54	0.63	12.3	2.75	0.37	0.53	0.64				
	755	16.5	1.82	0.42	0.59	0.69	15.4	2.11	0.42	0.59	0.70	14.5	2.38	0.41	0.59	0.71	13.3	2.75	0.39	0.59	0.72				
	945	17.3	1.81	0.45	0.63	0.74	16.2	2.10	0.44	0.64	0.76	15.2	2.37	0.43	0.64	0.78	13.9	2.74	0.42	0.65	0.80				

21 KW - ZCB074S4T - COOLING CAPACITY (2ND STAGE)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		26.7°C						35°C						43.3°C						46°C					
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	905	16.9	3.26	0.79	0.97	1.00	15.1	3.90	0.82	1.00	1.00	13.5	4.69	0.85	1.00	1.00	12.9	4.98	0.86	1.00	1.00				
	1135	18.0	3.29	0.86	1.00	1.00	16.3	3.95	0.90	1.00	1.00	14.5	4.74	0.95	1.00	1.00	13.9	5.03	0.97	1.00	1.00				
	1360	18.9	3.33	0.94	1.00	1.00	17.2	3.98	0.97	1.00	1.00	15.3	4.77	1.00	1.00	1.00	14.7	5.06	1.00	1.00	1.00				
19.4°C	905	17.9	3.29	0.63	0.80	0.91	16.1	3.94	0.63	0.83	0.95	14.1	4.72	0.65	0.86	1.00	13.4	5.00	0.65	0.88	1.00				
	1135	18.7	3.32	0.68	0.88	1.00	16.8	3.97	0.69	0.91	1.00	14.7	4.75	0.71	0.96	1.00	14.0	5.03	0.72	0.98	1.00				
	1360	19.3	3.34	0.73	0.95	1.00	17.3	3.99	0.74	0.99	1.00	15.3	4.77	0.77	1.00	1.00	14.7	5.06	0.79	1.00	1.00				
21.7°C	905	19.4	3.35	0.41	0.57	0.67	17.5	4.00	0.40	0.58	0.69	15.5	4.78	0.38	0.58	0.71	14.8	5.07	0.38	0.59	0.72				
	1135	20.3	3.38	0.43	0.62	0.74	18.3	4.03	0.42	0.63	0.76	16.1	4.81	0.41	0.64	0.80	15.4	5.10	0.40	0.65	0.81				
	1360	21.0	3.41	0.44	0.66	0.80	18.9	4.06	0.44	0.68	0.83	16.6	4.84	0.43	0.70	0.88	15.9	5.13	0.43	0.71	0.89				

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																	
		48°C						50°C						51.7°C					
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)					
				Dry Bulb					Dry Bulb					Dry Bulb					
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C				
17.2°C	905	12.5	5.21	0.88	1.00	1.00	12.0	5.46	0.89	1.00	1.00	11.6	5.68	0.91	1.00	1.00			
	1135	13.4	5.25	0.98	1.00	1.00	12.9	5.50	1.00	1.00	1.00	12.5	5.72	1.00	1.00	1.00			
	1360	14.2	5.29	1.00	1.00	1.00	13.6	5.54	1.00	1.00	1.00	13.2	5.75	1.00	1.00	1.00			
19.4°C	905	12.9	5.23	0.66	0.89	1.00	12.3	5.47	0.66	0.91	1.00	11.8	5.69	0.67	0.93	1.00			
	1135	13.5	5.26	0.73	1.00	1.00	13.0	5.50	0.74	1.00	1.00	12.5	5.72	0.75	1.00	1.00			
	1360	14.2	5.29	0.80	1.00	1.00	13.6	5.53	0.81	1.00	1.00	13.2	5.75	0.83	1.00	1.00			
21.7°C	905	14.2	5.29	0.37	0.59	0.73	13.7	5.54	0.37	0.60	0.74	13.2	5.75	0.37	0.60	0.75			
	1135	14.9	5.32	0.40	0.66	0.82	14.2	5.57	0.40	0.67	0.84	13.7	5.78	0.40	0.67	0.85			
	1360	15.3	5.35	0.43	0.72	0.91	14.7	5.59	0.43	0.73	0.93	14.1	5.81	0.43	0.74	0.94			

RATINGS

NOTE – For Temperatures and Capacities not shown in tables, see bulletin – Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

21 KW - ZCB074S4B - COOLING CAPACITY (1ST STAGE)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		18.1°C						24°C						29°C						35°C					
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	905	15.9	18.6	.86	1.00	1.00	14.9	21.5	.88	1.00	1.00	14.1	24.3	.90	1.00	1.00	13.1	28.0	.93	1.00	1.00				
	1135	17.1	18.5	.95	1.00	1.00	16.1	21.4	.97	1.00	1.00	15.2	24.2	.99	1.00	1.00	14.1	28.0	1.00	1.00	1.00				
	1360	18.0	18.4	1.00	1.00	1.00	16.9	21.3	1.00	1.00	1.00	16.1	24.1	1.00	1.00	1.00	14.9	27.9	1.00	1.00	1.00				
19.4°C	905	16.6	18.5	.68	.87	.99	15.6	21.5	.68	.89	1.00	14.6	24.2	.69	.91	1.00	13.4	28.0	.70	.94	1.00				
	1135	17.3	18.5	.73	.96	1.00	16.2	21.4	.75	.98	1.00	15.3	24.2	.76	1.00	1.00	14.1	28.0	.77	1.00	1.00				
	1360	18.0	18.4	.79	1.00	1.00	17.0	21.4	.80	1.00	1.00	16.0	24.1	.82	1.00	1.00	14.9	27.9	.84	1.00	1.00				
21.7°C	905	18.2	18.4	.44	.62	.73	17.1	21.3	.43	.62	.74	16.1	24.1	.42	.63	.76	14.9	27.9	.42	.64	.77				
	1135	19.0	18.3	.46	.67	.80	17.8	21.3	.45	.67	.82	16.8	24.0	.45	.68	.84	15.5	27.9	.44	.70	.86				
	1360	19.6	18.2	.48	.72	.87	18.3	21.2	.47	.73	.89	17.3	24.0	.47	.74	.91	15.9	27.9	.47	.76	.95				

21 KW - ZCB074S4B - COOLING CAPACITY (2ND STAGE)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		26.7°C						35°C						43.3°C						46°C					
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C					
17.2°C	905	17.6	32.7	.79	.97	1.00	15.8	39.2	.82	1.00	1.00	14.1	47.1	.85	1.00	1.00	13.5	50.0	.86	1.00	1.00				
	1135	18.8	33.0	.86	1.00	1.00	17.1	39.6	.90	1.00	1.00	15.2	47.5	.95	1.00	1.00	14.6	50.4	.97	1.00	1.00				
	1360	19.8	33.4	.94	1.00	1.00	18.0	40.0	.97	1.00	1.00	16.1	47.9	1.00	1.00	1.00	15.4	50.8	1.00	1.00	1.00				
19.4°C	905	18.7	33.0	.63	.80	.91	16.8	39.5	.63	.83	.95	14.8	47.4	.65	.87	1.00	14.1	50.2	.65	.88	1.00				
	1135	19.5	33.3	.68	.88	1.00	17.6	39.8	.69	.91	1.00	15.4	47.6	.71	.96	1.00	14.7	50.5	.72	.98	1.00				
	1360	20.1	33.6	.73	.95	1.00	18.1	40.0	.74	.99	1.00	16.1	47.9	.77	1.00	1.00	15.4	50.8	.79	1.00	1.00				
21.7°C	905	20.3	33.6	.41	.57	.67	18.3	40.1	.40	.58	.69	16.3	48.0	.38	.59	.71	15.5	50.8	.38	.59	.73				
	1135	21.2	33.9	.43	.62	.74	19.1	40.5	.42	.63	.76	16.9	48.3	.41	.65	.80	16.1	51.2	.41	.65	.81				
	1360	21.9	34.2	.44	.66	.80	19.7	40.7	.44	.68	.83	17.4	48.6	.43	.70	.88	16.7	51.4	.43	.71	.89				

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																	
		48°C						50°C						51.7°C					
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)					
				Dry Bulb					Dry Bulb					Dry Bulb					
L/s	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C	kW	kW	24°C	27°C	29°C				
17.2°C	905	13.1	52.3	.88	1.00	1.00	12.6	54.8	.89	1.00	1.00	12.2	57.0	.91	1.00	1.00			
	1135	14.1	52.7	.98	1.00	1.00	13.6	55.2	1.00	1.00	1.00	13.1	57.4	1.00	1.00	1.00			
	1360	14.9	53.1	1.00	1.00	1.00	14.3	55.5	1.00	1.00	1.00	13.9	57.7	1.00	1.00	1.00			
19.4°C	905	13.6	52.5	.66	.89	1.00	12.9	54.9	.66	.91	1.00	12.4	57.1	.67	.93	1.00			
	1135	14.1	52.8	.73	1.00	1.00	13.6	55.2	.74	1.00	1.00	13.2	57.5	.75	1.00	1.00			
	1360	14.9	53.1	.80	1.00	1.00	14.3	55.5	.81	1.00	1.00	13.9	57.7	.83	1.00	1.00			
21.7°C	905	14.9	53.1	.38	.59	.73	14.4	55.6	.37	.60	.74	13.9	57.7	.37	.60	.75			
	1135	15.6	53.4	.40	.66	.82	14.9	55.9	.40	.67	.84	14.4	58.0	.40	.67	.85			
	1360	16.1	53.7	.43	.72	.91	15.4	56.1	.43	.73	.93	14.8	58.3	.43	.74	.94			

BLOWER DATA - BELT DRIVE - ZCBO36 - DOWNFLOW

BLOWER TABLE INCLUDES RESISTANCE FOR BASE UNIT ONLY WITH DRY INDOOR COIL AND AIR FILTERS IN PLACE.
FOR ALL UNITS ADD:

1 - Any factory installed options air resistance (heat section, economizer, wet coil, etc.).

2 - Any field installed accessories air resistance (duct resistance, diffuser, etc.).

See page 24 for blower motors and drives and wet coil and options/accessory air resistance data.

Air Volume		External Static - Pa (in. w.g.)																							
		25 (0.10)		50 (0.20)		75 (0.30)		100 (0.40)		125 (0.50)		150 (0.60)		175 (0.70)		200 (0.80)									
L/s	cfm	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP						
425	900	562	0.12	0.16	629	0.13	0.18	699	0.14	0.19	771	0.15	0.2	840	0.16	0.22	904	0.18	0.24	962	0.19	0.26	1015	0.22	0.29
472	1000	586	0.13	0.18	654	0.15	0.2	725	0.16	0.21	796	0.17	0.23	864	0.19	0.25	927	0.20	0.27	983	0.22	0.3	1034	0.25	0.33
519	1100	612	0.15	0.2	681	0.16	0.22	752	0.18	0.24	823	0.19	0.26	890	0.21	0.28	950	0.23	0.31	1004	0.25	0.34	1054	0.28	0.37
566	1200	641	0.17	0.23	711	0.19	0.25	783	0.20	0.27	852	0.22	0.29	917	0.24	0.32	975	0.26	0.35	1027	0.29	0.39	1074	0.31	0.42
613	1300	673	0.19	0.25	744	0.21	0.28	815	0.22	0.3	882	0.25	0.33	944	0.27	0.36	1000	0.30	0.4	1050	0.33	0.44	1096	0.36	0.48
661	1400	709	0.22	0.29	779	0.24	0.32	849	0.25	0.34	914	0.28	0.37	973	0.31	0.41	1026	0.34	0.45	1074	0.37	0.49	1118	0.40	0.53
708	1500	747	0.25	0.33	816	0.27	0.36	883	0.29	0.39	945	0.31	0.42	1001	0.34	0.46	1052	0.38	0.51	1098	0.41	0.55	1141	0.44	0.59

Air Volume		External Static - Pa (in. w.g.)																							
		225 (0.90)		250 (1.00)		275 (1.10)		300 (1.20)		325 (1.30)		350 (1.40)		375 (1.50)		400 (1.60)									
L/s	cfm	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP						
425	900	1065	0.24	0.32	1112	0.26	0.35	1158	0.28	0.38	1202	0.31	0.41	1243	0.33	0.44	1284	0.36	0.48	1323	0.39	0.52	1364	0.41	0.55
472	1000	1082	0.27	0.36	1128	0.29	0.39	1173	0.31	0.42	1216	0.34	0.45	1257	0.37	0.49	1297	0.40	0.53	1336	0.43	0.57	1375	0.45	0.60
519	1100	1100	0.30	0.4	1145	0.33	0.44	1189	0.35	0.47	1231	0.38	0.51	1272	0.40	0.54	1311	0.43	0.58	1349	0.46	0.62	1388	0.49	0.66
566	1200	1119	0.34	0.45	1163	0.37	0.49	1206	0.39	0.52	1247	0.42	0.56	1287	0.45	0.60	1326	0.48	0.64	1364	0.51	0.68	1402	0.54	0.72
613	1300	1139	0.38	0.51	1182	0.41	0.55	1224	0.43	0.58	1265	0.46	0.62	1304	0.49	0.66	1342	0.53	0.71	1379	0.56	0.75	1416	0.59	0.79
661	1400	1160	0.43	0.57	1202	0.46	0.61	1243	0.48	0.65	1283	0.51	0.69	1322	0.54	0.73	1359	0.58	0.78	1396	0.61	0.82	1432	0.65	0.87
708	1500	1182	0.48	0.64	1223	0.51	0.68	1263	0.54	0.72	1303	0.57	0.76	1341	0.60	0.81	1378	0.63	0.85	1414	0.67	0.9	1449	0.70	0.94

BLOWER DATA - BELT DRIVE - ZCBO36 - HORIZONTAL

BLOWER TABLE INCLUDES RESISTANCE FOR BASE UNIT ONLY WITH DRY INDOOR COIL AND AIR FILTERS IN PLACE.
FOR ALL UNITS ADD:

1 - Any factory installed options air resistance (heat section, economizer, wet coil, etc.).

2 - Any field installed accessories air resistance (duct resistance, diffuser, etc.).

See page 24 for blower motors and drives and wet coil and options/accessory air resistance data.

Air Volume		External Static - Pa (in. w.g.)																							
		25 (0.10)		50 (0.20)		75 (0.30)		100 (0.40)		125 (0.50)		150 (0.60)		175 (0.70)		200 (0.80)									
L/s	cfm	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP						
425	900	580	0.10	0.14	649	0.13	0.17	721	0.14	0.19	794	0.16	0.22	868	0.18	0.24	938	0.20	0.27	998	0.22	0.3	1045	0.25	0.33
472	1000	612	0.13	0.17	681	0.14	0.19	752	0.16	0.22	825	0.19	0.25	897	0.20	0.27	963	0.22	0.3	1017	0.25	0.33	1061	0.28	0.37
519	1100	647	0.15	0.2	717	0.17	0.23	788	0.19	0.26	858	0.21	0.28	926	0.23	0.31	986	0.25	0.34	1036	0.28	0.38	1077	0.31	0.41
566	1200	687	0.17	0.23	757	0.19	0.26	826	0.22	0.29	893	0.24	0.32	955	0.26	0.35	1008	0.29	0.39	1054	0.31	0.42	1095	0.34	0.46
613	1300	730	0.20	0.27	798	0.22	0.3	864	0.25	0.33	926	0.28	0.37	982	0.30	0.4	1030	0.33	0.44	1073	0.35	0.47	1116	0.38	0.51
661	1400	775	0.23	0.31	840	0.25	0.34	902	0.28	0.38	959	0.31	0.42	1009	0.34	0.46	1054	0.37	0.5	1096	0.40	0.53	1140	0.42	0.56
708	1500	820	0.27	0.36	881	0.30	0.4	939	0.33	0.44	993	0.37	0.49	1039	0.40	0.53	1082	0.42	0.56	1124	0.44	0.59	1168	0.46	0.62
Air Volume		225 (0.90)		250 (1.00)		275 (1.10)		300 (1.20)		325 (1.30)		350 (1.40)		375 (1.50)		400 (1.60)									
		Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP						
425	900	1091	0.27	0.36	1140	0.28	0.38	1188	0.30	0.4	1232	0.32	0.43	1272	0.34	0.46	1309	0.37	0.49	1346	0.40	0.53	1383	0.43	0.57
472	1000	1105	0.30	0.4	1154	0.31	0.42	1201	0.34	0.45	1245	0.35	0.47	1284	0.37	0.5	1321	0.40	0.54	1357	0.43	0.58	1394	0.46	0.62
519	1100	1121	0.33	0.44	1169	0.35	0.47	1216	0.37	0.49	1259	0.39	0.52	1298	0.42	0.56	1335	0.45	0.6	1370	0.48	0.64	1406	0.51	0.69
566	1200	1139	0.37	0.49	1187	0.39	0.52	1234	0.40	0.54	1276	0.43	0.58	1314	0.46	0.62	1350	0.49	0.66	1385	0.53	0.71	1421	0.56	0.75
613	1300	1161	0.40	0.54	1208	0.43	0.57	1254	0.45	0.6	1295	0.48	0.64	1332	0.51	0.69	1366	0.54	0.73	1401	0.58	0.78	1436	0.62	0.83
661	1400	1185	0.44	0.59	1232	0.47	0.63	1276	0.50	0.67	1315	0.53	0.71	1351	0.57	0.76	1384	0.60	0.81	1419	0.64	0.86	1454	0.67	0.9
708	1500	1212	0.49	0.66	1257	0.52	0.7	1299	0.55	0.74	1337	0.59	0.79	1371	0.63	0.84	1404	0.66	0.89	1438	0.70	0.94	1473	0.74	0.99

BLOWER DATA - BELT DRIVE - ZCB048 - DOWNFLOW

BLOWER TABLE INCLUDES RESISTANCE FOR BASE UNIT ONLY WITH DRY INDOOR COIL AND AIR FILTERS IN PLACE.
FOR ALL UNITS ADD:

1 - Any factory installed options air resistance (heat section, economizer, wet coil, etc.).

2 - Any field installed accessories air resistance (duct resistance, diffuser, etc.).

See page 24 for blower motors and drives and wet coil and options/accessory air resistance data.

Air Volume		External Static - Pa (in. w.g.)																							
		25 (0.10)		50 (0.20)		75 (0.30)		100 (0.40)		125 (0.50)		150 (0.60)		175 (0.70)		200 (0.80)									
L/s	cfm	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP						
565	1200	641	0.17	0.23	711	0.19	0.25	783	0.20	0.27	852	0.22	0.29	917	0.24	0.32	975	0.26	0.35	1027	0.29	0.39	1074	0.31	0.42
615	1300	673	0.19	0.25	744	0.21	0.28	815	0.22	0.3	882	0.25	0.33	944	0.27	0.36	1000	0.30	0.4	1050	0.33	0.44	1096	0.36	0.48
660	1400	709	0.22	0.29	779	0.24	0.32	849	0.25	0.34	914	0.28	0.37	973	0.31	0.41	1026	0.34	0.45	1074	0.37	0.49	1118	0.40	0.53
710	1500	747	0.25	0.33	816	0.27	0.36	883	0.29	0.39	945	0.31	0.42	1001	0.34	0.46	1052	0.38	0.51	1098	0.41	0.55	1141	0.44	0.59
755	1600	787	0.28	0.38	854	0.31	0.41	918	0.33	0.44	976	0.36	0.48	1030	0.39	0.52	1078	0.42	0.56	1123	0.46	0.61	1164	0.49	0.66
800	1700	827	0.32	0.43	892	0.34	0.46	952	0.37	0.49	1007	0.40	0.53	1058	0.43	0.58	1105	0.47	0.63	1148	0.51	0.68	1189	0.54	0.73
850	1800	868	0.36	0.48	929	0.39	0.52	986	0.41	0.55	1038	0.44	0.59	1087	0.48	0.64	1132	0.51	0.69	1174	0.56	0.75	1214	0.60	0.8
895	1900	907	0.40	0.54	966	0.43	0.58	1019	0.46	0.62	1069	0.49	0.66	1116	0.53	0.71	1160	0.57	0.77	1200	0.61	0.82	1240	0.66	0.88
945	2000	946	0.45	0.6	1001	0.48	0.65	1053	0.51	0.69	1101	0.55	0.74	1146	0.59	0.79	1188	0.63	0.85	1228	0.68	0.91	1267	0.73	0.98

Air Volume		External Static - Pa (in. w.g.)																							
		225 (0.90)		250 (1.00)		275 (1.10)		300 (1.20)		325 (1.30)		350 (1.40)		375 (1.50)		400 (1.60)									
L/s	cfm	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP						
565	1200	1119	0.34	0.45	1163	0.37	0.49	1206	0.39	0.52	1247	0.42	0.56	1287	0.45	0.6	1326	0.48	0.64	1364	0.51	0.68	1402	0.54	0.72
615	1300	1139	0.38	0.51	1182	0.41	0.55	1224	0.43	0.58	1265	0.46	0.62	1304	0.49	0.66	1342	0.53	0.71	1379	0.56	0.75	1416	0.59	0.79
660	1400	1160	0.43	0.57	1202	0.46	0.61	1243	0.48	0.65	1283	0.51	0.69	1322	0.54	0.73	1359	0.58	0.78	1396	0.61	0.82	1432	0.65	0.87
710	1500	1182	0.48	0.64	1223	0.51	0.68	1263	0.54	0.72	1303	0.57	0.76	1341	0.60	0.81	1378	0.63	0.85	1414	0.67	0.9	1449	0.70	0.94
755	1600	1205	0.52	0.7	1245	0.56	0.75	1284	0.59	0.79	1323	0.63	0.84	1361	0.66	0.88	1397	0.69	0.93	1432	0.73	0.98	1467	0.77	1.03
800	1700	1228	0.58	0.78	1268	0.61	0.82	1307	0.65	0.87	1345	0.69	0.92	1382	0.72	0.97	1417	0.76	1.02	1452	0.80	1.07	1486	0.83	1.11
850	1800	1253	0.63	0.85	1292	0.68	0.91	1331	0.72	0.96	1368	0.75	1.01	1404	0.79	1.06	1439	0.83	1.11	1473	0.87	1.16	1506	0.90	1.21
895	1900	1279	0.70	0.94	1317	0.75	1.00	1355	0.78	1.05	1392	0.82	1.1	1427	0.87	1.16	1461	0.90	1.21	1494	0.94	1.26	1527	0.98	1.31
945	2000	1305	0.78	1.04	1343	0.82	1.10	1380	0.86	1.15	1416	0.90	1.21	1450	0.94	1.26	1484	0.98	1.32	1516	1.02	1.37	1549	1.06	1.42

BLOWER DATA - BELT DRIVE - ZCB048 - HORIZONTAL

BLOWER TABLE INCLUDES RESISTANCE FOR BASE UNIT ONLY WITH DRY INDOOR COIL AND AIR FILTERS IN PLACE.
FOR ALL UNITS ADD:

- 1 - Any factory installed options air resistance (heat section, economizer, wet coil, etc.).
- 2 - Any field installed accessories air resistance (duct resistance, diffuser, etc.).

See page 24 for blower motors and drives and wet coil and options/accessory air resistance data.

Air Volume		External Static - Pa (in. w.g.)																							
		25 (0.10)		50 (0.20)		75 (0.30)		100 (0.40)		125 (0.50)		150 (0.60)		175 (0.70)		200 (0.80)									
L/s	cfm	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP						
565	1200	687	0.17	0.23	757	0.19	0.26	826	0.22	0.29	893	0.24	0.32	955	0.26	0.35	1008	0.29	0.39	1054	0.31	0.42	1095	0.34	0.46
615	1300	730	0.20	0.27	798	0.22	0.30	864	0.25	0.33	926	0.28	0.37	982	0.30	0.40	1030	0.33	0.44	1073	0.35	0.47	1116	0.38	0.51
660	1400	775	0.23	0.31	840	0.25	0.34	902	0.28	0.38	959	0.31	0.42	1009	0.34	0.46	1054	0.37	0.50	1096	0.40	0.53	1140	0.42	0.56
710	1500	820	0.27	0.36	881	0.30	0.40	939	0.33	0.44	993	0.37	0.49	1039	0.40	0.53	1082	0.42	0.56	1124	0.44	0.59	1168	0.46	0.62
755	1600	864	0.31	0.42	921	0.34	0.46	976	0.38	0.51	1027	0.42	0.56	1072	0.45	0.60	1113	0.47	0.63	1155	0.49	0.66	1198	0.51	0.69
800	1700	907	0.36	0.48	961	0.40	0.53	1013	0.43	0.58	1061	0.47	0.63	1105	0.50	0.67	1146	0.52	0.70	1187	0.54	0.73	1230	0.57	0.77
850	1800	948	0.42	0.56	999	0.46	0.61	1049	0.49	0.66	1096	0.53	0.71	1139	0.56	0.75	1180	0.58	0.78	1221	0.61	0.82	1262	0.64	0.86
895	1900	987	0.48	0.64	1037	0.51	0.69	1086	0.55	0.74	1132	0.59	0.79	1174	0.62	0.83	1214	0.64	0.86	1255	0.67	0.90	1295	0.71	0.95
945	2000	1028	0.54	0.73	1076	0.58	0.78	1123	0.62	0.83	1168	0.65	0.87	1210	0.68	0.91	1250	0.72	0.96	1289	0.75	1.00	1328	0.79	1.06

Air Volume		External Static - Pa (in. w.g.)																							
		225 (0.90)		250 (1.00)		275 (1.10)		300 (1.20)		325 (1.30)		350 (1.40)		375 (1.50)		400 (1.60)									
L/s	cfm	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP						
565	1200	1139	0.37	0.49	1187	0.39	0.52	1234	0.40	0.54	1276	0.43	0.58	1314	0.46	0.62	1350	0.49	0.66	1385	0.53	0.71	1421	0.56	0.75
615	1300	1161	0.40	0.54	1208	0.43	0.57	1254	0.45	0.60	1295	0.48	0.64	1332	0.51	0.69	1366	0.54	0.73	1401	0.58	0.78	1436	0.62	0.83
660	1400	1185	0.44	0.59	1232	0.47	0.63	1276	0.50	0.67	1315	0.53	0.71	1351	0.57	0.76	1384	0.60	0.81	1419	0.64	0.86	1454	0.67	0.90
710	1500	1212	0.49	0.66	1257	0.52	0.70	1299	0.55	0.74	1337	0.59	0.79	1371	0.63	0.84	1404	0.66	0.89	1438	0.70	0.94	1473	0.74	0.99
755	1600	1242	0.54	0.73	1284	0.57	0.77	1324	0.61	0.82	1360	0.66	0.88	1394	0.69	0.93	1426	0.74	0.99	1460	0.78	1.04	1495	0.81	1.08
800	1700	1272	0.60	0.81	1312	0.64	0.86	1350	0.69	0.92	1385	0.73	0.98	1418	0.78	1.04	1451	0.81	1.09	1485	0.85	1.14	1519	0.89	1.19
850	1800	1302	0.67	0.9	1341	0.72	0.96	1377	0.76	1.02	1411	0.81	1.08	1444	0.86	1.15	1477	0.90	1.20	1510	0.93	1.25	1544	0.97	1.30
895	1900	1334	0.75	1.01	1371	0.80	1.07	1406	0.84	1.13	1439	0.90	1.20	1471	0.94	1.26	1504	0.98	1.32	1537	1.02	1.37	1571	1.05	1.41
945	2000	1365	0.84	1.12	1401	0.89	1.19	1435	0.93	1.25	1468	0.98	1.32	1500	1.03	1.38	1532	1.07	1.44	1565	1.11	1.49	1598	1.14	1.53

BLOWER DATA - BELT DRIVE - ZCB060 - DOWNFLOW

BLOWER TABLE INCLUDES RESISTANCE FOR BASE UNIT ONLY WITH DRY INDOOR COIL AND AIR FILTERS IN PLACE.
FOR ALL UNITS ADD:

1 - Any factory installed options air resistance (heat section, economizer, wet coil, etc.).

2 - Any field installed accessories air resistance (duct resistance, diffuser, etc.).

See page 24 for blower motors and drives and wet coil and options/accessory air resistance data.

Air Volume		External Static - Pa (in. w.g.)																							
		25 (0.10)		50 (0.20)		75 (0.30)		100 (0.40)		125 (0.50)		150 (0.60)		175 (0.70)		200 (0.80)									
L/s	cfm	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP						
755	1600	764	0.34	0.46	823	0.38	0.51	882	0.42	0.56	940	0.45	0.60	997	0.48	0.65	1048	0.51	0.69	1094	0.54	0.72	1140	0.56	0.75
800	1700	806	0.40	0.53	863	0.43	0.58	919	0.46	0.62	975	0.50	0.67	1028	0.53	0.71	1075	0.56	0.75	1119	0.58	0.78	1164	0.60	0.81
850	1800	849	0.45	0.60	903	0.48	0.65	957	0.51	0.69	1010	0.55	0.74	1058	0.58	0.78	1102	0.61	0.82	1145	0.63	0.85	1189	0.66	0.88
895	1900	892	0.51	0.68	944	0.54	0.72	995	0.57	0.77	1045	0.61	0.82	1089	0.64	0.86	1131	0.66	0.89	1174	0.69	0.92	1217	0.71	0.95
945	2000	935	0.57	0.76	984	0.60	0.81	1033	0.64	0.86	1079	0.68	0.91	1122	0.71	0.95	1163	0.72	0.97	1204	0.75	1.00	1247	0.77	1.03
990	2100	977	0.63	0.85	1024	0.67	0.90	1070	0.71	0.95	1114	0.75	1.00	1155	0.77	1.03	1196	0.79	1.06	1237	0.81	1.09	1278	0.84	1.12
1040	2200	1018	0.71	0.95	1063	0.74	0.99	1107	0.78	1.04	1149	0.81	1.09	1190	0.84	1.12	1230	0.86	1.15	1270	0.88	1.18	1310	0.91	1.22
1085	2300	1057	0.78	1.04	1100	0.81	1.09	1143	0.85	1.14	1185	0.88	1.18	1225	0.91	1.22	1264	0.93	1.25	1303	0.96	1.29	1342	0.99	1.33
1135	2400	1096	0.85	1.14	1137	0.88	1.18	1179	0.92	1.23	1220	0.95	1.27	1260	0.98	1.31	1299	1.01	1.35	1337	1.04	1.40	1375	1.08	1.45

Air Volume		External Static - Pa (in. w.g.)																							
		225 (0.90)		250 (1.00)		275 (1.10)		300 (1.20)		325 (1.30)		350 (1.40)		375 (1.50)		400 (1.60)									
L/s	cfm	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP						
755	1600	1185	0.59	0.79	1229	0.60	0.81	1271	0.63	0.84	1313	0.64	0.86	1354	0.67	0.9	1393	0.70	0.94	1431	0.73	0.98	1468	0.77	1.03
800	1700	1208	0.63	0.84	1252	0.65	0.87	1294	0.67	0.9	1335	0.70	0.94	1375	0.73	0.98	1413	0.76	1.02	1449	0.80	1.07	1485	0.84	1.12
850	1800	1233	0.68	0.91	1276	0.70	0.94	1318	0.73	0.98	1358	0.76	1.02	1397	0.79	1.06	1434	0.83	1.11	1469	0.87	1.16	1504	0.90	1.21
895	1900	1261	0.73	0.98	1303	0.76	1.02	1343	0.79	1.06	1382	0.83	1.11	1420	0.87	1.16	1455	0.90	1.21	1490	0.94	1.26	1525	0.98	1.31
945	2000	1289	0.80	1.07	1330	0.83	1.11	1370	0.87	1.16	1407	0.90	1.21	1444	0.95	1.27	1478	0.98	1.32	1513	1.02	1.37	1547	1.06	1.42
990	2100	1319	0.87	1.16	1359	0.90	1.21	1397	0.95	1.27	1433	0.98	1.32	1468	1.03	1.38	1502	1.07	1.44	1536	1.11	1.49	1570	1.14	1.53
1040	2200	1350	0.95	1.27	1388	0.98	1.32	1424	1.03	1.38	1459	1.08	1.45	1494	1.13	1.51	1527	1.16	1.56	1561	1.20	1.61	1594	1.23	1.65
1085	2300	1380	1.03	1.38	1417	1.08	1.45	1452	1.13	1.51	1486	1.18	1.58	1520	1.22	1.63	1553	1.25	1.68	1587	1.29	1.73	1620	1.33	1.78
1135	2400	1411	1.13	1.51	1446	1.18	1.58	1480	1.23	1.65	1514	1.28	1.71	1547	1.32	1.77	1580	1.35	1.81	1614	1.39	1.86	1648	1.42	1.90

BLOWER DATA - BELT DRIVE - ZCBO60 - HORIZONTAL

BLOWER TABLE INCLUDES RESISTANCE FOR BASE UNIT ONLY WITH DRY INDOOR COIL AND AIR FILTERS IN PLACE.
FOR ALL UNITS ADD:

- 1 - Any factory installed options air resistance (heat section, economizer, wet coil, etc.).
- 2 - Any field installed accessories air resistance (duct resistance, diffuser, etc.).

See page 24 for blower motors and drives and wet coil and options/accessory air resistance data.

Air Volume		External Static - Pa (in. w.g.)																							
		25 (0.10)		50 (0.20)		75 (0.30)		100 (0.40)		125 (0.50)		150 (0.60)		175 (0.70)		200 (0.80)									
L/s	cfm	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP						
755	1600	752	0.30	0.40	818	0.34	0.45	882	0.37	0.50	943	0.41	0.55	999	0.44	0.59	1050	0.46	0.62	1097	0.49	0.66	1142	0.51	0.69
800	1700	792	0.34	0.46	855	0.39	0.52	917	0.42	0.56	975	0.46	0.61	1028	0.48	0.64	1077	0.51	0.68	1123	0.54	0.72	1166	0.56	0.75
850	1800	832	0.40	0.53	894	0.43	0.58	952	0.47	0.63	1007	0.50	0.67	1058	0.52	0.70	1105	0.55	0.74	1149	0.58	0.78	1192	0.61	0.82
895	1900	873	0.45	0.60	932	0.48	0.65	988	0.51	0.69	1040	0.54	0.73	1088	0.57	0.77	1134	0.60	0.81	1177	0.63	0.85	1219	0.67	0.90
945	2000	914	0.50	0.67	970	0.54	0.72	1023	0.57	0.76	1073	0.60	0.80	1120	0.63	0.85	1163	0.66	0.89	1205	0.70	0.94	1246	0.74	0.99
990	2100	955	0.55	0.74	1009	0.59	0.79	1059	0.63	0.84	1107	0.66	0.89	1152	0.69	0.93	1194	0.73	0.98	1235	0.77	1.03	1275	0.81	1.09
1040	2200	995	0.62	0.83	1047	0.66	0.88	1095	0.69	0.93	1141	0.73	0.98	1184	0.77	1.03	1225	0.81	1.08	1265	0.85	1.14	1304	0.90	1.20
1085	2300	1036	0.69	0.92	1085	0.72	0.97	1132	0.76	1.02	1175	0.81	1.08	1217	0.84	1.13	1257	0.89	1.19	1296	0.94	1.26	1334	0.98	1.32
1135	2400	1077	0.75	1.01	1124	0.80	1.07	1168	0.84	1.13	1210	0.89	1.19	1251	0.93	1.25	1290	0.98	1.32	1328	1.04	1.39	1365	1.09	1.46

Air Volume		External Static - Pa (in. w.g.)																							
		225 (0.90)		250 (1.00)		275 (1.10)		300 (1.20)		325 (1.30)		350 (1.40)		375 (1.50)		400 (1.60)									
L/s	cfm	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP	Rev/ min	kW	BHP						
755	1600	1185	0.54	0.72	1228	0.56	0.75	1270	0.59	0.79	1310	0.62	0.83	1349	0.66	0.88	1387	0.69	0.93	1423	0.73	0.98	1459	0.77	1.03
800	1700	1209	0.58	0.78	1251	0.61	0.82	1292	0.65	0.87	1331	0.69	0.92	1370	0.72	0.97	1407	0.76	1.02	1443	0.80	1.07	1478	0.84	1.12
850	1800	1234	0.64	0.86	1275	0.68	0.91	1315	0.72	0.96	1354	0.75	1.01	1391	0.79	1.06	1428	0.83	1.11	1463	0.87	1.17	1498	0.91	1.22
895	1900	1260	0.71	0.95	1300	0.75	1.00	1340	0.78	1.05	1377	0.83	1.11	1414	0.87	1.16	1450	0.91	1.22	1485	0.95	1.27	1519	0.98	1.32
945	2000	1287	0.78	1.04	1326	0.82	1.10	1365	0.87	1.16	1402	0.90	1.21	1437	0.95	1.27	1472	0.99	1.33	1507	1.03	1.38	1541	1.07	1.43
990	2100	1314	0.86	1.15	1353	0.90	1.21	1391	0.95	1.27	1427	0.99	1.33	1462	1.04	1.39	1496	1.07	1.44	1530	1.12	1.50	1564	1.16	1.55
1040	2200	1343	0.94	1.26	1381	0.99	1.33	1417	1.04	1.39	1453	1.08	1.45	1487	1.13	1.51	1521	1.16	1.56	1555	1.21	1.62	1589	1.25	1.67
1085	2300	1372	1.04	1.39	1409	1.08	1.45	1445	1.13	1.52	1480	1.18	1.58	1513	1.22	1.64	1547	1.26	1.69	1580	1.31	1.75	1614	1.34	1.80
1135	2400	1402	1.13	1.52	1438	1.19	1.59	1473	1.23	1.65	1507	1.28	1.71	1541	1.32	1.77	1574	1.37	1.83	1607	1.40	1.88	1641	1.44	1.93

BLOWER DATA - BELT DRIVE - ZCB074 - DOWNFLOW

**BLOWER TABLE INCLUDES RESISTANCE FOR BASE UNIT ONLY WITH DRY INDOOR COIL AND AIR FILTERS IN PLACE.
FOR ALL UNITS ADD:**

- 1 - Any factory installed options air resistance (heat section, economizer, wet coil, etc.).
- 2 - Any field installed accessories air resistance (duct resistance, diffuser, etc.).

See page 24 for blower motors and drives and wet coil and options/accessory air resistance data.

Air Volume		External Static - Pa (in.w.g.)																							
		25 (0.10)		50 (0.20)		75 (0.30)		100 (0.40)		125 (0.50)		150 (0.60)		175 (0.70)		200 (0.80)									
L/s	cfm	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP						
900	1900	578	0.33	0.44	610	0.37	0.49	643	0.40	0.54	678	0.45	0.60	714	0.48	0.65	749	0.52	0.70	785	0.57	0.76	819	0.61	0.82
945	2000	600	0.37	0.50	632	0.42	0.56	665	0.46	0.61	699	0.49	0.66	734	0.53	0.71	769	0.57	0.77	803	0.62	0.83	837	0.67	0.90
990	2100	623	0.43	0.57	655	0.46	0.62	688	0.51	0.68	721	0.54	0.73	755	0.59	0.79	789	0.63	0.84	822	0.68	0.91	854	0.73	0.98
1040	2200	647	0.48	0.65	678	0.52	0.70	711	0.56	0.75	743	0.60	0.81	776	0.64	0.86	809	0.69	0.93	841	0.75	1.00	872	0.79	1.06
1085	2300	671	0.54	0.73	702	0.58	0.78	734	0.62	0.83	766	0.66	0.89	798	0.71	0.95	829	0.76	1.02	860	0.81	1.09	890	0.87	1.16
1135	2400	696	0.60	0.81	726	0.65	0.87	757	0.69	0.92	788	0.73	0.98	819	0.78	1.04	850	0.83	1.11	880	0.89	1.19	909	0.94	1.26
1180	2500	720	0.67	0.90	750	0.71	0.95	780	0.75	1.01	811	0.80	1.07	841	0.85	1.14	871	0.91	1.22	900	0.97	1.30	929	1.02	1.37
1225	2600	745	0.74	0.99	774	0.78	1.05	804	0.83	1.11	834	0.87	1.17	864	0.93	1.25	893	0.99	1.33	921	1.05	1.41	949	1.11	1.49
1275	2700	770	0.81	1.09	799	0.86	1.15	828	0.90	1.21	858	0.95	1.28	887	1.01	1.36	916	1.07	1.44	943	1.14	1.53	969	1.20	1.61
1320	2800	795	0.89	1.19	824	0.93	1.25	853	0.99	1.33	882	1.04	1.40	911	1.10	1.48	939	1.16	1.56	965	1.23	1.65	990	1.29	1.73
1370	2900	820	0.97	1.30	849	1.02	1.37	878	1.08	1.45	907	1.14	1.53	935	1.20	1.61	962	1.27	1.70	988	1.33	1.78	1012	1.39	1.86

Air Volume		External Static - Pa (in.w.g.)																							
		820		250 (1.00)		275 (1.10)		300 (1.20)		325 (1.30)		350 (1.40)		375 (1.50)		400 (1.60)									
L/s	cfm	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP	Rev/min	kW	BHP						
900	1900	853	0.66	0.88	885	0.70	0.94	915	0.74	0.99	944	0.78	1.05	971	0.83	1.11	996	0.87	1.17	1021	0.92	1.23	1045	0.96	1.29
945	2000	869	0.72	0.96	899	0.75	1.01	929	0.80	1.07	957	0.84	1.13	984	0.89	1.19	1009	0.93	1.25	1033	0.98	1.31	1058	1.03	1.38
990	2100	885	0.78	1.04	915	0.82	1.10	944	0.86	1.15	971	0.91	1.22	997	0.95	1.28	1022	1.00	1.34	1046	1.04	1.40	1070	1.09	1.46
1040	2200	902	0.84	1.13	931	0.89	1.19	959	0.93	1.24	986	0.98	1.31	1012	1.02	1.37	1036	1.07	1.43	1060	1.12	1.50	1084	1.16	1.56
1085	2300	920	0.92	1.23	948	0.96	1.29	975	1.01	1.35	1001	1.05	1.41	1027	1.10	1.47	1051	1.14	1.53	1075	1.19	1.60	1098	1.24	1.66
1135	2400	938	0.99	1.33	965	1.04	1.39	992	1.08	1.45	1017	1.13	1.52	1042	1.18	1.58	1066	1.22	1.64	1090	1.27	1.70	1113	1.32	1.77
1180	2500	956	1.07	1.44	983	1.13	1.51	1009	1.17	1.57	1034	1.22	1.63	1059	1.26	1.69	1082	1.31	1.75	1105	1.36	1.82	1128	1.40	1.88
1225	2600	975	1.16	1.56	1001	1.22	1.63	1026	1.26	1.69	1051	1.31	1.75	1075	1.35	1.81	1098	1.40	1.87	1121	1.44	1.93	1143	1.49	2.00
1275	2700	995	1.25	1.68	1020	1.31	1.75	1044	1.35	1.81	1069	1.40	1.87	1092	1.44	1.93	1114	1.48	1.99	1136	1.54	2.06	1158	1.59	2.13
1320	2800	1015	1.35	1.81	1039	1.40	1.87	1063	1.45	1.94	1086	1.49	2.00	1109	1.54	2.06	1131	1.58	2.12	1152	1.63	2.19	1174	1.69	2.26
1370	2900	1035	1.45	1.94	1058	1.49	2.00	1081	1.54	2.07	1104	1.59	2.13	1126	1.63	2.19	1147	1.69	2.26	1168	1.74	2.33	1189	1.79	2.40

BLOWER DATA - BELT DRIVE - ZCB074 - HORIZONTAL

BLOWER TABLE INCLUDES RESISTANCE FOR BASE UNIT ONLY WITH DRY INDOOR COIL AND AIR FILTERS IN PLACE.

FOR ALL UNITS ADD:

1 - Any factory installed options air resistance (heat section, economizer, wet coil, etc.).

2 - Any field installed accessories air resistance (duct resistance, diffuser, etc.).

See page 24 for blower motors and drives and wet coil and options/accessory air resistance data.

Air Volume		External Static - Pa (in.w.g.)																							
		25 (0.10)		50 (0.20)		75 (0.30)		100 (0.40)		125 (0.50)		150 (0.60)		175 (0.70)		200 (0.80)									
L/s	cfm	Rev/ min	BHP	KW	Rev/ min	BHP	KW	Rev/ min	BHP	KW	Rev/ min	BHP	KW	Rev/ min	BHP	KW	Rev/ min	BHP	KW						
900	1900	581	0.33	0.44	618	0.37	0.49	655	0.40	0.54	692	0.44	0.59	729	0.48	0.64	765	0.51	0.69	800	0.56	0.75	833	0.60	0.80
945	2000	602	0.37	0.50	639	0.41	0.55	676	0.46	0.61	713	0.49	0.66	749	0.53	0.71	784	0.57	0.76	818	0.61	0.82	850	0.66	0.88
990	2100	625	0.43	0.57	661	0.46	0.62	698	0.50	0.67	735	0.54	0.73	770	0.58	0.78	804	0.63	0.84	837	0.67	0.90	868	0.72	0.96
1040	2200	648	0.48	0.64	685	0.51	0.69	721	0.56	0.75	757	0.60	0.80	791	0.64	0.86	824	0.69	0.92	856	0.73	0.98	886	0.78	1.05
1085	2300	673	0.53	0.71	709	0.57	0.77	745	0.62	0.83	780	0.66	0.88	813	0.70	0.94	845	0.75	1.01	876	0.81	1.08	905	0.86	1.15
1135	2400	699	0.59	0.79	734	0.63	0.85	769	0.68	0.91	803	0.72	0.97	835	0.78	1.04	866	0.83	1.11	896	0.88	1.18	924	0.93	1.25
1180	2500	725	0.66	0.88	759	0.70	0.94	793	0.75	1.00	826	0.80	1.07	857	0.85	1.14	887	0.90	1.21	916	0.95	1.28	944	1.01	1.36
1225	2600	752	0.72	0.97	785	0.78	1.04	818	0.82	1.10	850	0.87	1.17	880	0.93	1.25	909	0.98	1.32	937	1.04	1.40	964	1.10	1.48
1275	2700	779	0.80	1.07	811	0.85	1.14	843	0.90	1.21	873	0.96	1.29	902	1.02	1.37	931	1.07	1.44	958	1.13	1.52	984	1.19	1.60
1320	2800	805	0.88	1.18	837	0.94	1.26	868	0.99	1.33	897	1.05	1.41	925	1.11	1.49	952	1.17	1.57	979	1.24	1.66	1004	1.30	1.74
1370	2900	832	0.97	1.30	863	1.03	1.38	892	1.09	1.46	921	1.15	1.54	948	1.22	1.63	974	1.28	1.71	1000	1.34	1.80	1024	1.40	1.88
Air Volume		External Static - Pa (in.w.g.)																							
		225 (0.90)		250 (1.00)		275 (1.10)		300 (1.20)		325 (1.30)		350 (1.40)		375 (1.50)		400 (1.60)									
L/s	cfm	Rev/ min	BHP	KW	Rev/ min	BHP	KW	Rev/ min	BHP	KW	Rev/ min	BHP	KW	Rev/ min	BHP	KW	Rev/ min	BHP	KW						
900	1900	864	0.65	0.87	895	0.69	0.93	924	0.74	0.99	953	0.79	1.06	980	0.84	1.12	1007	0.88	1.18	1032	0.93	1.25	1056	0.98	1.31
945	2000	881	0.71	0.95	911	0.75	1.01	940	0.81	1.08	967	0.85	1.14	994	0.90	1.21	1020	0.95	1.27	1044	1.00	1.34	1068	1.04	1.40
990	2100	898	0.77	1.03	927	0.82	1.10	955	0.87	1.17	982	0.92	1.23	1008	0.97	1.30	1033	1.02	1.37	1057	1.07	1.43	1080	1.12	1.50
1040	2200	916	0.84	1.12	944	0.89	1.19	971	0.94	1.26	998	0.99	1.33	1023	1.04	1.40	1047	1.10	1.47	1071	1.15	1.54	1093	1.19	1.60
1085	2300	934	0.91	1.22	961	0.96	1.29	988	1.01	1.36	1014	1.07	1.43	1038	1.12	1.50	1062	1.18	1.58	1085	1.23	1.65	1107	1.28	1.71
1135	2400	952	0.98	1.32	979	1.04	1.40	1005	1.10	1.47	1030	1.15	1.54	1054	1.21	1.62	1077	1.26	1.69	1099	1.31	1.76	1121	1.37	1.83
1180	2500	971	1.07	1.43	997	1.13	1.51	1022	1.19	1.59	1046	1.24	1.66	1069	1.30	1.74	1092	1.35	1.81	1114	1.40	1.88	1135	1.45	1.95
1225	2600	990	1.16	1.55	1015	1.22	1.63	1039	1.28	1.71	1063	1.34	1.79	1086	1.39	1.86	1108	1.45	1.94	1129	1.50	2.01	1150	1.54	2.07
1275	2700	1009	1.25	1.68	1034	1.31	1.76	1057	1.37	1.84	1080	1.43	1.92	1102	1.48	1.99	1124	1.54	2.07	1145	1.60	2.14	1166	1.65	2.21
1320	2800	1028	1.36	1.82	1052	1.42	1.90	1075	1.48	1.98	1097	1.54	2.06	1119	1.59	2.13	1140	1.65	2.21	1161	1.70	2.28	1182	1.75	2.34
1370	2900	1048	1.46	1.96	1071	1.52	2.04	1093	1.58	2.12	1115	1.64	2.20	1136	1.70	2.28	1157	1.75	2.35	1177	1.81	2.42	1198	1.85	2.48

BLOWER DATA

BELT DRIVE KIT SPECIFICATIONS - 036-060

Model No.	Motor kW (HP)		No. of Speeds	Drive Kits and Rev/Min Range					
	Nominal	Maximum		ZA07	ZA08	ZA09	ZA10	¹ ZA11	² ZA12
036	0.62 (0.83)	0.71 (0.95)	1	705 - 1077	---	---	1025 - 1391	---	---
	0.93 (1.25)	1.07 (1.43)	1	705 - 1077	---	---	1025 - 1391	---	---
048	0.62 (0.83)	0.71 (0.95)	1	---	759 -1158	---	---	1111 - 1437	---
	0.93 (1.25)	1.07 (1.43)	1	---	759 -1158	---	---	1111 - 1437	---
060	0.93 (1.25)	1.07 (1.43)	1	---	---	919 - 1247	---	---	1190 - 1540
	1.24 (1.66)	1.42 (1.91)	1	---	---	919 - 1247	---	---	1190 - 1540

NOTE - Using total air volume and system static pressure requirements determine from blower performance tables rev/min and motor size required. Maximum usable size of motors furnished are shown. If motors of comparable size are used, be sure to keep within the service factor limitations outlined on the motor nameplate.

¹ ZA11 drive kits require the 0.93 kW (1.25 hp) motor.

² ZA12 drive kit requires the 1.24 kW (1.66 hp) motor.

BELT DRIVE KIT SPECIFICATIONS - 074

Model No.	Motor kW (HP)		No. of Speeds	Drive Kits and Rev/Min Range		
	Nominal	Maximum		ZAA03	ZAA04	ZAA05
074	1.24 (1.66)	1.42 (1.91)	2	665 - 921	768 - 1023	921 - 1177
	1.24 (1.66)	1.42 (1.91)	2	665 - 921	768 - 1023	921 - 1177

NOTE - Using total air volume and system static pressure requirements determine from blower performance tables rev/min and motor size required. Maximum usable size of motors furnished are shown. If motors of comparable size are used, be sure to keep within the service factor limitations outlined on the motor nameplate.

POWER EXHAUST FAN PERFORMANCE

Return Air System Static Pressure		Air Volume Exhausted	
Pa	in. w.g.	L/s	cfm
0	0.00	880	1865
12	0.05	842	1785
25	0.10	807	1710
37	0.15	769	1630
50	0.20	729	1545
62	0.25	684	1450
75	0.30	637	1350
87	0.35	585	1240

OPTIONS / ACCESSORIES AIR RESISTANCE

Air Volume		036, 048				060, 074				Electric Heat		Economizer			
		036, 048		060, 074		Electric Heat		Downflow		Horizontal					
L/s	cfm	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.		
425	900	2	0.01	---	---	12	0.05	7	0.03	10	0.04				
472	1000	5	0.02	---	---	15	0.06	7	0.03	12	0.05				
519	1100	5	0.02	---	---	20	0.08	10	0.04	12	0.05				
566	1200	5	0.02	---	---	22	0.09	12	0.05	15	0.06				
613	1300	7	0.03	---	---	30	0.12	12	0.05	17	0.07				
661	1400	7	0.03	---	---	42	0.17	15	0.06	20	0.08				
708	1500	10	0.04	---	---	55	0.22	17	0.07	20	0.08				
755	1600	10	0.04	7	0.03	65	0.26	20	0.08	22	0.09				
802	1700	12	0.05	7	0.03	75	0.30	22	0.09	25	0.10				
849	1800	12	0.05	7	0.03	82	0.33	25	0.10	27	0.11				
897	1900	15	0.06	10	0.04	82	0.33	27	0.11	30	0.12				
944	2000	15	0.06	10	0.04	77	0.31	30	0.12	32	0.13				
991	2100	---	---	12	0.05	67	0.27	32	0.13	35	0.14				
1038	2200	---	---	12	0.05	72	0.29	35	0.14	37	0.15				
1085	2300	---	---	12	0.05	77	0.31	37	0.15	40	0.16				
1133	2400	---	---	15	0.06	80	0.32	40	0.16	45	0.18				
1180	2500	---	---	15	0.06	85	0.34	45	0.18	47	0.19				
1227	2600	---	---	17	0.07	94	0.38	47	0.19	50	0.20				
1274	2700	---	---	17	0.07	104	0.42	50	0.20	52	0.21				
1321	2800	---	---	17	0.07	112	0.45	55	0.22	57	0.23				
1369	2900	---	---	20	0.08	122	0.49	57	0.23	60	0.24				

BLOWER DATA

CEILING DIFFUSERS AIR RESISTANCE

Air Volume		RTD9-65S Step-Down Diffuser						FD9-65S Flush Diffuser		RTD11-95S Step-Down Diffuser						FD11-95S Flush Diffuser	
		2 Ends Open		1 Side & 2 Ends Open		All Ends & Sides Open				2 Ends Open		1 Side & 2 Ends Open		All Ends & Sides Open			
L/s	cfm	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.	Pa	in. w.g.
375	800	37	0.15	32	0.13	27	0.11	27	0.11	---	---	---	---	---	---	---	---
470	1000	47	0.19	40	0.16	35	0.14	35	0.14	---	---	---	---	---	---	---	---
565	1200	62	0.25	50	0.20	42	0.17	42	0.17	---	---	---	---	---	---	---	---
660	1400	82	0.33	65	0.26	50	0.20	50	0.20	---	---	---	---	---	---	---	---
755	1600	107	0.43	80	0.32	50	0.20	50	0.24	---	---	---	---	---	---	---	---
850	1800	139	0.56	99	0.40	75	0.30	75	0.30	32	0.13	27	0.11	22	0.09	22	0.09
945	2000	182	0.73	124	0.50	90	0.36	90	0.36	37	0.15	32	0.13	27	0.11	25	0.10
1040	2200	236	0.95	157	0.63	109	0.44	109	0.44	45	0.18	37	0.15	30	0.12	30	0.12
1130	2400	---	---	---	---	---	---	---	---	52	0.21	45	0.18	37	0.15	35	0.14
1225	2600	---	---	---	---	---	---	---	---	60	0.24	52	0.21	45	0.18	42	0.17
1320	2800	---	---	---	---	---	---	---	---	67	0.27	60	0.24	52	0.21	50	0.20
1415	3000	---	---	---	---	---	---	---	---	80	0.32	72	0.29	62	0.25	62	0.25
1510	3200	---	---	---	---	---	---	---	---	102	0.41	92	0.37	80	0.32	77	0.31
1605	3400	---	---	---	---	---	---	---	---	124	0.50	112	0.45	97	0.39	92	0.37
1700	3600	---	---	---	---	---	---	---	---	152	0.61	134	0.54	119	0.48	109	0.44

CEILING DIFFUSER AIR THROW DATA

Air Volume		¹ Effective Throw			
Model No.		RTD9-65S		FD9-65S	
L/s	cfm	m	ft.	m	ft.
375	800	3 - 5	10 - 17	4 - 5	14 - 18
470	1000	3 - 5	10 - 17	5 - 6	15 - 20
565	1200	3 - 5	11 - 18	5 - 7	16 - 22
660	1400	4 - 6	12 - 19	5 - 7	17 - 24
755	1600	4 - 6	12 - 20	5 - 8	18 - 25
850	1800	4 - 6	13 - 21	6 - 9	20 - 28
945	2000	4 - 7	14 - 23	6 - 9	21 - 29
1040	2200	5 - 8	16 - 25	7 - 9	22 - 30
Model No.		RTD11-95S		FD11-95S	
1225	2600	7 - 9	24 - 29	6 - 7	19 - 24
1320	2800	8 - 9	25 - 30	6 - 9	20 - 28
1415	3000	8 - 10	27 - 33	6 - 9	21 - 29
1510	3200	9 - 11	28 - 35	7 - 9	22 - 29
1605	3400	9 - 11	30 - 37	7 - 9	22 - 30
1700	3600	8 - 10	25 - 33	7 - 8	22 - 24

¹ Effective throw based on terminal velocities of 23 m per minute (75 ft. per minute).

ELECTRICAL DATA

Model No.		ZCB036S4		ZCB048S4		ZCB060S4		ZCB074S4
¹ Voltage - 50hz with Neutral		380/420V - 3 Ph		380/420V - 3 Ph		380/420V - 3 Ph		380/420V - 3 Ph
Compressor	Rated Load Amps	4		5.5		8		8.5
	Locked Rotor Amps	31		37		59		66
Outdoor Fan Motor	Full Load Amps	0.9		0.9		0.9		1
Power Exhaust (1) 0.25 kW	Full Load Amps	0.6		0.6		0.6		1.3
Indoor Blower Motor	kW	0.62	0.93	0.62	0.93	0.93	1.24	1.24
	Full Load Amps	1.6	2	1.6	2	2	2.6	2.6
² Maximum Overcurrent Protection	Unit Only	15	15	15	15	20	20	20
	With (1) 0.25 kW Power Exhaust	15	15	15	15	20	20	20
³ Minimum Circuit Ampacity	Unit Only	8	8	10	10	13	14	15
	With (1) 0.25 kW Power Exhaust	9	9	10	11	14	15	16

ELECTRIC HEAT DATA

Electric Heat Voltage			420V	420V	420V	420V	420V	420V	420V
² Maximum Overcurrent Protection	⁴ Electric Heat	Unit+ 3.8 kW	15	15	15	15	20	20	---
		5.7 kW	15	15	15	15	20	20	20
		7.7 kW	20	20	20	20	20	20	20
		11.5 kW	25	25	25	25	25	25	25
		17.2 kW	---	---	35	35	35	35	35
		23 kW	---	---	---	---	---	---	45
³ Minimum Circuit Ampacity	⁴ Electric Heat	Unit+ 3.8 kW	9	10	10	10	13	14	---
		5.7 kW	12	13	12	13	13	14	15
		7.7 kW	16	16	16	16	16	17	17
		11.5 kW	22	23	22	23	23	24	23
		17.2 kW	---	---	32	33	33	34	33
		23 kW	---	---	---	---	---	---	43
² Maximum Overcurrent Protection	⁴ Electric Heat and (1) 0.25 kW Power Exhaust	Unit+ 3.8 kW	15	15	15	15	20	20	---
		5.7 kW	15	15	15	15	20	20	20
		7.7 kW	20	20	20	20	20	20	20
		11.5 kW	25	25	25	25	25	25	25
		17.2 kW	---	---	35	35	35	35	35
		23 kW	---	---	---	---	---	---	45
³ Minimum Circuit Ampacity	⁴ Electric Heat and (1) 0.25 kW Power Exhaust	Unit+ 3.8 kW	10	10	10	11	14	15	---
		5.7 kW	13	14	13	14	14	15	16
		7.7 kW	16	17	16	17	17	18	19
		11.5 kW	23	23	23	23	23	25	25
		17.2 kW	---	---	33	33	33	34	35
		23 kW	---	---	---	---	---	---	45

ELECTRIC HEAT ACCESSORIES

Unit Fuse Block	Unit Only	10A29	10A29	10A29	10A29	10A29	10A29	10A29
	Unit + Power Exhaust	10A29	10A29	10A29	10A29	10A29	10A29	10A29

¹ Extremes of operating range are plus and minus 10% of line voltage.

² Heating, Air Conditioning, Refrigeration type breaker or fuse.

³ Refer to local electrical code to determine wire, fuse and disconnect size requirements.

⁴ Nominal kW based on 420V-3ph-50hz.

ELECTRIC HEAT CAPACITIES

Input Voltage	3.8 kW			5.7 kW			7.7 kW		
	No of Stages	kW input	Btuh Output	No of Stages	kW input	Btuh Output	No of Stages	kW input	Btuh Output
380	1	3.1	10 700	1	4.7	16 000	1	6.3	21 400
400	1	3.5	11 800	1	5.2	17 800	1	6.9	23 700
420	1	3.8	13 100	1	5.7	19 600	1	7.7	26 100
Input Voltage	11.5 kW			17.2 kW			23 kW		
	No of Stages	kW input	Btuh Output	No of Stages	kW input	Btuh Output	No of Stages	kW input	Btuh Output
380	1	9.4	32 100	1	14.1	48 100	1	18.8	64 200
400	1	10.4	35 500	1	15.6	53 300	1	20.9	71 200
420	1	11.5	39 200	1	17.2	58 800	1	23.0	78 500


OUTDOOR SOUND DATA

Unit Model No.	Octave Band Sound Power Levels dB, re 10 ⁻¹² Watts - Center Frequency - Hz							¹ Sound Rating Number (dBA)
	125	250	500	1000	2000	4000	8000	
ZCB036	81	78	77	72	68	66	61	77
ZCB048	84	80	79	74	70	67	63	80
ZCB060	80	76	76	73	68	66	64	78
ZCB074	88	85	84	79	72	66	64	84


¹ Sound Rating Number according to AHRI Standard 270-2008. Sound Rating Number is the overall A-Weighted Sound Power Level, (LWA), dB (100 Hz to 10,000 Hz).

UNIT CLEARANCES

UNIT WITH DOWNFLOW ECONOMIZER

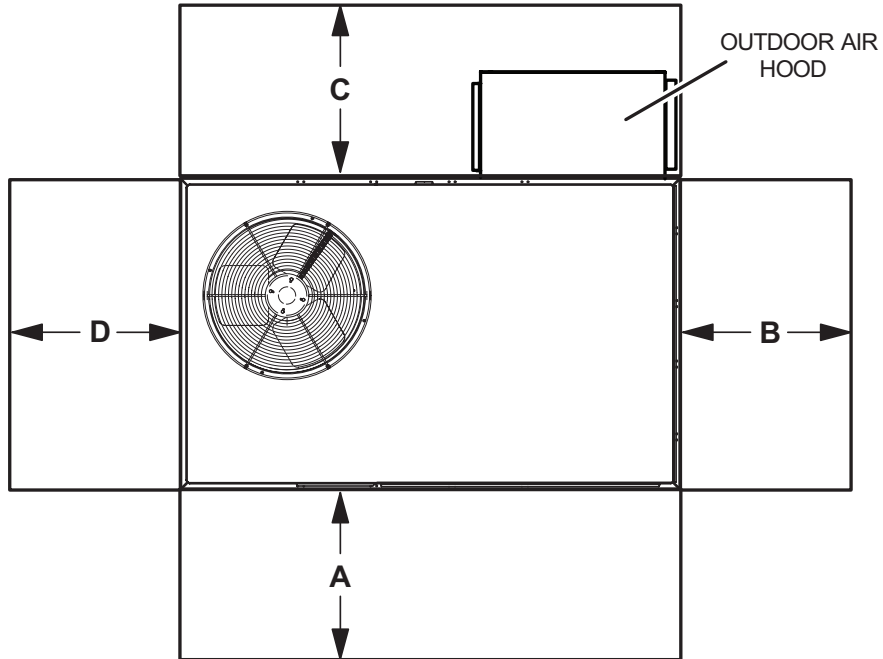

UNIT WITH HORIZONTAL ECONOMIZER

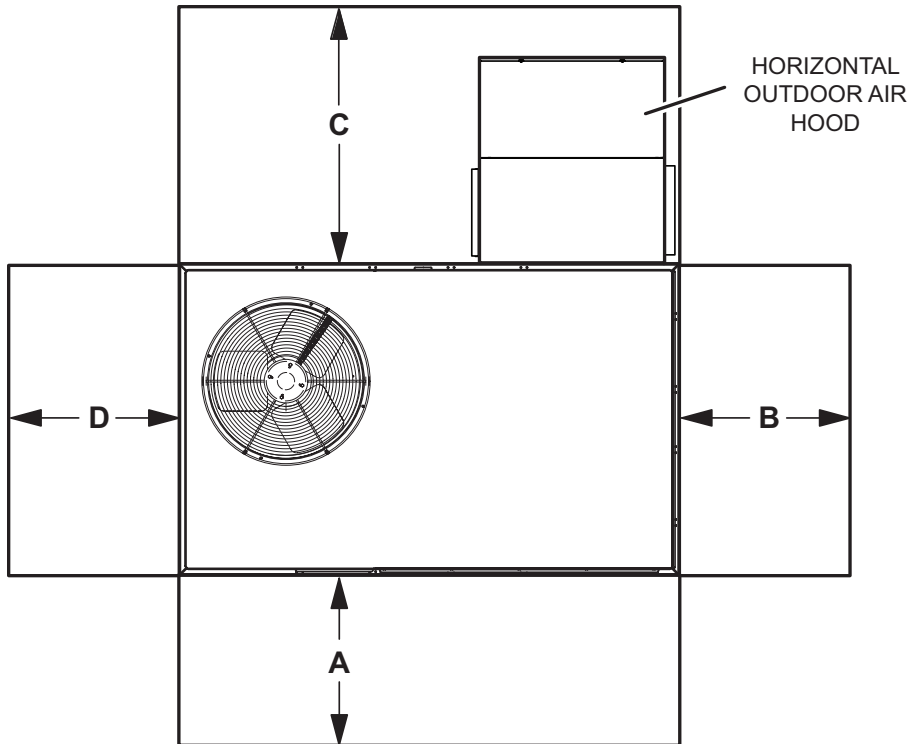


¹ Unit Clearance	A		B		C Downflow		C Horizontal		D		Top Clearance
	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	
Service Clearance	914	36	914	36	914	36	1524	60	914	36	Unobstructed
Minimum Operation Clearance	914	36	914	36	914	36	1524	60	914	36	

NOTE - Entire perimeter of unit base requires support when elevated above the mounting surface.

¹ Service Clearance - Required for removal of serviceable parts.

Minimum Operation Clearance - Required clearance for proper unit operation.

OPTIONAL CONVENTIONAL TEMPERATURE CONTROL SYSTEMS

Item	Model No.	Catalog No.
7-DAY PROGRAMMABLE THERMOSTAT - BACNET COMPATIBLE WITH REHEAT FUNCTION		
 <ul style="list-style-type: none"> • For units with or without ¹ Dehumidification Option • BTL listed MS/TP ensures compatibility with any BACnet system • Built-in control programs for conventional and heat pump applications • Conventional systems up to 3-stage heat and 3-stage cool • Heat pumps with 1 or 2 compressors and up to 2-stage auxiliary heat • On-board temperature and humidity sensor • Multiple configurable inputs and outputs enable advanced control strategies • Set-up Wizard enables rapid system configuration • No special tools required for installation or commissioning • Seven-day (2, 4 or 6 event) occupancy scheduling per day • Backlit 5-inch LCD touchscreen 	---	Y8241

¹ BACnet Thermostat (Y8241) will control units with and without dehumidification. If there is a mix of units equipped with and without dehumidification on the same site, this thermostat can be used for all units if desired.

BACnet Controls (no reheat capability)	BACnet® Module (factory or field installed)	K0CTRL31A-2	16X70
	BACnet® Room Sensor with Display (field installed)	K0SNSR01FF1	97W23
	BACnet® Room Sensor without Display (field installed)	K0SNSR00FF1	97W24
Optional Accessories	Plenum Cable (RJ45/CAT5 75 ft.)	K0MISC00FF1	97W25

WEIGHT DATA

Model Number	Net				Shipping			
	Base		Max.		Base		Max.	
	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.
ZCB036S	215	474	247	544	217	479	249	549
ZCB048S	219	483	251	553	221	488	253	558
ZCB060S	258	568	290	640	260	573	293	645
ZCB074S	258	568	282	621	260	573	284	626

Base Unit - The unit with NO OPTIONS.

Max. Unit - The unit with ALL OPTIONS Installed. (Economizer, etc.)

OPTIONS / ACCESSORIES

		Shipping Weights	
		kg	lbs.
ECONOMIZER			
Economizer			
Economizer, Includes Outdoor Air Hood and Barometric Relief Dampers with Hood	Downflow	34	75
	Horizontal	46	102
OUTDOOR AIR			
Outdoor Air Dampers			
Motorized		18	39
Manual		13	29
POWER EXHAUST			
Standard Static	Downflow	24	54
	Horizontal	19	41
ELECTRIC HEAT			
3.8 kW		11	25
5.7 kW		12	26
7.7 kW		12	27
11.5 kW		12	27
17.2 kW		13	29
23 kW		14	30
ROOF CURBS			
Hybrid Roof Curbs, Downflow			
203 mm		29	63
356 mm		38	83
457 mm		42	93
610 mm		51	113
CEILING DIFFUSERS			
Step-Down	RTD9-65S	36	80
	RTD11-95S	54	118
Flush	FD9-65S	36	80
	FD11-95S	54	118

DIMENSIONS - UNIT

Model No.	CORNER WEIGHTS																CENTER OF GRAVITY							
	AA				BB				CC				DD				EE				FF			
	Base		Max.		Base		Max.		Base		Max.		Base		Max.		Base		Max.		Base		Max.	
	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	mm	in.	mm	in.	mm	in.	mm	in.
036	53	117	61	134	51	112	59	129	54	120	63	138	57	125	65	143	984	38.75	933	36.75	578	22.75	622	24.5
048	54	119	62	136	52	115	59	131	55	122	64	140	58	127	66	145	984	38.75	933	36.75	578	22.75	622	24.5
060	71	156	80	176	64	140	72	158	59	129	66	145	65	143	73	161	1016	40	965	38	622	24.5	660	26
074	62	136	68	149	62	136	68	149	67	148	73	162	67	148	73	162	965	38	914	36	572	22.5	610	24



Base Unit - The unit with NO OPTIONS.

Max. Unit - The unit with ALL OPTIONS Installed. (Economizer, largest blower motor, etc.).

BOTTOM POWER ENTRY


Holes required for Optional Bottom Power Entry Kit

	Threaded Conduit Fittings (Provided in Kit)	Wire Use	Hole Diameter Required in Unit Base (Max.)
A	1/2	ACC	23 (7/8)
B	1/2	24V	23 (7/8)
C	3/4	POWER	29 (1-1/8)

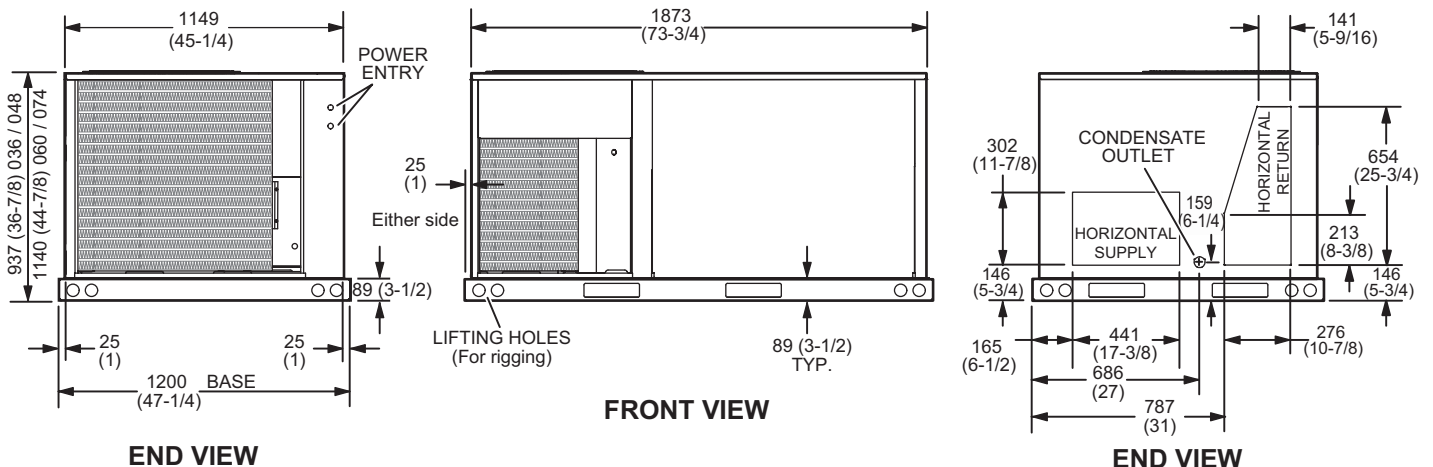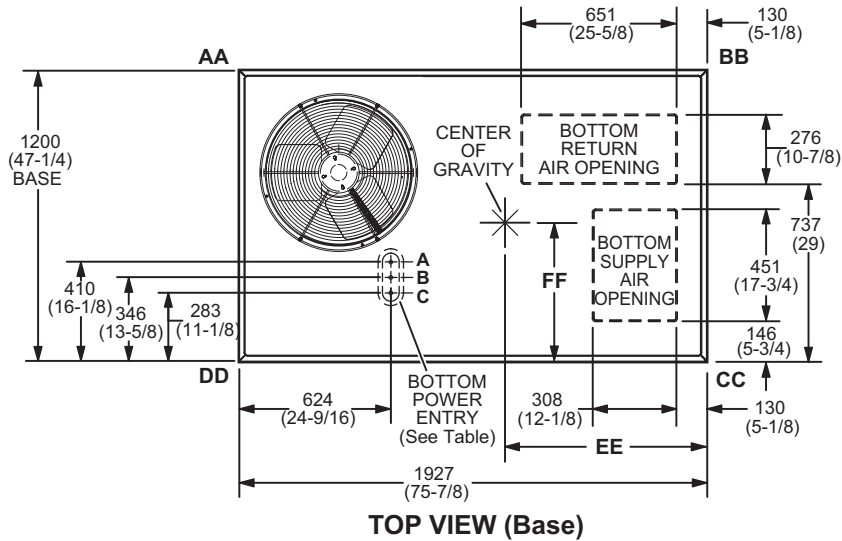


DIMENSIONS - ACCESSORIES

OUTDOOR AIR HOOD DETAIL FOR OPTIONAL ECONOMIZER (Downflow Applications)

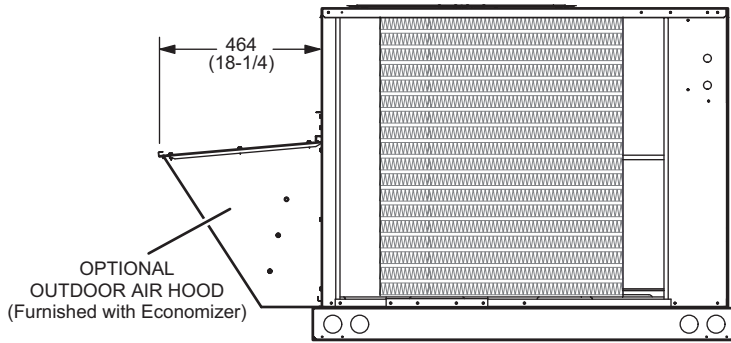


SIDE VIEW

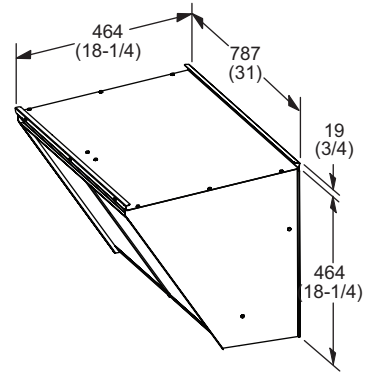


OUTDOOR AIR DAMPER HOOD DETAIL (Downflow or Horizontal Applications)

MANUAL OUTDOOR AIR DAMPER HOOD


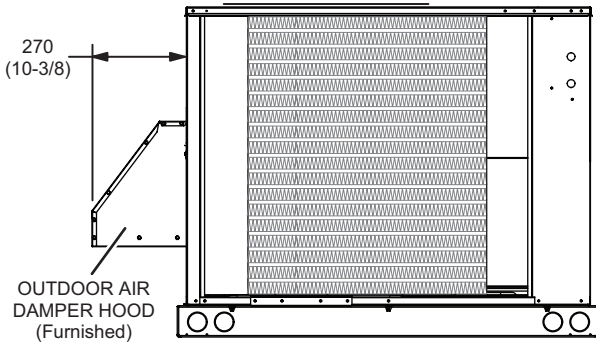


END VIEW

MOTORIZED OUTDOOR AIR DAMPER HOOD

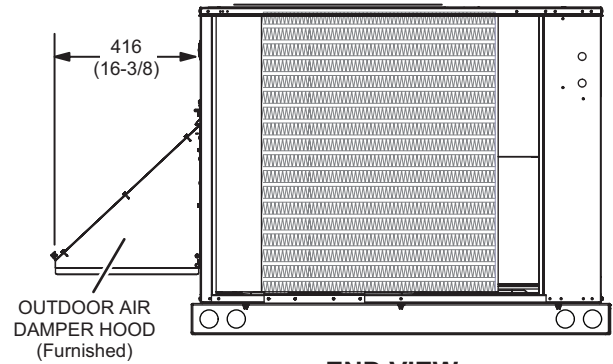


END VIEW

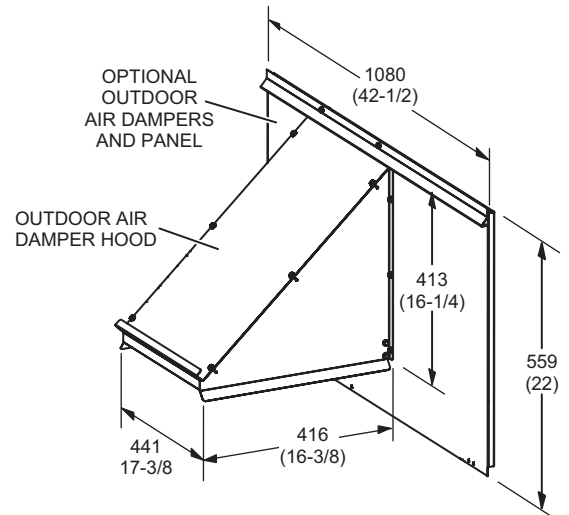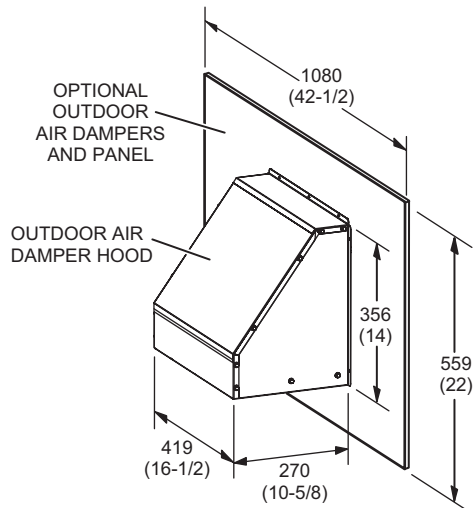

DIMENSIONS - ACCESSORIES


OUTDOOR AIR HOOD DETAIL WITH OPTIONAL ECONOMIZER AND BAROMETRIC RELIEF DAMPERS (Horizontal Applications)

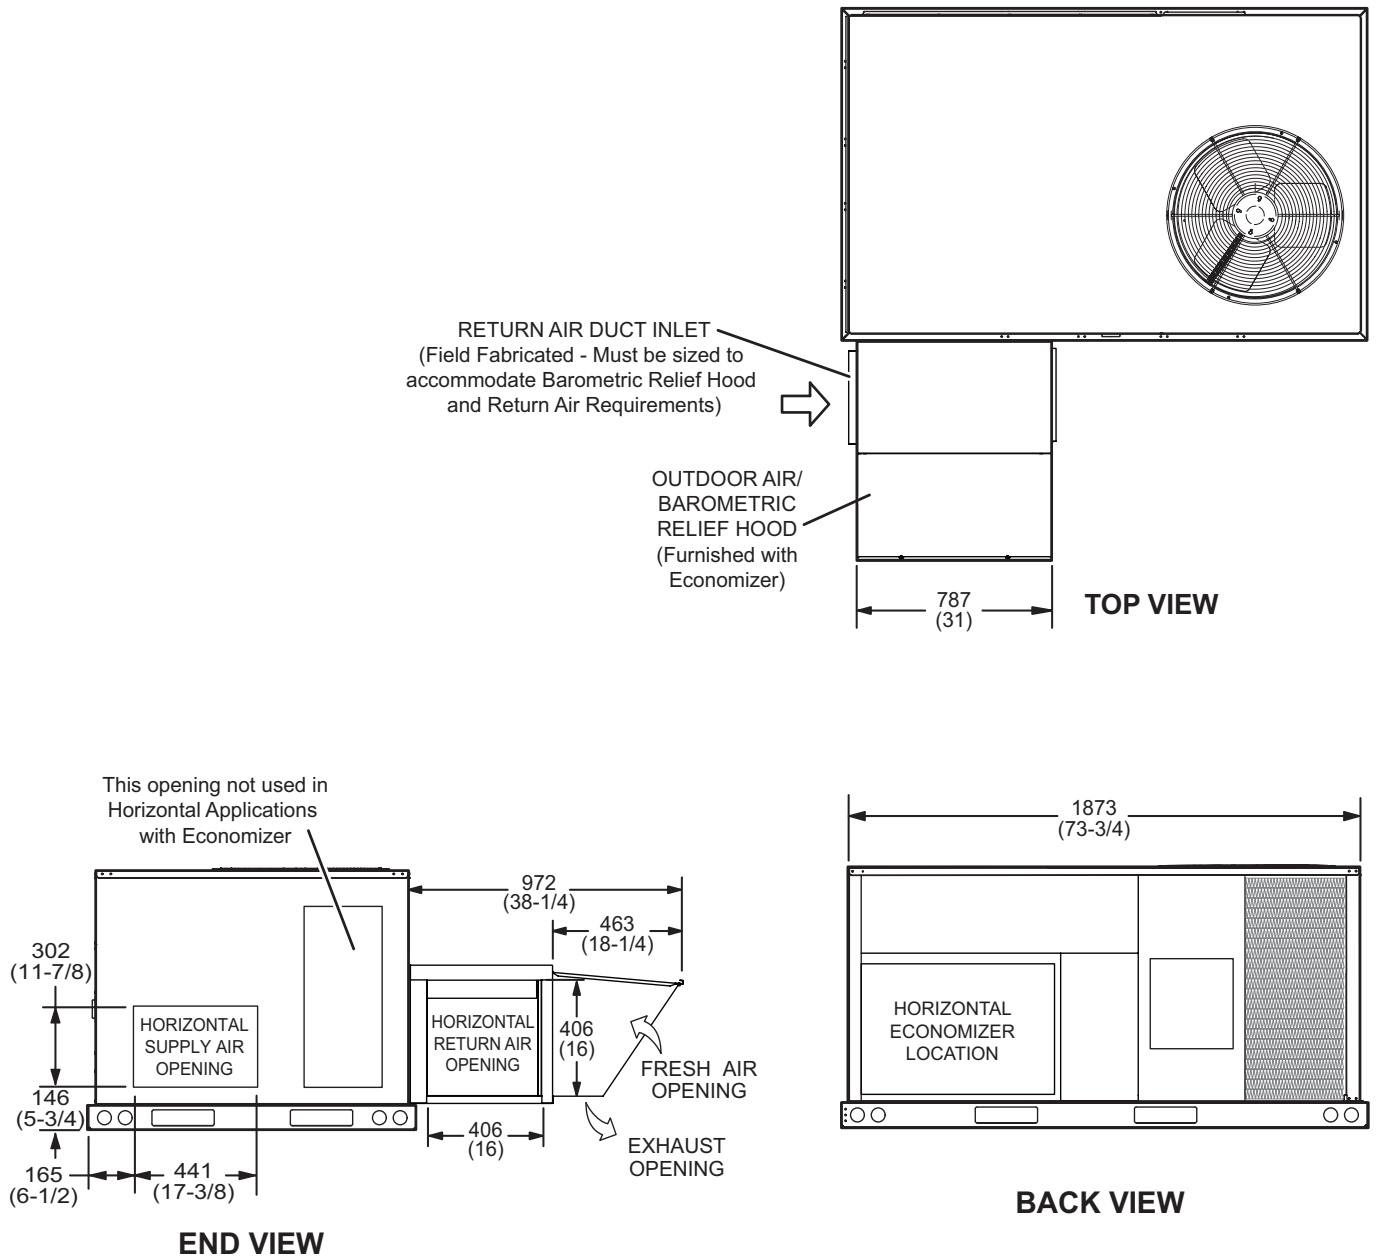

Note - Return Air Duct and Transition must be supported.


DIMENSIONS - ACCESSORIES

HYBRID ROOF CURBS - DOUBLE DUCT OPENING

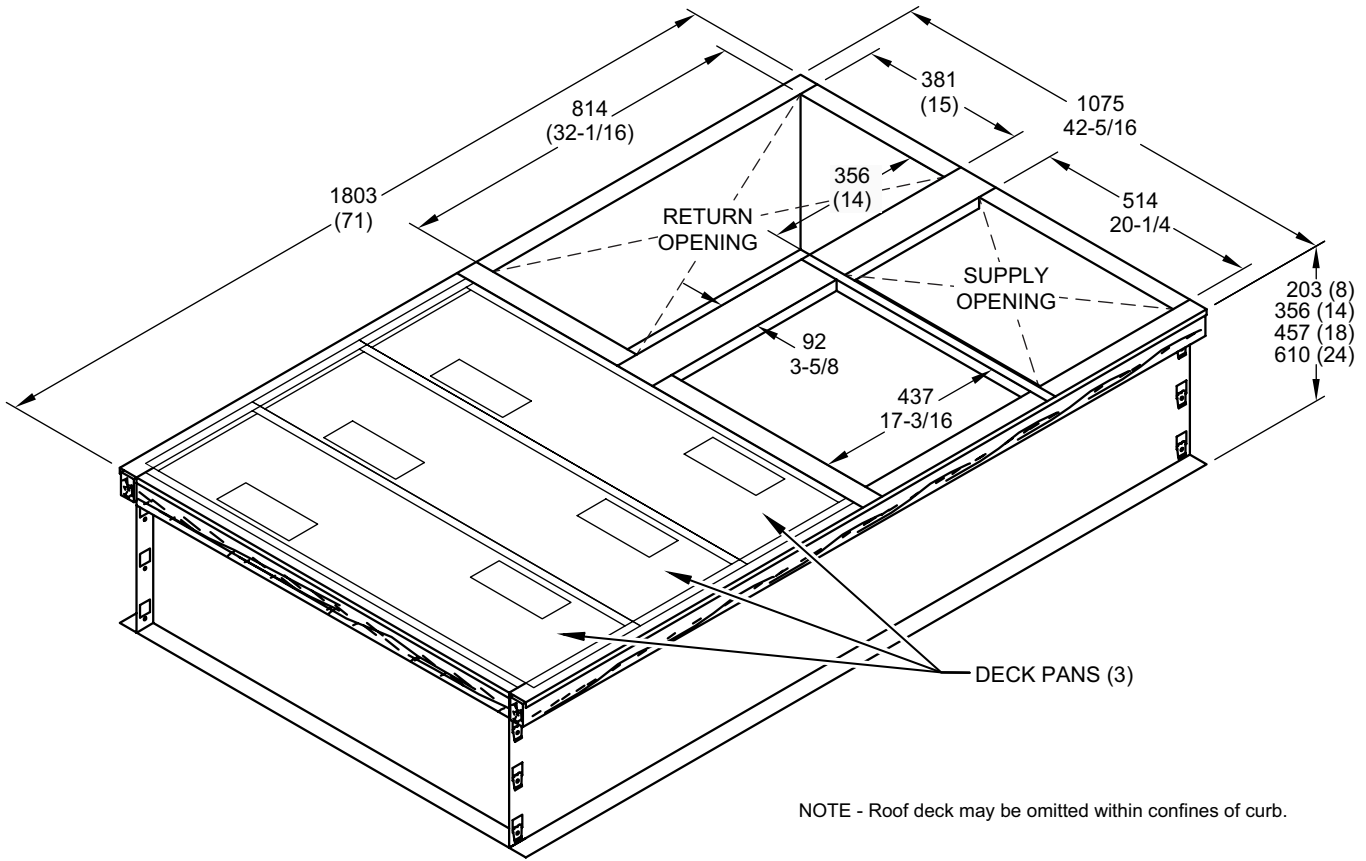


NOTE - Roof deck may be omitted within confines of curb.

TYPICAL FLASHING DETAIL FOR ROOF CURB

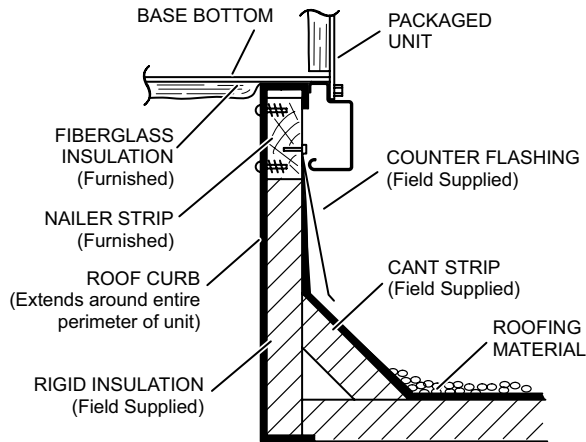


DETAIL ROOF CURB

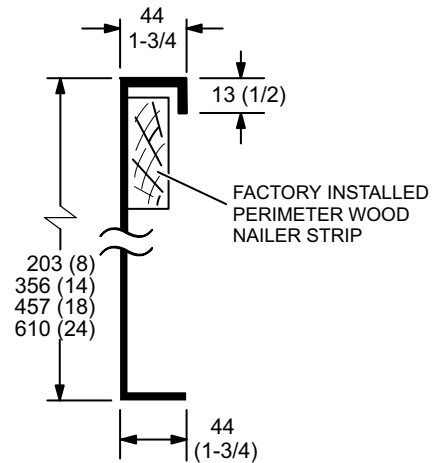


DIMENSIONS - ACCESSORIES

COMBINATION CEILING SUPPLY AND RETURN DIFFUSERS

STEP-DOWN CEILING DIFFUSER

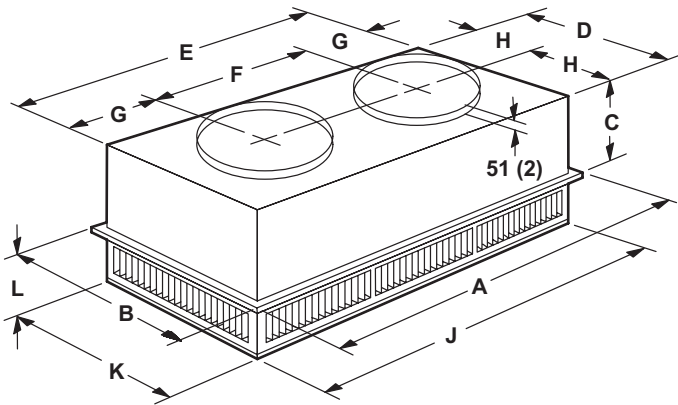

FLUSH CEILING DIFFUSER

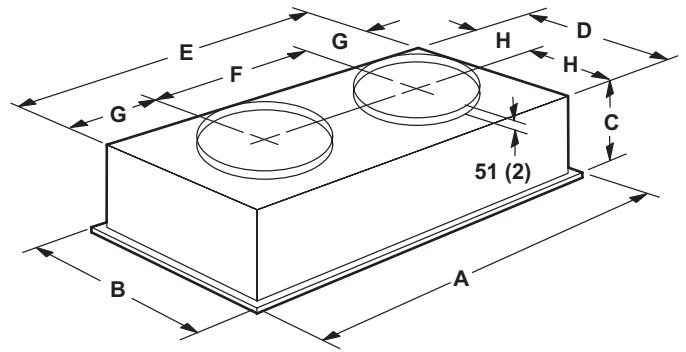

Model Number		RTD9-65S	RTD11-95S
A	mm	1159	1159
	in.	47-5/8	47-5/8
B	mm	600	752
	in.	23-5/8	29-5/8
C	mm	289	365
	in.	11-3/8	14-3/8
D	mm	546	699
	in.	21-1/2	27-1/2
E	mm	1156	1158
	in.	45-1/2	45-1/2
F	mm	572	572
	in.	22-1/2	22-1/2
G	mm	292	292
	in.	11-1/2	11-1/2
H	mm	273	349
	in.	10-3/4	13-3/4
J	mm	1156	1156
	in.	45-1/2	45-1/2
K	mm	546	699
	in.	21-1/2	27-1/2
L	mm	181	206
	in.	7-1/8	8-1/8
Duct Size	mm	457 round	508 round
	in.	18 round	20 round

Model Number		FD9-65S	FD11-95S
A	mm	1159	1159
	in.	47-5/8	47-5/8
B	mm	600	752
	in.	23-5/8	29-5/8
C	mm	343	422
	in.	13-1/2	16-5/8
D	mm	533	686
	in.	21	27
E	mm	1143	1143
	in.	45	45
F	mm	572	572
	in.	22-1/2	22-1/2
G	mm	286	286
	in.	11-1/4	11-1/4
H	mm	267	343
	in.	10-1/2	13-1/2
Duct Size	mm	457 round	20 round
	in.	18 round	508 round

REVISIONS

Section	Description
Optional Conventional Temperature Control Systems	Updated to reflect latest features.



Visit us at www.allied-commercial.com

For the latest technical information, visit us at www.allied-commercial.com

Contact us at 1-800-448-5872

NOTE - Due to Allied Commercial ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

©2019 Allied Air Enterprises LLC, a Lennox International Inc. Company