




Product Data

FA4A FB4A FC4B Direct Expansion Fan Coil

Sizes 018 thru 070

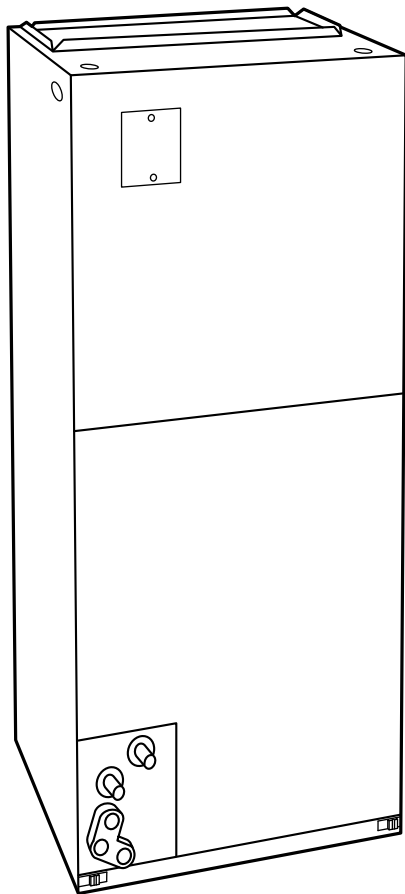

Air Handling Technology At Its Finest

Carrier's FA4A, FB4A, and FC4B direct expansion multipoise fan coils are designed to cover a wide range of air handling requirements. They are compact and ready to fit where needed — in the basement, crawl-space, attic, utility room, or closet.

All units come with solid-state power board controls, 1-in. insulation with an R value of 4.2, super-quiet multispeed motors, and fully wettable coils. Units can accommodate factory- or field-installed heaters from 3 to 30 kw.

The FA4A is the residential new construction (RNC) model in the line-up. It has an embossed galvanized steel casing, 2-speed motor in 018 through 036 sizes and 3-speed motor in 042 through 060 sizes. The FA4A is equipped with an AccuRater[®] metering device.

The FB4A is the standard of Carrier fan coils. It comes in a prepainted galvanized steel casing with foil-faced insulation and has a 3-speed motor in the full range of sizes 018 through 070. All FB4A units are equipped with an AccuRater metering device and are also shipped with a cleanable, permanent framed filter.

The FC4B is the deluxe design in the fan coil group. It incorporates all the features found in the FB4A. In addition, it has a hard shut-off thermostatic expansion valve (TXV) metering device with internal check valve for reverse-flow bypass capability. The FC4B is available in sizes 024 through 070.

Standard features

- Grooved copper tubing
- Lanced sine-wave aluminum fin
- Fully wettable coils
- High-impact thermoplastic condensate pan
- Primary and secondary drain connections with brass inserts
- Multipoise design for maximum versatility
- Field-installed heater packages from 3–30 kw (fused, circuit breaker, non-fused)
- Control board with built-in, replaceable 5-amp blade-type auto fuse
- Cooling controls
- Time-delay relay (TDR)
- High-density, super thick R 4.2 insulation
- Sweat connections
- Inspection plate for cleaning A-coil design
- HUD approved for manufactured housing
- 40-va, 208/230-v transformer
- All models listed with UL, cUL, ARI, and RADCO

Additional features

FA4A

- 018-060 sizes
- Embossed galvanized steel cabinet
- 2-speed motor in 018 through 036 sizes
- 3-speed motor in 042 through 060 sizes
- AccuRater metering device
- Factory-installed heaters available



FB4A

- 018-070 sizes
- Prepainted galvanized steel cabinet
- 3-speed motor on all sizes 018 through 070
- Modular version available in 042 through 070 sizes
- AccuRater® metering device
- Foil-faced, high density insulation
- Factory-supplied, cleanable, permanent framed filter
- Factory-installed heaters available
- Factory-supplied power plug
- Multiple electric entry

FC4B


- 024-070 sizes
- TXV
- Prepainted galvanized steel cabinet
- 3-speed motor on 024 through 070 sizes
- Modular version available in 054 and 070 sizes
- Foil-faced, high-density insulation
- Factory-supplied, cleanable, permanent framed filter
- Factory-supplied power plug
- Multiple electric entry

Model number nomenclature

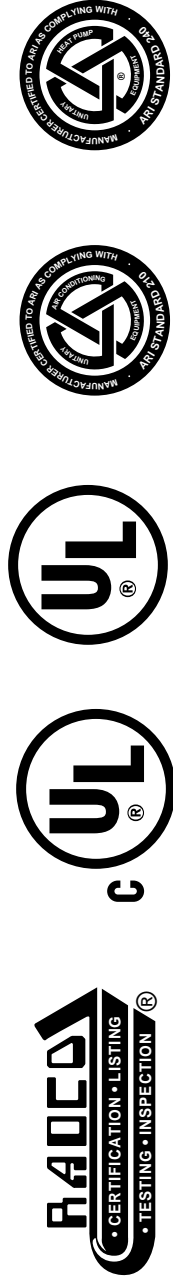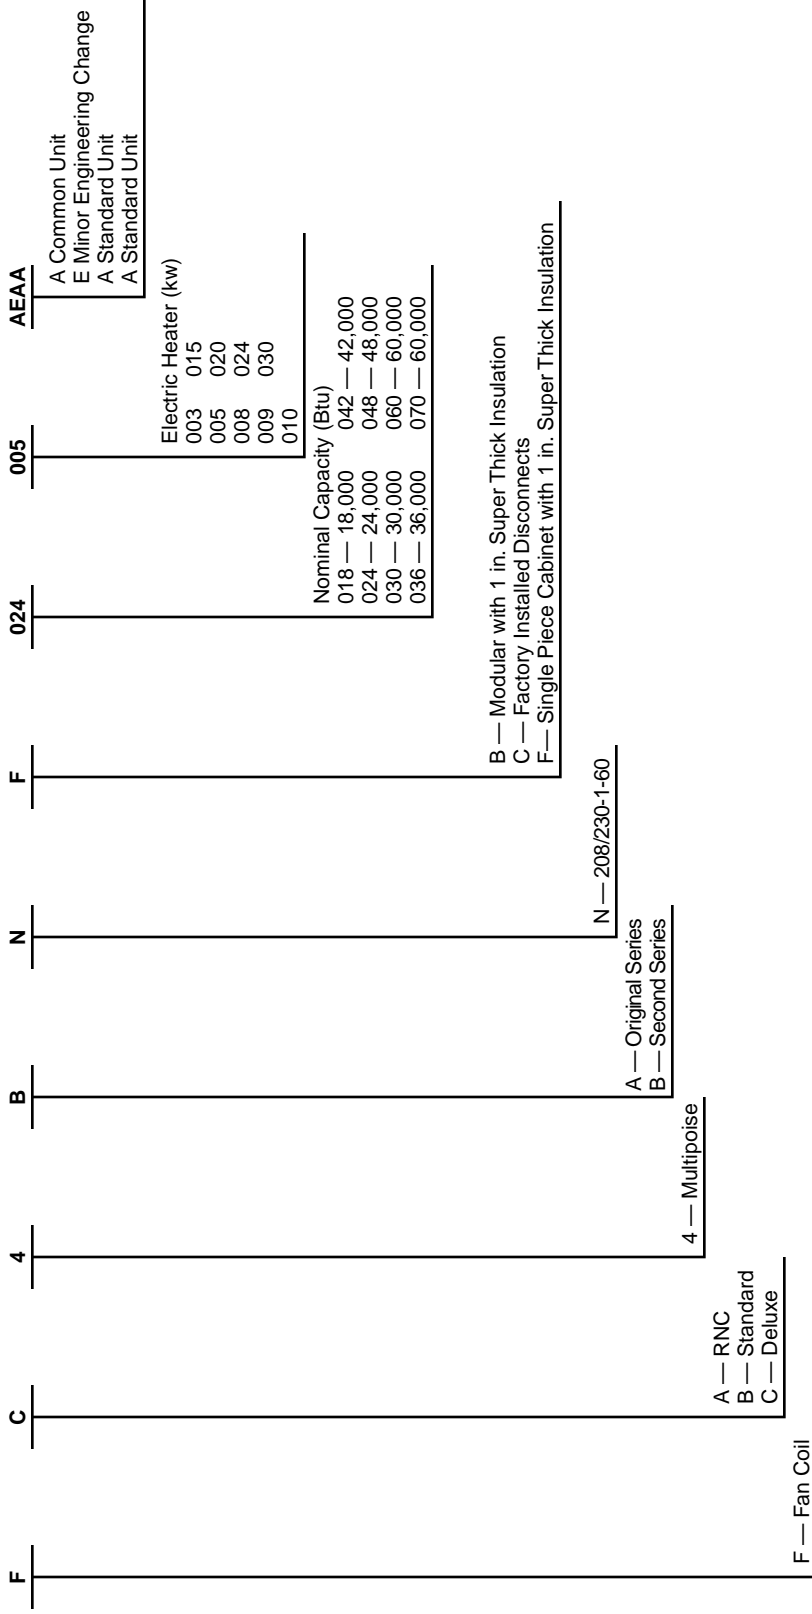

CERTIFICATION APPLIES ONLY WHEN THE COMPLETE SYSTEM IS LISTED WITH ARI.

Dimensions continued

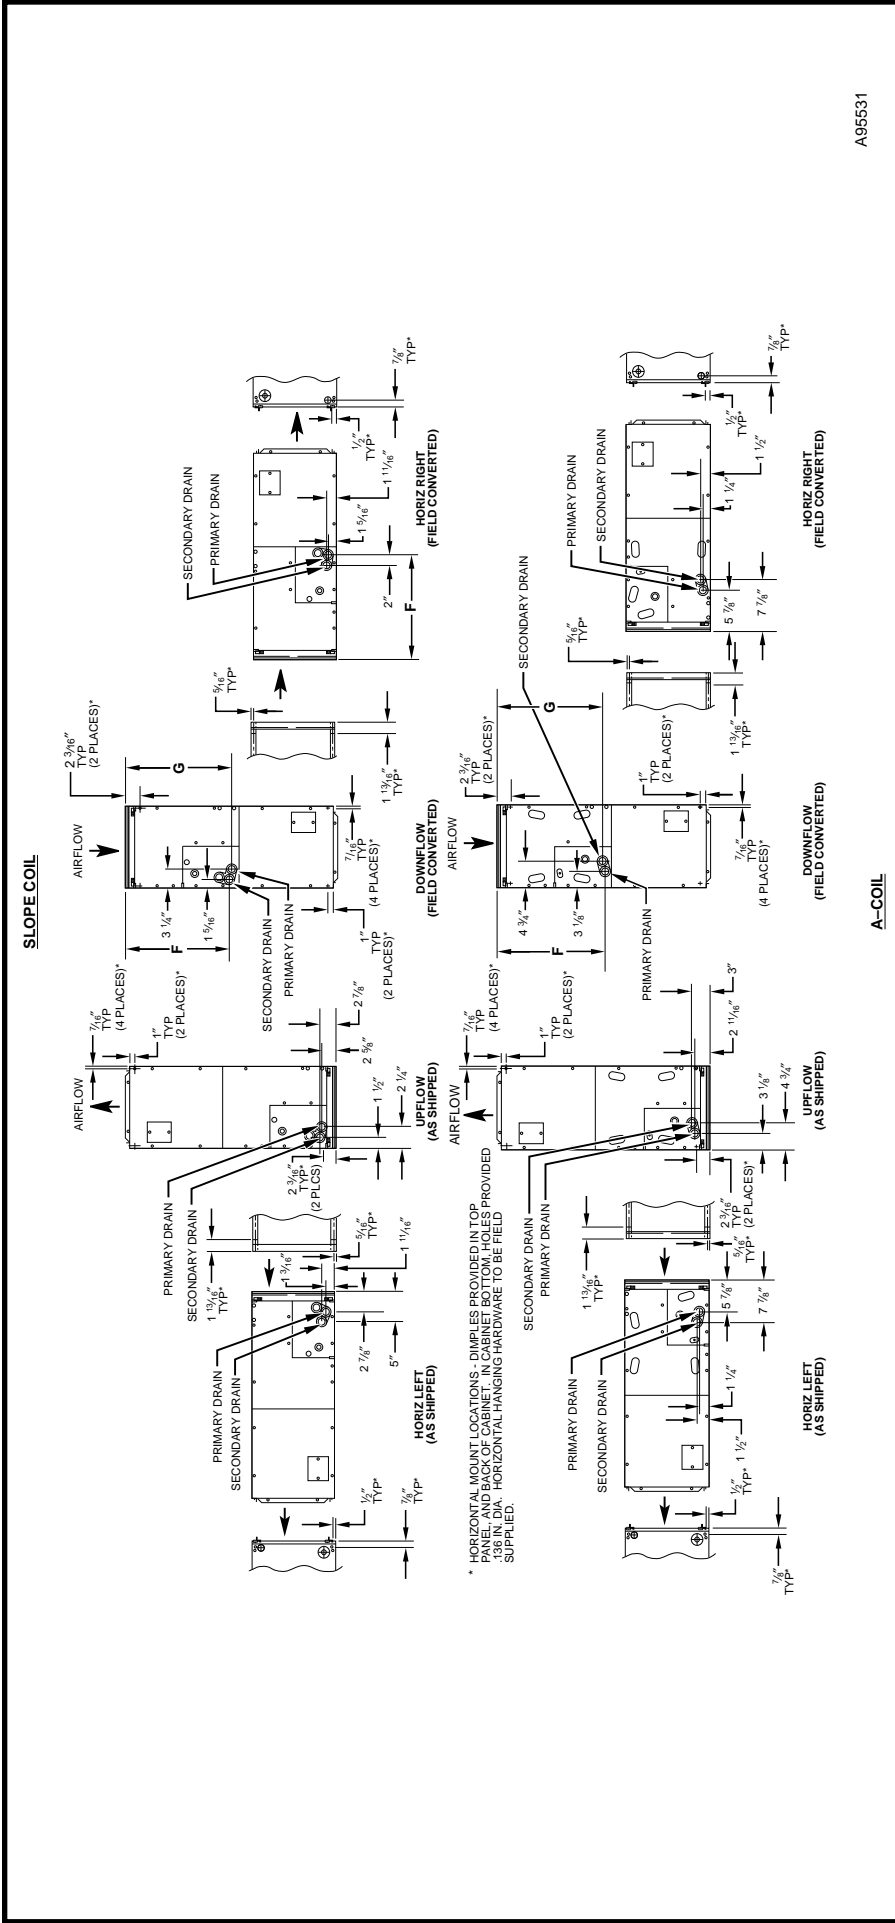

A95531

A-COIL

| UNIT SIZE* | COIL TYPE | F | | G | |
|------------|-----------|----------|-------|----------|-------|
| | | In. | mm | In. | mm |
| 018, 024 | Slope | 18-1/8 | 460.4 | 18-5/8 | 473.1 |
| 030 | Slope | 23-1/8 | 587.4 | 23-5/8 | 600.0 |
| 036 | Slope | 23-1/8 | 587.4 | 23-5/8 | 600.0 |
| 033, 042 | Slope | 26-15/16 | 684.2 | 27-1/2 | 698.5 |
| 048 | A | 23-7/16 | 593.3 | 23-1/8 | 587.4 |
| 038, 060 | A | 27-1/4 | 692.2 | 26-15/16 | 684.2 |
| 054, 070 | A | 32-15/16 | 836.6 | 32-5/8 | 828.7 |

* Descriptions and dimensions apply to all versions (FA4A, FB4A, and FC4B), unless otherwise specified.

Physical data

| | | | | | | | | | | | |
|------------------------------------|--|------------|-----------------|------------|------------|-----------------|------------|------------|------------|------------------|------------|
| MODEL FA4A | 018 | 024 | 030 | 036 | — | 042 | 048 | — | 060 | — | — |
| FB4A | 018 | 024 | 030 | 036 | — | 042 | 048 | — | 060 | — | 070 |
| FC4B* | — | 024 | 030 | 036 | 033 | 042 | 048 | 038 | 060 | 054 | 070 |
| SHIPPING WT (Lb) | 94 | 98 | 126 | 128 | 147 | 147 | 154 | 168 | 168 | 199 | 199 |
| REFRIGERANT METERING DEVICE | Bypass AccuRater (FA4A, FB4A); TXV Factory Installed on FC4B | | | | | | | | | | |
| PISTON SIZE | 52 | 65 | 73 | 80 | — | 84 | 88 | — | 101 | — | 101 |
| TXV SIZE † | — | 2 ton | 2-1/2 ton | 3 ton | 2-1/2 ton | 3 ton | 4 ton | 3 ton | 5 ton | 4 ton | 5 ton |
| COIL | | | | | | | | | | | |
| Rows and Fins Per In. | 2 and 14.5 | 3 and 14.5 | 3 and 14.5 | 3 and 14.5 | 3 and 14.5 | 3 and 14.5 | 3 and 14.5 | 3 and 14.5 | 3 and 14.5 | 3 and 14.5 | 3 and 14.5 |
| Face Area (Sq Ft) | 2.23 | 2.23 | 2.97 | 2.97 | 3.46 | 3.46 | 4.45 | 5.93 | 5.93 | 7.42 | 7.42 |
| Configuration | Slope | Slope | Slope | Slope | Slope | Slope | A | A | A | A | A |
| FAN | | | | | | | | | | | |
| Air Discharge CFM (Nominal) | 650 | 850 | 1100 | 1300 | 1100 | 1500 | 1700 | 1300 | 2000 | 1700 | 2000 |
| Motor Hp (PSC) | 1/5** | 1/4 | 1/3** | 1/3 | 1/3 | 1/2 | 3/4 | 1/3 | 3/4 | 1/2 | 3/4 |
| FILTER‡ | 21-1/2 x 13 | | 21-1/2 x 16-3/8 | | | 21-1/2 x 19-7/8 | | | | 21-1/2 x 23-5/16 | |

* Fan coil units with hard shut-off TXV may require compressor hard start components. Refer to outdoor unit specifications.

† FC4B factory-installed TXV is hard shut-off, bypass flow-type for heat pump application.

‡ Filter must be field supplied for FA4A units. (See Accessory Kits.)

** FA4A018 fan coil has a 1/10 Hp motor

FA4A030 fan coil has a 1/4 Hp motor

NOTE: Descriptions and dimensions apply to all versions (FA4A, FB4A, FC4B, etc.), unless otherwise specified.


Performance data


AIRFLOW PERFORMANCE (CFM)


| MODEL AND SIZE | BLOWER MOTOR SPEED | EXTERNAL STATIC PRESSURE (IN. WC) | | | | | | | | | | | |
|----------------------|--------------------|-----------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | 0.10 | | 0.20 | | 0.30 | | 0.40 | | 0.50 | | 0.60 | |
| | | 208V | 230V | 208V | 230V | 208V | 230V | 208V | 230V | 208V | 230V | 208V | 230V |
| FA4A 018 | High | 660 | 725 | 615 | 675 | 565 | 625 | 500 | 565 | 405 | 470 | — | — |
| | Low | 585 | 650 | 540 | 605 | 490 | 555 | 420 | 485 | 345 | 395 | — | — |
| FB4A 018 | High | 860 | 925 | 815 | 870 | 765 | 820 | 715 | 760 | 645 | 690 | 550 | 600 |
| | Medium | 650 | 740 | 625 | 705 | 585 | 660 | 545 | 620 | 480 | 555 | 385 | 450 |
| | Low | 565 | 650 | 535 | 620 | 500 | 590 | 460 | 545 | 405 | 480 | 330 | 385 |
| FA4A 024 | High | 940 | 975 | 890 | 925 | 835 | 865 | 780 | 805 | 715 | 735 | 635 | 650 |
| | Low | 820 | 900 | 785 | 855 | 745 | 805 | 700 | 750 | 640 | 680 | 545 | 575 |
| FB4A, FC4B 024 | High | 945 | 975 | 900 | 930 | 840 | 870 | 780 | 805 | 695 | 725 | 560 | 595 |
| | Medium | 835 | 900 | 795 | 855 | 745 | 800 | 690 | 740 | 610 | 650 | 470 | 510 |
| | Low | 605 | 695 | 575 | 665 | 530 | 625 | 485 | 580 | 425 | 510 | 340 | 395 |
| FA4A 030 | High | 1075 | 1170 | 1030 | 1115 | 985 | 1055 | 920 | 990 | 850 | 910 | 750 | 805 |
| | Low | 825 | 960 | 810 | 935 | 790 | 890 | 750 | 845 | 690 | 780 | 590 | 680 |
| FB4A, FC4B 030 | High | 1260 | 1305 | 1200 | 1245 | 1135 | 1170 | 1065 | 1110 | 985 | 1015 | 880 | 900 |
| | Medium | 1055 | 1170 | 1020 | 1115 | 980 | 1055 | 930 | 1000 | 960 | 920 | 755 | 810 |
| | Low | 830 | 950 | 805 | 925 | 780 | 890 | 740 | 850 | 685 | 790 | 595 | 700 |
| FA4A 036 | High | 1320 | 1405 | 1265 | 1345 | 1205 | 1280 | 1135 | 1210 | 1060 | 1120 | 960 | 1025 |
| | Low | 1100 | 1215 | 1070 | 1170 | 1020 | 1115 | 960 | 1060 | 890 | 980 | 805 | 895 |
| FB4A, FC4B 036 | High | 1485 | 1550 | 1425 | 1490 | 1365 | 1420 | 1300 | 1350 | 1230 | 1275 | 1150 | 1190 |
| | Medium | 1235 | 1380 | 1200 | 1325 | 1160 | 1265 | 1110 | 1210 | 1055 | 1140 | 985 | 1070 |
| | Low | 1035 | 1185 | 1010 | 1150 | 980 | 1115 | 940 | 1070 | 890 | 1010 | 825 | 935 |
| FA4A, FB4A, FC4B 042 | High | 1580 | 1710 | 1540 | 1655 | 1495 | 1595 | 1440 | 1530 | 1375 | 1445 | 1290 | 1355 |
| | Medium | 1400 | 1570 | 1375 | 1525 | 1350 | 1480 | 1305 | 1425 | 1255 | 1360 | 1175 | 1280 |
| | Low | 1195 | 1375 | 1180 | 1350 | 1165 | 1325 | 1135 | 1285 | 1085 | 1240 | 1020 | 1160 |
| FA4A, FB4A, FC4B 048 | High | 1880 | 1935 | 1785 | 1830 | 1700 | 1735 | 1615 | 1645 | 1520 | 1555 | 1430 | 1460 |
| | Medium | 1740 | 1840 | 1660 | 1750 | 1585 | 1660 | 1510 | 1575 | 1435 | 1485 | 1350 | 1390 |
| | Low | 1425 | 1605 | 1395 | 1555 | 1360 | 1495 | 1315 | 1430 | 1255 | 1360 | 1170 | 1270 |
| FA4A, FB4A, FC4B 060 | High | 2145 | 2245 | 2085 | 2185 | 2030 | 2115 | 1965 | 2045 | 1905 | 1975 | 1830 | 1895 |
| | Medium | 2025 | 2175 | 1970 | 2110 | 1915 | 2050 | 1860 | 1980 | 1805 | 1905 | 1740 | 1830 |
| | Low | 1680 | 1895 | 1655 | 1855 | 1625 | 1810 | 1595 | 1765 | 1555 | 1705 | 1500 | 1645 |
| FB4A, FC4B 070 | High | 2205 | 2285 | 2130 | 2205 | 2050 | 2120 | 1960 | 2025 | 1875 | 1930 | 1790 | 1825 |
| | Medium | 1880 | 2075 | 1845 | 2015 | 1795 | 1945 | 1745 | 1870 | 1675 | 1790 | 1595 | 1700 |
| | Low | 1570 | 1825 | 1560 | 1795 | 1545 | 1745 | 1520 | 1700 | 1480 | 1640 | 1420 | 1565 |
| FC4B 033 | High | 1315 | 1385 | 1255 | 1315 | 1185 | 1240 | 1115 | 1165 | 1035 | 1080 | 950 | 995 |
| | Medium | 1045 | 1170 | 1010 | 1130 | 970 | 1080 | 925 | 1020 | 870 | 960 | 790 | 870 |
| | Low | 775 | 900 | 765 | 880 | 740 | 855 | 710 | 825 | 655 | 780 | 570 | 715 |
| FC4B 038 | High | 1570 | 1700 | 1525 | 1645 | 1475 | 1580 | 1420 | 1515 | 1355 | 1440 | 1285 | 1360 |
| | Medium | 1215 | 1420 | 1180 | 1380 | 1150 | 1340 | 1110 | 1290 | 1060 | 1240 | 1000 | 1170 |
| | Low | 1020 | 1200 | 995 | 1185 | 960 | 1130 | 925 | 1090 | 880 | 1040 | 835 | 980 |
| FC4B 054 | High | 1700 | 1835 | 1640 | 1760 | 1570 | 1685 | 1500 | 1605 | 1420 | 1520 | 1330 | 1430 |
| | Medium | 1505 | 1660 | 1455 | 1600 | 1395 | 1540 | 1330 | 1470 | 1260 | 1395 | 1175 | 1310 |
| | Low | 1300 | 1460 | 1260 | 1410 | 1205 | 1350 | 1145 | 1290 | 1080 | 1220 | 1000 | 1140 |

NOTES: 1. Airflow based upon dry coil at 230v with factory approved filter and electric heater (2 element heater, sizes 018 through 036; 3 element heater, sizes 042 through 060).

2. Not recommended for use above 0.60 in. external static pressure.

 Airflows in this region have the **potential** for condensate to blow out of the drainpan. If usage in this region is desired, consult duct static pressure graph for allowable return and supply duct static pressures.

 Airflows in this region are outside recommended airflow for all applications. Usage at these airflows could result in condensate blowing out of the drainpan.

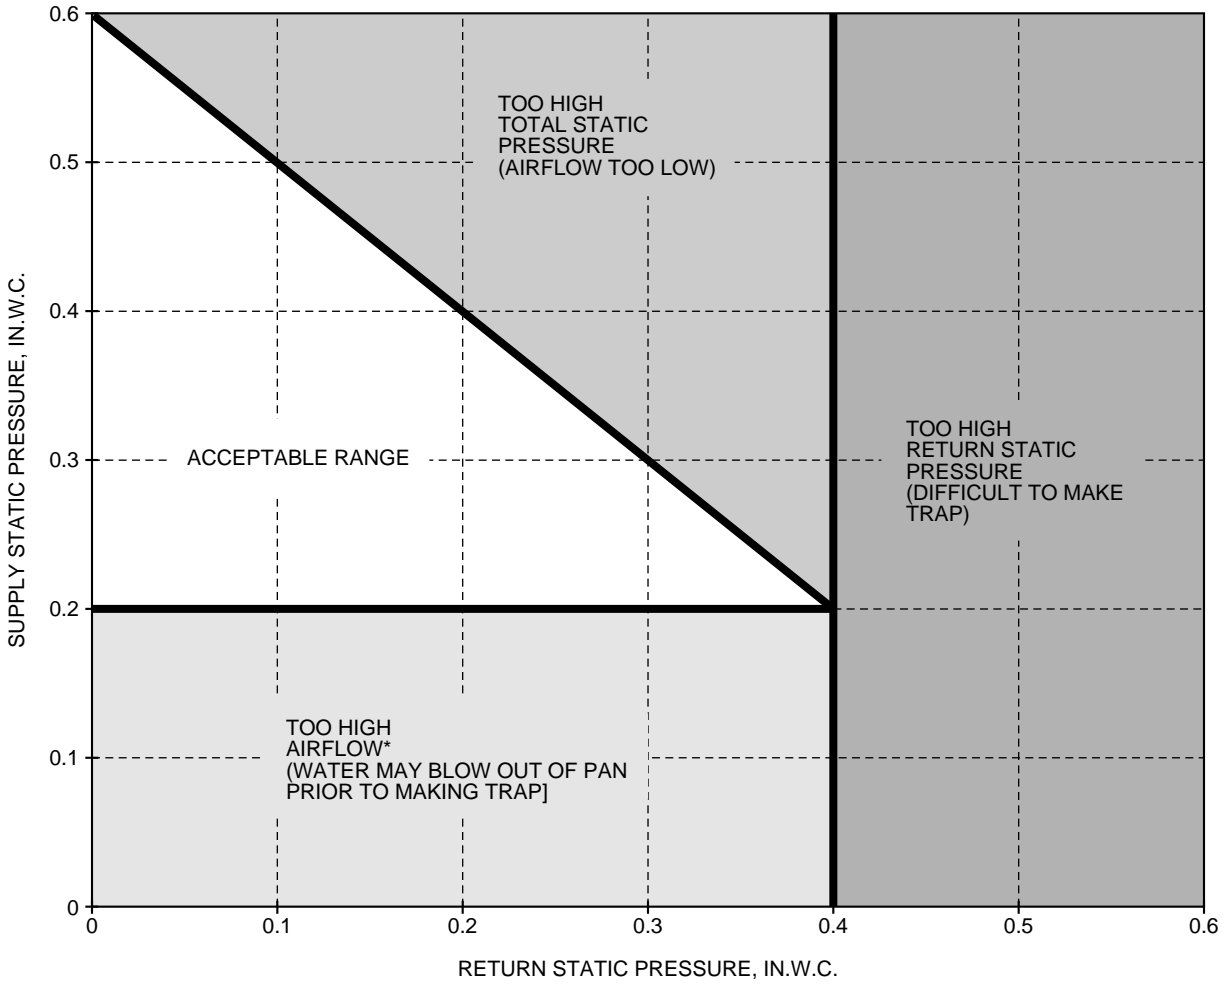

A96027

ACCEPTABLE DUCT CONDITIONS

For satisfactory operation (specifically making dry secondary trap), subject fan coils must be installed with duct systems which fall within the “Acceptable Range” illustrated above.

* Operation in this “Too High Airflow” range (below .2 supply static) applies only to *horizontal* applications of the following:

| | |
|------------|-------------------------------|
| 048 | medium and high blower speeds |
| 060 | medium and high blower speeds |
| 070 | high blower speeds |

All other applications (the above units on low speed, FK units, 018 thru 042 units, all units in vertical applications, etc.) are acceptable to use below the .2 supply static boundary.

Performance data continued

FILTER STATIC PRESSURE DROP (IN. WC.)

| UNIT SIZE | CFM | | | | | | | | |
|---------------|------|-------|-------|-------|-------|-------|-------|-------|-------|
| | 400 | 600 | 800 | 1000 | 1200 | 1400 | 1600 | 1800 | 2000 |
| 018 | 0.02 | 0.044 | 0.075 | — | — | — | — | — | — |
| 024 | — | 0.044 | 0.075 | 0.110 | — | — | — | — | — |
| 030 | — | — | 0.048 | 0.072 | 0.100 | — | — | — | — |
| 036 | — | — | — | 0.072 | 0.100 | 0.130 | — | — | — |
| 033, 038, 042 | — | — | — | — | 0.070 | 0.092 | 0.120 | — | — |
| 048 | — | — | — | — | — | 0.092 | 0.120 | 0.152 | — |
| 060 | — | — | — | — | — | — | 0.120 | 0.152 | 0.187 |
| 054, 070 | — | — | — | — | — | — | 0.086 | 0.105 | 0.130 |

ELECTRIC HEATER STATIC PRESSURE DROP (IN. WC.)

018–036

| HEATER ELEMENTS | KW | EXTERNAL STATIC PRESSURE CORRECTION |
|-----------------|------|-------------------------------------|
| 0 | 0 | +0.02 |
| 1 | 3,5 | +0.01 |
| 2 | 8,10 | 0 |
| 3 | 9,15 | -0.02 |
| 4 | 20 | -0.04 |

042–070

| HEATER ELEMENTS | KW | EXTERNAL STATIC PRESSURE CORRECTION |
|-----------------|----------|-------------------------------------|
| 0 | 0 | +0.04 |
| 2 | 8,10 | +0.02 |
| 3 | 9,15 | 0 |
| 4 | 20 | -0.02 |
| 6 | 18,24,30 | -0.10 |

The airflow performance data was developed using fan coils with 10-kw electric heaters (2 elements) in the 018 through 036 size units and 15-kw heaters (3 elements) in the 042 through 070 size units. For fan coils with heaters of a different number of elements, the external available static at a given CFM from the curve may be corrected by adding or subtracting available external static pressure as indicated above.

AIR DELIVERY PERFORMANCE CORRECTION COMPONENT PRESSURE DROP (IN. WC) AT INDICATED AIRFLOW (DRY-TO-WET COIL)

| UNIT SIZE | CFM | | | | | | | | | |
|-----------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| | 500 | 600 | 700 | 800 | 900 | 1000 | 1100 | 1200 | 1300 | 1350 |
| 018 | 0.023 | 0.034 | 0.044 | — | — | — | — | — | — | — |
| 024 | 0.035 | 0.051 | 0.066 | 0.080 | 0.091 | — | — | — | — | — |
| 030 | — | — | — | 0.051 | 0.063 | 0.073 | 0.081 | — | — | — |
| 036 | — | — | — | — | — | 0.073 | 0.081 | 0.091 | 0.098 | 0.102 |

| UNIT SIZE | CFM | | | | | | | | |
|-----------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| | 1200 | 1300 | 1400 | 1500 | 1600 | 1700 | 1800 | 1900 | 2000 |
| 033, 042 | 0.075 | 0.083 | 0.091 | 0.098 | — | — | — | — | — |
| 048 | — | — | 0.066 | 0.073 | 0.080 | 0.086 | 0.091 | — | — |
| 038, 060 | — | — | — | — | 0.051 | 0.057 | 0.063 | 0.069 | 0.073 |
| 054, 070 | — | — | — | — | 0.030 | 0.034 | 0.039 | 0.044 | 0.053 |

NOTE: Subtract the above pressure drop corrections from unit airflow data when that component or condition is used. The remaining external static pressure will be available for the duct system.

Performance data continued

GROSS COOLING CAPACITIES (MBtuh)

| UNIT | EVAPORATOR AIR CFM AND BF | COIL REFRIGERANT TEMPERATURE (°F)* | | | | | | | | | | | | | | |
|---------------------------------|---------------------------|--|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| | | 35 | | | 40 | | | 45 | | | 50 | | | 55 | | |
| | | Evaporator Air — Entering Wet-Bulb Temp (°F) | | | | | | | | | | | | | | |
| | | 72 | 67 | 62 | 72 | 67 | 62 | 72 | 67 | 62 | 72 | 67 | 62 | 72 | 67 | 62 |
| FA4A, FB4A 018 | 400 | 28 | 23 | 19 | 25 | 21 | 16 | 22 | 17 | 13 | 19 | 14 | 11 | 15 | 10 | 9 |
| | 0.08 | 13 | 14 | 15 | 12 | 13 | 14 | 11 | 12 | 12 | 10 | 10 | 11 | 8 | 9 | 9 |
| | 500 | 31 | 26 | 21 | 28 | 23 | 18 | 25 | 20 | 15 | 21 | 16 | 13 | 17 | 12 | 11 |
| | 0.10 | 15 | 16 | 18 | 14 | 15 | 16 | 12 | 14 | 15 | 11 | 12 | 13 | 9 | 10 | 10 |
| | 600 | 33 | 28 | 23 | 31 | 25 | 20 | 27 | 22 | 17 | 23 | 17 | 14 | 19 | 13 | 12 |
| | 0.13 | 16 | 18 | 20 | 15 | 17 | 18 | 13 | 15 | 16 | 12 | 14 | 14 | 10 | 12 | 12 |
| FA4A, FB4A, FC4B 024 | 600 | 39 | 33 | 27 | 36 | 29 | 23 | 31 | 24 | 18 | 27 | 19 | 15 | 21 | 14 | 12 |
| | 0.05 | 19 | 20 | 22 | 17 | 19 | 20 | 15 | 16 | 17 | 13 | 14 | 15 | 11 | 12 | 12 |
| | 700 | 42 | 35 | 29 | 38 | 31 | 25 | 34 | 27 | 20 | 29 | 21 | 17 | 23 | 16 | 14 |
| | 0.06 | 20 | 22 | 24 | 18 | 20 | 22 | 17 | 18 | 20 | 15 | 16 | 17 | 13 | 14 | 14 |
| | 875 | 47 | 39 | 32 | 42 | 35 | 28 | 38 | 30 | 23 | 32 | 24 | 20 | 26 | 18 | 17 |
| | 0.08 | 22 | 25 | 28 | 21 | 23 | 26 | 19 | 21 | 23 | 17 | 19 | 20 | 15 | 16 | 17 |
| FA4A, FB4A, FC4B 030 | 750 | 48 | 40 | 32 | 44 | 35 | 28 | 38 | 30 | 23 | 32 | 24 | 18 | 26 | 17 | 15 |
| | 0.04 | 23 | 25 | 26 | 21 | 22 | 24 | 19 | 20 | 21 | 16 | 18 | 18 | 14 | 15 | 15 |
| | 900 | 53 | 44 | 36 | 48 | 39 | 31 | 42 | 33 | 25 | 36 | 27 | 21 | 28 | 19 | 17 |
| | 0.06 | 25 | 28 | 30 | 23 | 25 | 27 | 21 | 23 | 24 | 18 | 20 | 21 | 16 | 17 | 17 |
| | 1075 | 58 | 48 | 39 | 52 | 42 | 34 | 46 | 36 | 28 | 39 | 29 | 24 | 31 | 21 | 20 |
| | 0.07 | 27 | 31 | 33 | 25 | 28 | 31 | 23 | 25 | 27 | 20 | 22 | 24 | 17 | 19 | 20 |
| FA4A, FB4A, FC4B 036 | 800 | 53 | 43 | 35 | 48 | 38 | 29 | 41 | 31 | 23 | 34 | 25 | 18 | 27 | 18 | 15 |
| | 0.05 | 25 | 27 | 28 | 23 | 24 | 25 | 20 | 21 | 22 | 17 | 19 | 18 | 15 | 16 | 15 |
| | 900 | 58 | 47 | 38 | 52 | 41 | 32 | 45 | 34 | 26 | 37 | 27 | 20 | 29 | 19 | 16 |
| | 0.06 | 27 | 30 | 31 | 25 | 27 | 28 | 22 | 24 | 25 | 19 | 21 | 20 | 16 | 17 | 16 |
| | 1100 | 65 | 54 | 43 | 58 | 47 | 36 | 51 | 39 | 29 | 43 | 31 | 24 | 33 | 22 | 20 |
| | 0.07 | 31 | 34 | 36 | 28 | 31 | 33 | 25 | 28 | 29 | 22 | 24 | 24 | 19 | 20 | 19 |
| FA4A, FB4A, FC4B 033, 042 | 1300 | 71 | 59 | 48 | 64 | 51 | 41 | 56 | 43 | 33 | 47 | 35 | 27 | 37 | 25 | 22 |
| | 0.09 | 34 | 38 | 41 | 31 | 35 | 37 | 28 | 31 | 32 | 25 | 28 | 27 | 21 | 23 | 22 |
| | 1000 | 69 | 57 | 46 | 62 | 50 | 39 | 54 | 42 | 31 | 45 | 33 | 25 | 35 | 23 | 20 |
| | 0.05 | 33 | 35 | 37 | 30 | 32 | 33 | 26 | 28 | 29 | 23 | 24 | 25 | 19 | 20 | 20 |
| | 1200 | 77 | 63 | 51 | 69 | 55 | 44 | 61 | 47 | 35 | 51 | 37 | 29 | 39 | 26 | 24 |
| | 0.07 | 36 | 39 | 42 | 33 | 36 | 38 | 29 | 32 | 34 | 26 | 28 | 29 | 22 | 23 | 24 |
| FA4A, FB4A, FC4B 048 | 1350 | 82 | 68 | 55 | 74 | 59 | 46 | 65 | 50 | 38 | 54 | 39 | 31 | 42 | 28 | 26 |
| | 0.08 | 39 | 43 | 46 | 35 | 39 | 41 | 32 | 35 | 37 | 28 | 30 | 31 | 23 | 26 | 26 |
| | 1530 | 87 | 72 | 59 | 79 | 64 | 50 | 69 | 53 | 41 | 58 | 42 | 34 | 46 | 30 | 28 |
| | 0.09 | 41 | 46 | 50 | 38 | 42 | 45 | 34 | 38 | 40 | 30 | 33 | 34 | 26 | 28 | 28 |
| | 1200 | 83 | 69 | 56 | 75 | 61 | 48 | 66 | 52 | 39 | 56 | 41 | 32 | 45 | 30 | 26 |
| | 0.05 | 39 | 43 | 46 | 36 | 39 | 42 | 32 | 35 | 37 | 28 | 31 | 32 | 24 | 26 | 26 |
| FA4A, FB4A, FC4B 048 | 1400 | 90 | 75 | 61 | 82 | 66 | 53 | 72 | 57 | 43 | 61 | 45 | 36 | 49 | 33 | 30 |
| | 0.06 | 42 | 47 | 51 | 39 | 43 | 47 | 35 | 39 | 42 | 31 | 34 | 36 | 27 | 29 | 30 |
| | 1600 | 95 | 79 | 65 | 87 | 71 | 56 | 77 | 60 | 47 | 66 | 48 | 40 | 52 | 36 | 33 |
| | 0.07 | 45 | 51 | 55 | 42 | 47 | 51 | 38 | 42 | 46 | 34 | 38 | 40 | 29 | 32 | 33 |
| | 1750 | 99 | 83 | 68 | 90 | 74 | 59 | 80 | 63 | 50 | 69 | 51 | 42 | 55 | 37 | 35 |
| | 0.08 | 47 | 53 | 59 | 44 | 49 | 54 | 40 | 45 | 49 | 36 | 40 | 42 | 31 | 34 | 35 |

See notes on pg. 10.

GROSS COOLING CAPACITIES (MBtuh) continued

| UNIT | EVAPORATOR AIR CFM AND BF | COIL REFRIGERANT TEMPERATURE (°F)* | | | | | | | | | | | | | | |
|---------------------------------------|---------------------------|--|----|----|-----|----|----|----|----|----|----|----|----|----|----|----|
| | | 35 | | | 40 | | | 45 | | | 50 | | | 55 | | |
| | | Evaporator Air — Entering Wet-Bulb Temp (°F) | | | | | | | | | | | | | | |
| | | 72 | 67 | 62 | 72 | 67 | 62 | 72 | 67 | 62 | 72 | 67 | 62 | 72 | 67 | 62 |
| FA4A, FB4A 060 FC4B 038, 060 | 1300 | 91 | 74 | 60 | 81 | 65 | 51 | 72 | 55 | 41 | 60 | 44 | 31 | 48 | 31 | 26 |
| | 0.03 | 43 | 46 | 48 | 39 | 41 | 43 | 35 | 37 | 38 | 30 | 32 | 31 | 25 | 27 | 26 |
| | 1600 | 104 | 85 | 69 | 94 | 76 | 59 | 83 | 64 | 47 | 70 | 51 | 38 | 55 | 37 | 31 |
| | 0.05 | 49 | 53 | 57 | 45 | 49 | 51 | 40 | 44 | 45 | 35 | 38 | 38 | 30 | 32 | 31 |
| | 1750 | 109 | 91 | 73 | 99 | 80 | 63 | 87 | 68 | 51 | 74 | 54 | 41 | 58 | 39 | 33 |
| | 0.05 | 52 | 57 | 61 | 47 | 52 | 55 | 43 | 47 | 49 | 38 | 41 | 41 | 32 | 35 | 33 |
| 2000 | | 117 | 97 | 80 | 106 | 86 | 68 | 94 | 74 | 56 | 80 | 59 | 45 | 64 | 43 | 38 |
| | 0.06 | 56 | 62 | 67 | 51 | 57 | 61 | 46 | 51 | 54 | 41 | 45 | 45 | 35 | 39 | 38 |
| FB4A 070 FC4B 054, 070 | 1300 | 93 | 77 | 63 | 84 | 69 | 52 | 75 | 58 | 43 | 64 | 46 | 33 | 50 | 32 | 27 |
| | 0.02 | 44 | 47 | 50 | 40 | 43 | 45 | 36 | 38 | 39 | 31 | 33 | 33 | 26 | 27 | 27 |
| | 1600 | 104 | 87 | 72 | 95 | 78 | 61 | 85 | 67 | 50 | 73 | 53 | 40 | 58 | 38 | 34 |
| | 0.03 | 50 | 54 | 58 | 46 | 50 | 53 | 41 | 45 | 47 | 36 | 39 | 40 | 31 | 33 | 33 |
| | 1750 | 109 | 91 | 75 | 100 | 82 | 65 | 89 | 70 | 53 | 76 | 57 | 44 | 61 | 41 | 36 |
| | 48 | 52 | 57 | 62 | 48 | 53 | 57 | 43 | 48 | 51 | 39 | 42 | 43 | 33 | 36 | 36 |
| 2000 | | 116 | 98 | 81 | 106 | 87 | 70 | 95 | 75 | 58 | 82 | 61 | 49 | 67 | 45 | 40 |
| | 0.05 | 55 | 62 | 68 | 51 | 57 | 62 | 47 | 52 | 56 | 42 | 46 | 49 | 36 | 40 | 40 |

* Saturated suction leaving evaporator coil.

SHC — Sensible Heat Capacity (1000 Btuh)

BF — Bypass Factor

NOTES:

1. Contact manufacturer for cooling capacities at conditions other than shown in table.

2. Formulas:

$$\text{Leaving db} = \text{entering db} - \frac{\text{sensible heat cap.}}{1.09 \times \text{CFM}}$$

Leaving wb = wb corresponding to enthalpy of air leaving coil (h_{lwb})

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{CFM}}$$

where h_{ewb} = enthalpy of air entering coil.

3. Direct interpolation is permissible. Do not extrapolate.

4. SHC is based on 80°F db temperature of air entering coil. Below 80°F subtract (corr factor x CFM) from SHC.

Above 80°F db, add (corr factor x CFM) to SHC.

SHC CORRECTION FACTOR

| BYPASS FACTOR | ENTERING AIR DRY-BULB TEMPERATURE (°F) | | | | | |
|---------------|--|------|------|------|------|-------------------------|
| | 79 | 78 | 77 | 76 | 75 | Under 75 |
| | 81 | 82 | 83 | 84 | 84 | Over 85 |
| | Correction Factor | | | | | |
| 0.10 | 0.98 | 1.96 | 2.94 | 3.92 | 4.91 | Use formula shown below |
| 0.20 | 0.87 | 1.74 | 2.62 | 3.49 | 4.36 | |
| 0.30 | 0.76 | 1.53 | 2.29 | 3.05 | 3.82 | |

Interpolation is permissible.

$$\text{Correction Factor} = 1.09 \times (1 - \text{BF}) \times (\text{db} - 80)$$

Carrier accessories

| ITEM | ACCESSORY PART NO.* | FAN COIL SIZE USED WITH |
|--------------------------|---------------------|---|
| Disconnect Kit | KFADK0101DSC | Cooling controls and heaters 3 kw through 10 kw |
| Downflow Base Kit | KFACB0101CFB | 018, 024 |
| | KFACB0201CFB | 030, 036 |
| | KFACB0301CFB | 033, 038, 042, 048, 060 |
| | KFACB0401CFB | 054, 070 |
| Downflow Conversion Kit | KFADC0201SLP | Slope Coil Units — 018, 024, 030, 033, 036, 042 |
| | KFADC0401ACL | A-Coil Units — 038, 048, 054, 060, 070 |
| Single-Point Wiring Kit | KFASP0101SPK | 15 and 20 kw Fuse |
| Filter Kit (12 Pack) | KFAFK0112SML | 018, 024 |
| | KFAFK0212MED | 030, 036 |
| | KFAFK0312LRG | 033, 038, 042, 048, 060 |
| | KFAFK0412XXL | 054, 070 |
| Power Plug Kit (25 Pack) | KFAPP0125PLG | FA4A 018–060 |

* Factory-authorized and listed, field installed.

Accessory Kits Description Suggested and Required Use

1. Disconnect Kit

The kit is used to disconnect electrical power to the fan coil so service or maintenance may be performed safely.

SUGGESTED USE: FK4, FC4, FB4, FA4, and FH4 units for 3kw through 10kw electric resistance heaters and cooling controls.

2. Downflow Base Kit

This kit is designed to provide a 1-in. minimum clearance between unit discharge plenum, ductwork, and combustible materials. It also provides a gap free seal with the floor.

REQUIRED USE: This kit must be used whenever FK4, FC4, FB4, FA4, and FH4 fan coils are used in downflow applications.

3. Downflow Conversion Kit

Fan coils are shipped from the factory for upflow or horizontal-left applications. Downflow conversion kits provide proper condensate water drainage and support for the coil when used in downflow applications. Separate kits are available for slope coils and A-coils.

REQUIRED USE: This kit must be used whenever FK4, FC4, FB4, and FA4 fan coils are used in downflow applications.

4. Single Point Wiring Kit

The single point wiring kit acts as a jumper between L1 and L3 lugs, and between the L2 and L4 lugs. This allows the installer to run 2 heavy-gage, high-voltage wires into the fan coil rather than 4 light-gage, high-voltage wires.

SUGGESTED USE: FK4, FC4, FB4, FA4, and FH4 fan coils only with 15kw and 20kw heaters.

5. Fan Coil Filter

The kit consists of 12 fan coil framed filters. These filters collect large dust particles from the return air entering the fan coil and prevents them from collecting on the coil. This process helps to keep the coil clean, which increases heat transfer and in turn the efficiency of the system.

SUGGESTED USE: To replace filters in FK4, FC4, FB4, FA4, and FH4 fan coils.

REQUIRED USE: All FA4 units unless a filter grille is used.

6. Power Plug Kit

The kit consists of 25 wire harness assemblies. Each plug provides the high-voltage power connection to the fan coil in the absence of electric heat.

REQUIRED USE: FA4A units installed without electric heat.

Accessory electric heaters

| HEATER PART NO. | KW @ 240V | VOLTS/PH | KW/STAGE | INTERNAL CIRCUIT PROTECTION | FAN COIL SIZE USED WITH | HEATING CAP.** @ 230V |
|-----------------|-----------|----------|----------|-----------------------------|-------------------------|-----------------------|
| KFAEH0101N03 | 3 | 230/1 | 3 | None‡ | 018-024 | 9,400 |
| KFAEH0201N05 | 5 | 230/1 | 5 | None‡ | 018-038 | 15,700 |
| KFAEH0301N08 | 8 | 230/1 | 8 | None‡ | 018-070 | 25,100 |
| KFAEH0401N10 | 10 | 230/1 | 10 | None‡ | 018-070 | 31,400 |
| KFAEH0601F20 | 20 | 230/1 | 10,10 | Fuse | 030-070 | 62,800 |
| KFAEH0801315 | 15 | 230/3 | 5,10 | None‡ | 036-070 | 47,100 |
| KFAEH0901318 | 18 | 230/3 | 6,6,6 | None‡ | 042-070 | 56,500 |
| KFAEH1001F24 | 24 | 230/3* | 8,8,8 | Fuse | 048, 060, 070 | 78,300 |
| KFAEH1101F30 | 30 | 230/3* | 10,10,10 | Fuse | 048, 060, 070 | 94,100 |
| KFAEH1301C05 | 5 | 230/1 | 5 | Circuit Braker‡ | 018-038 | 15,700 |
| KFAEH1401C08 | 8 | 230/1 | 8 | Circuit Braker‡ | 018-038 | 25,100 |
| KFAEH1501C10 | 10 | 230/1 | 10 | Circuit Braker‡ | 018-070 | 31,400 |
| KFAEH1701C20 | 20 | 230/1 | 10,10 | Circuit Braker‡ | 030-070 | 62,800 |
| KFAEH1901S20 | 20 | 230/1 | 10,10 | Fuse‡ | 030-070 | 62,800 |
| KFAEH2501N09 | 9 | 230/1† | 3,6 | None‡ | 030-070 | 28,200 |
| KFAEH2601F15 | 15 | 230/1 | 5,10 | Fuse | 024-070 | 47,100 |
| KFAEH2701S15 | 15 | 230/1 | 5,10 | Fuse‡ | 024-070 | 47,100 |
| KFAEH2801C15 | 15 | 230/1 | 5,10 | Circuit Braker‡ | 024-070 | 47,100 |

Smart heat

| HEATER PART NO. | KW @ 240V | VOLTS/PH | KW/STAGE | INTERNAL CIRCUIT PROTECTION | FAN COIL SIZE USED WITH | HEATING CAP.** @ 230V |
|-----------------|-----------|----------|----------|-----------------------------|-------------------------|-----------------------|
| KFAEH2201H10 | 10 | 230/1 | 4,6 | None‡ | 018-036 | 31,400 |
| KFAEH2301H15 | 15 | 230/1 | 3,8,4 | Fuse | 024-048 | 47,100 |
| KFAEH2401H20 | 20 | 230/1 | 5,10,5 | Fuse | 030-070 | 62,800 |

* Field convertible to 1 phase.

† Field convertible to 3 phase.

‡ Approved for Canadian application.

** Blower motor heat not included.

When using units with 20-, 24-, and 30-kw electric heaters, maintain a 1-in. clearance from combustible materials to discharge plenum and ductwork and maintain a distance of 36 in. from the unit. Use an accessory downflow base to maintain proper clearance on downflow installations.

Use flexible connectors between ductwork and unit to prevent transmission of vibration. When electric heater is installed, use heat resistant material for flexible connector between ductwork and unit at discharge connection. Ductwork passing through unconditioned space must be insulated and covered with vapor barrier.

**FAN COIL ELECTRICAL DATA
(UNITS WITHOUT ELECTRICAL HEAT)**

| UNIT SIZE | VOLTS (1 PHASE) | FLA | MIN CKT AMPS | BRANCH CIRCUIT | | | |
|-----------|-----------------|-----|--------------|--------------------|-----------------------|------|-----------|
| | | | | Min Wire Size* Awg | Max Wire Length (Ft)† | | Fuse Amps |
| | | | | | 208v | 230v | |
| 018 | 208/230 | 1.6 | 2.0 | 14 | 325 | 350 | 15 |
| 024 | 208/230 | 2.0 | 2.5 | 14 | 250 | 275 | 15 |
| 030, 033 | 208/230 | 2.4 | 3.0 | 14 | 210 | 225 | 15 |
| 036, 038 | 208/230 | 3.2 | 4.0 | 14 | 150 | 175 | 15 |
| 042, 054 | 208/230 | 3.4 | 4.7 | 14 | 125 | 150 | 15 |
| 048 | 208/230 | 5.5 | 6.9 | 14 | 90 | 100 | 15 |
| 060, 070 | 208/230 | 5.4 | 6.8 | 14 | 90 | 100 | 15 |

* Use copper wire only. Use 75°C only in this application. When using non-metallic (NM) sheathed cable, wire size required should be based on that of 60°C conductors, instead of wire sizes shown in table above per NEC 1993 Article 336-26.

† Length shown is as measured one way along wire path between unit and service panel for a voltage drop not to exceed 2%.

FLA — Full Load Amps

ELECTRIC HEATER INTERNAL PROTECTION

| HEATER KW | PHASE | FUSE QTY/SIZE | CKT BKR QTY/SIZE |
|-----------|-------|---------------|------------------|
| 3 | 1 | — | — |
| 5 | 1 | — | 2/60 |
| 8 | 1 | — | 2/60 |
| 10 | 1 | — | 2/60 |
| 15 | 1 | 4/60 | 4/60 |
| 20 | 1 | 4/60 | 4/60 |
| 24 | 3/1 | 6/60 | — |
| 30 | 3/1 | 6/60 | — |
| 9 | 1/3 | — | — |
| 15 | 3 | — | — |
| 18 | 3 | — | — |

ESTIMATED SOUND POWER LEVEL (dB)

| UNIT SIZE | CONDITIONS | | OCTAVE BAND CENTER FREQUENCY | | | | | | | |
|-----------|------------|---------------------|------------------------------|----|-----|-----|-----|------|------|------|
| | CFM | Ext Static Pressure | Motor Rpm | 63 | 125 | 250 | 500 | 1000 | 2000 | 4000 |
| 018 | 650 | 0.25 | 950 | 63 | 59 | 55 | 54 | 50 | 48 | 44 |
| 024 | 875 | 0.25 | 1075 | 64 | 60 | 56 | 53 | 53 | 49 | 45 |
| 030, 033 | 1075 | 0.25 | 1075 | 65 | 61 | 57 | 54 | 54 | 50 | 46 |
| 036, 038 | 1300 | 0.25 | 1075 | 66 | 62 | 58 | 55 | 50 | 47 | |
| 042 | 1530 | 0.25 | 1075 | 67 | 63 | 59 | 56 | 56 | 52 | 48 |
| 048, 054 | 1750 | 0.25 | 1075 | 67 | 63 | 59 | 56 | 56 | 52 | 48 |
| 060 | 2000 | 0.25 | 1100 | 68 | 64 | 60 | 57 | 57 | 53 | 49 |
| 070 | 2000 | 0.25 | 1075 | 68 | 64 | 60 | 57 | 57 | 53 | 49 |

* Estimated sound power levels have been derived using the method described in the 1987 ASHRAE HVAC Systems & Applications Handbook, Chapter 52, p. 52.7.

ELECTRIC HEATER ELECTRICAL DATA

| HEATER PART NO. | KW | | PHASE | INTERNAL CIRCUIT PROTECTION | HEATER AMPS 208/230V | | | MIN AMPACITY 208/230V** | | | MIN WIRE SIZE (AWG) 208/230V†† | | | MIN GND WIRE SIZE 208/230V | | | FUSE/CKT BKR AMPS 208/230V | | | MAX. WIRE LENGTH 208/230V (FT)‡‡ | | | | | |
|-----------------|------|------|-------|-----------------------------|----------------------|---------------------|-----------|-------------------------|---------------------|-----------|--------------------------------|---------------------|--------|----------------------------|---------------------|--------|----------------------------|---------------------|--------|----------------------------------|---------------------|--------|----------------|---------------------|--------|
| | 240V | 208V | | | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| KFAEH101N03 | 3 | 2.3 | 1 | None | 10.9/12.0 | — | — | — | 16.2/17.5 | — | — | 12/12 | 12/12 | — | 20/20 | — | — | 63/65 | — | — | — | — | — | — | |
| KFAEH0201N05 | 5 | 3.8 | 1 | None | 18.1/20.0 | — | — | — | 31.2/33.5 | — | — | 8/8 | 8/8 | — | 40/40 | — | — | 81/85 | — | — | — | — | — | — | |
| KFAEH1301C05 | 5 | 3.8 | 1 | Ckt Bkr | 18.1/20.0 | — | — | — | 31.2/33.5 | — | — | 8/8 | 8/8 | — | 40/40 | — | — | 81/85 | — | — | — | — | — | — | |
| KFAEH0301N08 | 8 | 6.0 | 1 | None | 28.9/32.0 | — | — | — | 43.0/46.9 | — | — | 8/8 | 8/8 | — | 45/50 | — | — | 61/62 | — | — | — | — | — | — | |
| KFAEH1401C08 | 8 | 6.0 | 1 | Ckt Bkr | 28.9/32.0 | — | — | — | 43.0/46.9 | — | — | 8/8 | 8/8 | — | 45/50 | — | — | 61/62 | — | — | — | — | — | — | |
| KFAEH2501N09* | 9 | 6.8 | 1 | None | 32.8/36.0 | — | — | — | 47.9/51.9 | — | — | 6/6 | 6/6 | — | 50/60 | — | — | 94/96 | — | — | — | — | — | — | |
| KFAEH0401N10 | 10 | 7.5 | 1 | None | 18.8/20.8 | — | — | — | 30.4/32.9 | — | — | 8/8 | 10/10 | — | 35/35 | — | — | 108/111 | — | — | — | — | — | — | |
| KFAEH1501C10 | 10 | 7.5 | 1 | Ckt Bkr | 36.2/40.0 | — | — | — | 52.2/56.9 | — | — | 6/6 | 6/6 | — | 60/60 | — | — | 78/79 | — | — | — | — | — | — | |
| KFAEH2601F15 | 15 | 11.3 | 1 | Fuse | 54.2/59.9 | 36.2/40.0 | 18.1/20.0 | 44 | 74.7/81.8 | 52.2/56.9 | 22.7/25.0 | 4/4 | 6/6 | 10/10 | 80/90 | 60/60 | 25/25 | 86/87 | 78/79 | 78/79 | 78/79 | 78/79 | 78/79 | | |
| KFAEH2701S15 | 15 | 11.3 | 1 | Fuse‡ | 54.2/59.9 | 36.2/40.0 | 18.1/20.0 | 44 | 74.7/81.8 | 52.2/56.9 | 22.7/25.0 | 4/4 | 6/6 | 10/10 | 80/90 | 60/60 | 25/25 | 86/87 | 78/79 | 78/79 | 78/79 | 78/79 | 78/79 | | |
| KFAEH2801C15 | 15 | 11.3 | 1 | Ckt Bkr | — | 36.2/40.0 | 18.1/20.0 | — | 52.2/56.9 | — | 22.7/25.0 | — | — | 10/10 | — | 60/60 | 25/25 | — | 78/79 | 78/79 | 78/79 | 78/79 | 78/79 | | |
| KFAEH0801315 | 15 | 11.3 | 3 | None | 31.3/34.6 | — | — | — | 46.0/50.2 | — | — | 8/6 | 10/10 | — | 50/50 | — | — | 71/112 | — | — | — | — | — | — | |
| KFAEH0901318 | 18 | 13.5 | 3 | None | 37.6/41.5 | — | — | — | 53.9/58.8 | — | — | 6/6 | 10/10 | — | 60/60 | — | — | 94/95 | — | — | — | — | — | — | |
| KFAEH0601F20 | 20 | 15.0 | 1 | Fuse | 72.3/79.9 | 36.2/40.0 | 36.2/40.0 | 3/2 | 97.3/106.8 | 52.2/56.9 | 45.3/50.0 | 3/2 | 6/6 | 10/10 | 100/110 | 60/60 | 50/50 | 84/106 | 78/79 | 58/58 | 58/58 | 58/58 | 58/58 | | |
| KFAEH1701C20 | 20 | 15.0 | 1 | Ckt Bkr | — | 36.2/40.0 | 36.2/40.0 | — | 52.2/56.9 | — | 45.3/50.0 | — | — | 10/10 | — | 60/60 | 50/50 | — | 78/79 | 78/79 | 78/79 | 78/79 | 78/79 | | |
| KFAEH1901S20 | 20 | 15.0 | 1 | Fuse‡ | 72.3/79.9 | 36.2/40.0 | 36.2/40.0 | 3/2 | 97.3/106.8 | 52.2/56.9 | 45.3/50.0 | 3/2 | 6/6 | 10/10 | 100/110 | 60/60 | 50/50 | 84/106 | 78/79 | 58/58 | 58/58 | 58/58 | 58/58 | | |
| KFAEH1001F24† | 24 | 18.0 | 3 | Fuse | 50.1/55.4 | — | — | — | 69.5/76.2 | — | — | 4/4 | — | — | 80/80 | — | — | 116/117 | — | — | — | — | — | — | |
| KFAEH1001F24† | 24 | 18.0 | 1 | Fuse | 86.7/95.5 | — | — | — | 116.0/127.0 | — | — | 1/1 | 6/6 | — | 125/150 | — | — | 112/113 | — | — | — | — | — | — | |
| KFAEH2201H10 | 10 | 7.5 | 1 | None | 32.5/35.9 | — | — | — | 44.6/48.9 | — | — | 6/6 | 10/10 | — | 50/50 | — | — | 101/102 | — | — | — | — | — | — | |
| KFAEH2301H15 | 15 | 11.3 | 1 | Fuse | 54.2/59.9 | 39.7/43.9 | 14.4/16.0 | 4/4 | 74.6/81.7 | 48.7/54.9 | 24.9/26.8 | 4/4 | 6/6 | 10/10 | 80/90 | 50/60 | 30/30 | 90/91 | 91/91 | 89/70 | 89/70 | 89/70 | 89/70 | | |
| KFAEH2401H20 | 20 | 15.0 | 1 | Fuse | 72.3/79.9 | 36.2/40.0 | 36.2/40.0 | 3/2 | 97.3/106.8 | 52.2/56.9 | 45.3/50.0 | 3/2 | 6/6 | 10/10 | 100/110 | 60/60 | 50/50 | 84/106 | 78/79 | 58/58 | 58/58 | 58/58 | 58/58 | | |

SMART HEAT ELECTRICAL DATA


| HEATER PART NO. | KW | | PHASE | INTERNAL CIRCUIT PROTECTION | HEATER AMPS 208/230V | | | MIN AMPACITY 208/230V** | | | MIN WIRE SIZE (AWG) 208/230V†† | | | MIN GND WIRE SIZE 208/230V | | | FUSE/CKT BKR AMPS 208/230V | | | MAX. WIRE LENGTH 208/230V (FT)‡‡ | | | | | |
|-----------------|------|------|-------|-----------------------------|----------------------|---------------------|-----------|-------------------------|---------------------|-----------|--------------------------------|---------------------|--------|----------------------------|---------------------|--------|----------------------------|---------------------|--------|----------------------------------|---------------------|--------|----------------|---------------------|--------|
| | 240V | 208V | | | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| KFAEH2201H10 | 10 | 7.5 | 1 | None | 32.5/35.9 | — | — | — | 44.6/48.9 | — | — | 6/6 | 10/10 | — | 50/50 | — | — | 101/102 | — | — | — | — | — | — | |
| KFAEH2301H15 | 15 | 11.3 | 1 | Fuse | 54.2/59.9 | 39.7/43.9 | 14.4/16.0 | 4/4 | 74.6/81.7 | 48.7/54.9 | 24.9/26.8 | 4/4 | 6/6 | 10/10 | 80/90 | 50/60 | 30/30 | 90/91 | 91/91 | 89/70 | 89/70 | 89/70 | 89/70 | | |
| KFAEH2401H20 | 20 | 15.0 | 1 | Fuse | 72.3/79.9 | 36.2/40.0 | 36.2/40.0 | 3/2 | 97.3/106.8 | 52.2/56.9 | 45.3/50.0 | 3/2 | 6/6 | 10/10 | 100/110 | 60/60 | 50/50 | 84/106 | 78/79 | 58/58 | 58/58 | 58/58 | 58/58 | | |

FIELD MULTIPOINT WIRING OF 24- AND 30-KW SINGLE PHASE

| HEATER PART NO. | KW | | PHASE | HEATER AMPS 208/230V | | | MIN AMPACITY 208/230V** | | | MIN WIRE SIZE (AWG) 208/230V†† | | | MIN GND WIRE SIZE 208/230V | | | FUSE/CKT BKR AMPS 208/230V | | | MAX. WIRE LENGTH 208/230V (FT)‡‡ | | | | | |
|-----------------|------|------|-------|----------------------|---------------------|-----------|-------------------------|----------------|---------------------|--------------------------------|-----------|----------------|----------------------------|-----------|-----------|----------------------------|---------------------|-----------|----------------------------------|---------------------|-----------|----------------|---------------------|--------|
| | 240V | 208V | | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | L5, L6 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | L5, L6 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | L5, L6 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 | SINGLE CIRCUIT | DUAL CIRCUIT L1, L2 | L3, L4 |
| | | | | | | | | | | | | | | | | | | | | | | | | |
| KFAEH1001F24† | 24 | 18.0 | 1 | 28.9/32.0 | 36.2/40.0 | 36.2/40.0 | 43.0/46.9 | 45.1/50.0 | 45.1/50.0 | 45.1/50.0 | 45.1/50.0 | 45.1/50.0 | 45.1/50.0 | 45.1/50.0 | 45.1/50.0 | 45.1/50.0 | 45.1/50.0 | 45.1/50.0 | 45.1/50.0 | 45.1/50.0 | 45.1/50.0 | 45.1/50.0 | 45.1/50.0 | |
| KFAEH1101F30† | 30 | 22.5 | 1 | 36.2/40.0 | 36.2/40.0 | 36.2/40.0 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | 52.2/56.9 | |

* Field convertible to 3 phase.
 † Field convertible to 1 phase, single or multiple supply circuit.
 ‡ Approved for Canadian application.
 ** Includes blower motor amps of largest fan coil used with heater.
 †† Copper wire must be used. If other than uncoated (non-plated), 75°C ambient, copper wire (solid wire for 10 AWG and smaller, stranded wire for larger than 10 AWG) is used, consult applicable tables of the National Electric Code (ANSI/NFPA 70).
 ‡‡ Length shown is as measured 1 way along wire path between unit and service panel for a voltage drop not to exceed 2%.
NOTE: Single circuit application of F15 and F20 heaters requires single-point wiring kit accessory.

Matched system

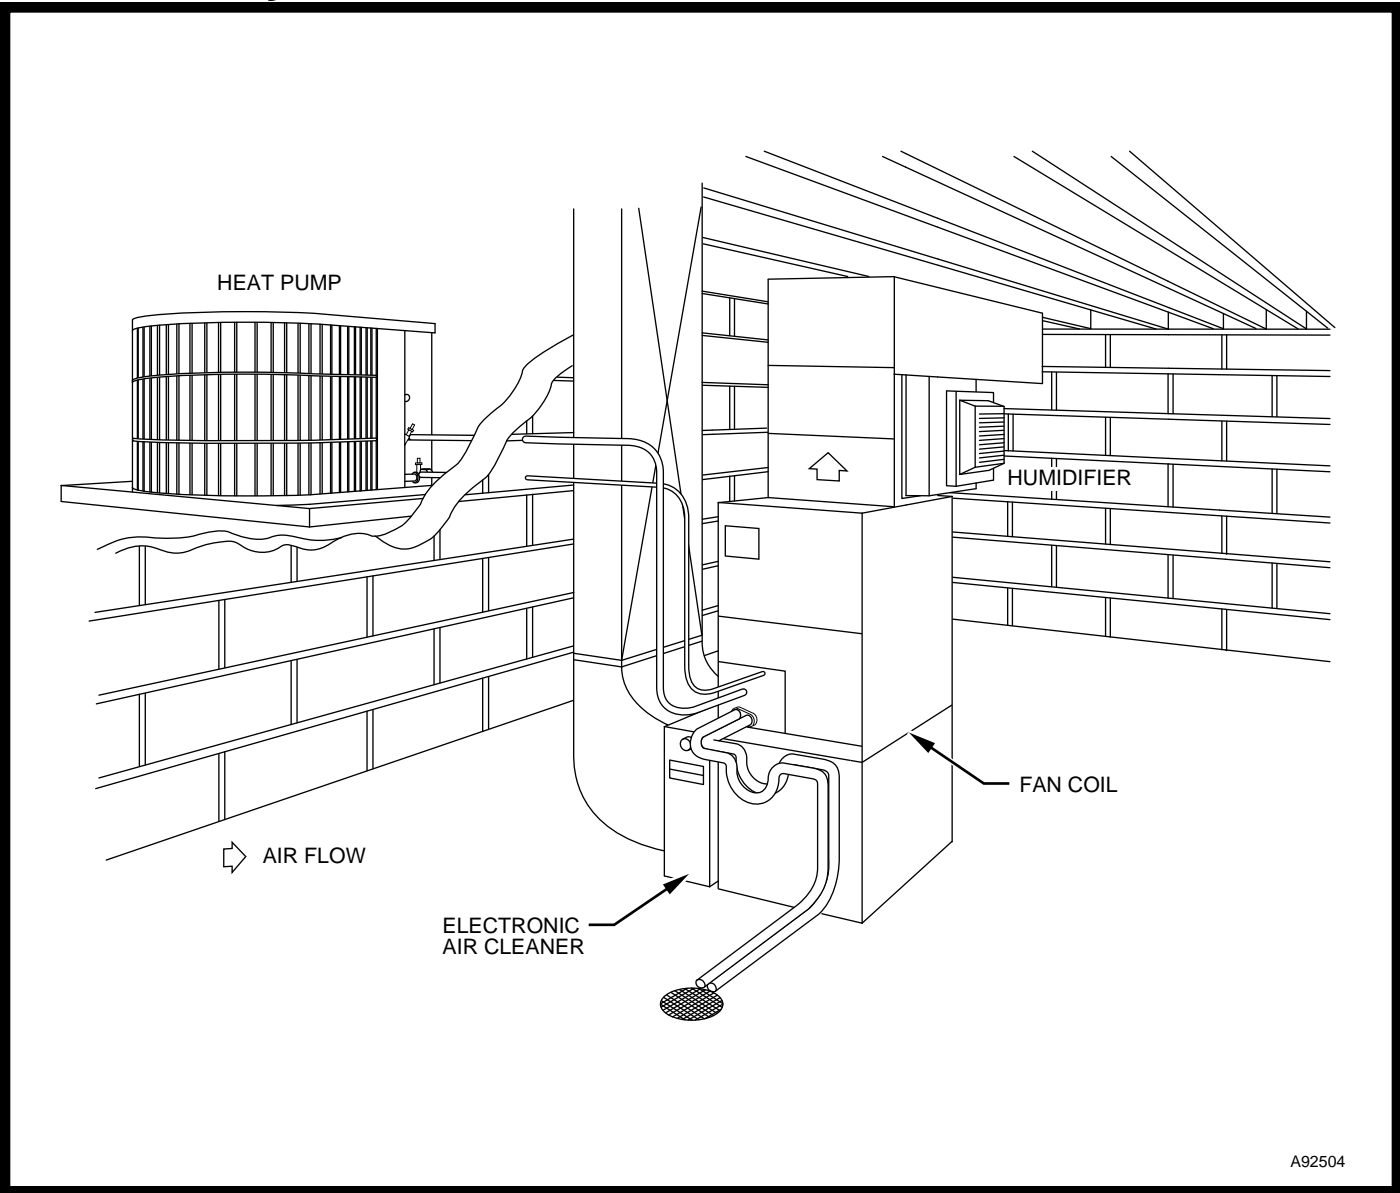

A92504

SERVICE TRAINING

Packaged Service Training programs are an excellent way to increase your knowledge of the equipment discussed in this manual, including:

- Unit Familiarization
- Maintenance
- Installation Overview
- Operating Sequence

A large selection of product, theory, and skills programs is available, using popular video-based formats and materials. All include video and/or slides, plus companion book.

Classroom Service Training plus "hands-on" the products in our labs can mean increased confidence that really pays dividends in faster troubleshooting, fewer callbacks. Course descriptions and schedules are in our catalog.

CALL FOR FREE CATALOG 1-800-962-9212

Packaged Service Training

Classroom Service Training

A94328